



CHILLED WATER

Fan Coil & Air Handling Units



temperzone
climate innovations

Chilled Water
Solutions For
Every Project



How we combine superior performance and energy savings

In a complex world of chilled water technology, Temperzone offer a wide range of solutions.

The sky's the limit with Temperzone water-cooled systems

Temperzone has an extensive range of chilled water products, we have the product to suit your air movement requirements.


All models can be air flow controlled to match the required load profile either through simple local control or through a building management system.

The premium range incorporates EC fan technology, offering a higher efficiency operation compared to traditional AC alternatives.


All Temperzone units incorporate high efficiency heat transfer coils to extract the most out of your chilled water system. Temperzone units have a range of heat transfer coil options adaptable to a wide spectrum of chilled water system operating parameters. Whatever the water temperature and flow rate requirements, Temperzone has a solution to match your needs.




Advantage range (underceiling) (GMW) 06



Advantage range (low profile) (IMDL) 18



Premium range (low profile) (IMDL-Y) 28



Premium range (Multizone) (IXDL-Y) 38



Advantage range (Compact FCU) (IMD) 52




Premium range (Compact FCU) (IMD-Y) 68



Advantage range (AHU) (IJD) 84

Advantage GMW Range (Underceiling)

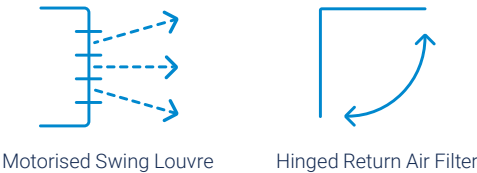

Advantage Range (GMW) Specifications

Model	GMW 50	GMW 70	GMW 80	GMW 140	GMW 160
Features					
Nominal Air Flow (l/s) * ¹ 'H Series'	175	240	375	625	815
Nominal Air Flow (l/s) * ¹ 'S Series'	150	170	295	520	N/A
Fan Type	Forward Curved Centrifugal Double Inlet Double Width				
Power Source * ²	1 Phase 230 Volt AC 50 Hz				
Full Load Amps (A) 'H Series'	0.45	0.9	0.7	1.4	2.0
Full Load Amps (A) 'S Series'	0.37	0.74	0.37	0.74	N/A
Fan Motor Type	Three Speed, Direct Drive				
Heat Exchanger Type	Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tube				
Finish	Polyester Powder Coat + White PVC				
Test Pressure	2100 kPa				
Cooling & Heating					
Cooling/Heating Medium	Chilled Water or Hot Water				
Coil Connection - Cooling 2 Row	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 20 (¾" BSP)	Ø 20 (¾" BSP)	Ø 20 (¾" BSP)
Coil Connection - Cooling 3 Row	Ø 15 (½" BSP)	Ø 20 (¾" BSP)	Ø 20 (¾" BSP)	Ø 20 (¾" BSP)	Ø 25 (1" BSP)
Coil Connection - Heating 1 Row	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)
Filters					
Air Filter Type	Plastic Net - Washable				
Weight					
Weight Incl. Water (kg)	28	40	51	79	79
Nett Dry Weight (kg)	27	38	48	74	74
Shipping Weight (kg)	30	41	51	78	78
Notes:	* ¹ With standard screen filter fitted and a dry coil surface. * ² Voltage range 220-240V		Cooling and Heating Coil options: 3 Row Cooling Only 2 Row Cooling + 1 Row Heating		Fan Options H-Series 4 Pole Motor S-Series 6 Pole Motor

GMW 50S-3				Low Speed			Medium Speed			High Speed		
3 row chilled water coil				135 L/s			140 L/s			150 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering V temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.1	3.2	total	2.7	2.5	2.3	2.8	2.6	2.3	2.9	2.6	2.4
			sensible	1.9	1.8	1.7	1.9	1.8	1.7	2.0	1.9	1.8
	0.2	11.1	total	3.3	3.0	2.8	3.4	3.1	2.8	3.5	3.2	3.0
			sensible	2.1	2.0	1.9	2.2	2.1	1.9	2.3	2.2	2.0
	0.3	22.9	total	3.5	3.3	3.0	3.6	3.3	3.0	3.8	3.5	3.2
			sensible	2.2	2.1	2.0	2.3	2.2	2.0	2.4	2.3	2.1
27/19	0.1	3.2	total	3.3	3.1	2.9	3.4	3.2	2.9	3.5	3.2	3.0
			sensible	2.3	2.3	2.2	2.4	2.3	2.2	2.5	2.4	2.3
	0.2	11.1	total	4.1	3.8	3.5	4.2	3.9	3.6	4.3	4.0	3.7
			sensible	2.6	2.5	2.4	3.7	2.6	2.5	2.8	2.7	2.6
	0.3	22.9	total	4.4	4.1	3.8	4.5	4.2	3.9	4.6	4.3	4.0
			sensible	2.7	2.6	2.5	2.8	2.7	2.6	3.0	2.8	2.7

GMW 50H-3				Low Speed			Medium Speed			High Speed		
3 row chilled water coil				155 L/s			165 L/s			175 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.1	3.2	total	2.9	2.7	2.4	3.0	2.7	2.5	3.0	2.8	2.5
			sensible	2.0	1.9	1.8	2.1	2.0	1.9	2.2	2.1	2.0
	0.2	11.1	total	3.6	3.3	3.0	3.7	3.4	3.1	3.8	3.5	3.2
			sensible	2.3	2.2	2.1	2.4	2.3	2.2	2.5	2.4	2.3
	0.3	22.9	total	3.9	3.6	3.2	4.0	3.7	3.4	4.2	3.8	3.5
			sensible	2.4	2.3	2.2	2.6	2.4	2.3	2.7	2.5	2.4
27/19	0.1	3.2	total	3.5	3.3	3.0	3.6	3.3	3.1	3.7	3.4	3.1
			sensible	2.5	2.4	2.3	2.6	2.5	2.4	2.7	2.6	2.5
	0.2	11.1	total	4.4	4.1	3.8	4.5	4.2	3.9	4.7	4.4	4.0
			sensible	2.9	2.8	2.6	3.0	2.9	2.8	3.1	3.0	2.9
	0.3	22.9	total	4.7	4.4	4.1	4.9	4.6	4.3	5.1	4.8	4.4
			sensible	3.0	2.9	2.8	3.2	3.0	2.9	3.3	3.2	3.0

GMW 50S-2/1				135 L/s			140 L/s			150 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.1	2.8	total	2.5	2.3	2.1	2.5	2.3	2.1	2.5	2.4	2.1
			sensible	1.7	1.6	1.6	1.7	1.7	1.6	1.8	1.7	1.7
	0.2	9.5	total	3.0	2.8	2.5	3.1	2.8	2.6	3.2	2.9	2.7
			sensible	1.9	1.8	1.7	2.0	1.9	1.8	2.1	2.0	1.9
	0.3	19.5	total	3.2	3.0	2.7	3.3	3.0	2.8	3.4	3.2	2.9
			sensible	2.0	1.9	1.8	2.1	2.0	1.9	2.2	2.1	1.9
27/19	0.1	2.8	total	3.0	2.8	2.6	3.0	2.8	2.6	3.1	2.9	2.7
			sensible	2.1	2.0	2.0	2.2	2.1	2.0	2.3	2.2	2.1
	0.2	9.5	total	3.7	3.4	3.2	3.8	3.5	3.2	3.9	3.6	3.4
			sensible	2.4	2.3	2.2	2.4	2.4	2.2	2.6	2.5	2.4
	0.3	19.5	total	4.0	3.7	3.4	4.1	3.8	3.5	4.2	3.9	3.6
			sensible	2.5	2.4	2.3	2.6	2.5	2.4	2.7	2.6	2.5

GMW 50H-2/1				155 L/s			165 L/s			175 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.1	2.8	total	2.6	2.4	2.2	2.6	2.4	2.2	2.7	2.5	2.2
			sensible	1.9	1.8	1.7	1.9	1.8	1.7	2.0	1.9	1.8
	0.2	9.5	total	3.2	3.0	2.7	3.3	3.1	2.8	3.4	3.2	2.9
			sensible	2.1	2.0	1.9	2.2	2.1	2.0	2.3	2.2	2.1
	0.3	19.5	total	3.5	3.2	2.9	3.7	3.4	3.0	3.8	3.5	3.1
			sensible	2.2	2.1	2.0	2.3	2.2	2.1	2.4	2.3	2.2
27/19	0.1	2.8	total	3.1	2.9	2.7	3.2	3.0	2.8	3.3	3.1	2.8
			sensible	2.3	2.2	2.1	2.4	2.3	2.2	2.5	2.4	2.3
	0.2	9.5	total	4.0	3.7	3.4	4.1	3.8	3.5	4.2	3.9	3.6
			sensible	2.6	2.5	2.4	2.7	2.6	2.5	2.8	2.7	2.6
	0.3	19.5	total	4.3	4.0	3.7	4.5	4.2	3.9	4.6	4.3	4.0
			sensible	2.8	2.6	2.5	2.9	2.8	2.6	3.0	2.9	2.7

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.03	2.7	heat	1.3	1.8	2.4	1.3	1.9	2.4	1.3	1.9	2.5
	0.06	9.3	heat	1.5	2.1	2.7	1.5	2.1	2.8	1.5	2.2	2.9
	0.09	19.5	heat	1.6	2.3	2.9	1.6	2.3	3.0	1.6	2.3	3.1
21	0.03	2.7	heat	1.1	1.6	2.2	1.1	1.6	2.2	1.1	1.7	2.2
	0.06	9.3	heat	1.2	1.9	2.5	1.2	1.9	2.5	1.3	1.9	2.6
	0.09	19.5	heat	1.3	2.0	2.7	1.3	2.0	2.7	1.4	2.1	2.8

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.03	2.7	heat	1.4	2.0	2.5	1.4	2.0	2.6	1.4	2.0	2.7
	0.06	9.3	heat	1.6	2.2	2.9	1.6	2.3	3.0	1.6	2.4	3.1
	0.09	19.5	heat	1.7	2.4	3.1	1.7	2.5	3.2	1.8	2.5	3.3
21	0.03	2.7	heat	1.1	1.7	2.3	1.2	1.8	2.4	1.2	1.8	2.4
	0.06	9.3	heat	1.3	2.0	2.6	1.3	2.0	2.7	1.4	2.1	2.8
	0.09	19.5	heat	1.4	2.1	2.8	1.4	2.2	2.9	1.5	2.2	3.0

GMW 70S-3				Low Speed			Medium Speed			High Speed		
3 row chilled water coil				160 L/s			167 L/s			170 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	4.6	total	3.9	3.5	3.2	3.9	3.6	3.3	4.0	3.6	3.3
			sensible	2.5	2.4	2.2	2.6	2.4	2.3	2.6	2.5	2.3
	0.3	9.5	total	4.2	3.8	3.5	4.3	3.9	3.6	4.3	4.0	3.6
			sensible	2.6	2.5	2.3	2.7	2.6	2.4	2.7	2.6	2.4
	0.4	15.9	total	4.3	4.0	3.6	4.5	4.1	3.8	4.5	4.2	3.8
			sensible	2.7	2.6	2.4	2.8	2.6	2.5	2.8	2.7	2.5
27/19	0.2	4.6	total	4.7	4.4	4.1	4.8	4.5	4.2	4.9	4.5	5.2
			sensible	3.1	2.9	2.8	3.2	3.0	2.9	3.2	3.1	2.9
	0.3	9.5	total	5.1	4.8	4.4	5.3	4.9	4.5	5.3	5.0	4.6
			sensible	3.3	3.1	3.0	3.4	3.2	3.1	3.4	3.3	30.9
	0.4	15.9	total	5.3	5.0	4.6	5.5	5.1	4.8	5.5	5.2	4.8
			sensible	3.3	3.2	3.0	3.4	3.3	3.1	3.5	3.3	3.2

GMW 70H-3				Low Speed			Medium Speed			High Speed		
3 row chilled water coil				220 L/s			230 L/s			240 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	4.6	total	4.5	4.1	3.7	4.6	4.2	3.8	4.7	4.3	3.9
			sensible	3.0	2.9	2.7	3.1	3.0	2.8	3.2	3.1	2.9
	0.3	9.5	total	5.0	4.6	4.2	5.1	4.7	4.3	5.3	4.8	4.4
			sensible	3.3	3.1	2.9	3.4	3.2	3.0	3.5	3.3	3.1
	0.4	15.9	total	5.3	4.9	4.5	5.5	5.0	4.5	5.6	5.1	4.7
			sensible	3.4	3.2	3.0	3.5	3.3	3.1	3.6	3.4	3.2
27/19	0.2	4.6	total	5.5	5.1	4.7	5.6	5.2	4.8	5.7	5.3	4.9
			sensible	3.8	3.6	3.5	3.9	3.7	3.6	4.0	3.8	3.7
	0.3	9.5	total	6.1	5.7	5.3	6.3	5.9	5.4	6.4	6.0	5.6
			sensible	4.0	3.9	3.7	4.1	4.0	3.8	4.3	4.1	3.9
	0.4	15.9	total	6.5	6.1	5.6	6.7	6.2	5.8	6.9	6.4	5.9
			sensible	4.2	4.0	3.8	4.3	4.1	3.9	4.4	4.3	4.1

GMW 70S-2/1				160 L/s			167 L/s			170 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	11.2	total	3.6	3.4	3.1	3.7	3.4	3.1	3.8	3.5	3.2
			sensible	2.3	2.2	2.1	2.4	2.3	2.2	2.4	2.3	2.2
	0.3	23.4	total	4.0	3.6	3.3	4.0	3.7	3.4	4.1	3.8	3.4
			sensible	2.5	2.3	2.2	2.5	2.4	2.3	2.6	2.4	2.3
	0.4	38.9	total	4.1	3.8	3.4	4.2	3.9	3.5	4.3	3.9	3.6
			sensible	2.5	2.4	2.3	2.6	2.5	2.3	2.6	2.5	2.3
27/19	0.2	11.2	total	4.5	4.2	3.8	4.6	4.3	4.0	4.6	4.3	4.0
			sensible	2.9	2.8	2.6	3.0	2.9	2.7	3.0	2.9	2.8
	0.3	23.4	total	4.8	4.5	4.2	5.0	4.6	4.3	4.9	4.7	4.4
			sensible	3.0	2.9	2.8	3.1	3.0	2.9	3.2	3.0	2.9
	0.4	38.9	total	5.0	4.7	4.4	5.1	4.8	4.4	5.2	4.9	4.5
			sensible	3.1	3.0	2.8	3.2	3.1	2.7	3.3	3.1	3.0

GMW 70H-2/1				220 L/s			230 L/s			240 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	11.2	total	4.3	3.9	3.6	4.4	4.0	3.6	4.5	4.1	3.7
			sensible	2.9	2.7	2.6	2.9	2.8	2.7	3.0	2.9	2.7
	0.3	23.4	total	4.7	4.4	4.0	4.9	4.5	4.1	5.0	4.6	4.1
			sensible	3.1	2.9	2.7	3.1	3.0	2.8	3.2	3.1	2.9
	0.4	38.9	total	5.0	4.6	4.2	5.1	4.7	4.3	5.2	4.8	4.4
			sensible	3.2	3.0	2.8	3.2	3.1	2.9	3.3	3.2	3.0
27/19	0.2	11.2	total	5.2	4.9	4.5	5.3	5.0	4.6	5.4	5.1	4.7
			sensible	3.5	3.4	3.3	3.6	3.5	3.4	3.7	3.6	3.5
	0.3	23.4	total	5.8	5.4	5.0	6.0	5.5	5.1	6.1	5.6	5.2
			sensible	3.8	3.6	3.5	3.9	3.7	3.6	4.0	3.8	3.7
	0.4	38.9	total	6.1	5.7	5.3	6.3	5.8	5.4	6.4	6.0	5.5
			sensible	3.9	3.7	3.6	4.0	3.8	3.7	4.1	3.9	3.8

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.03	3.3	heat	1.6	2.5	2.9	1.6	2.3	2.9	1.6	2.3	3.0
	0.06	11.3	heat	1.8	2.6	3.4	1.9	2.7	3.5	1.9	2.7	3.5
	0.09	23.3	heat	2.0	2.8	3.7	2.0	2.9	3.7	2.0	2.9	3.8
21	0.03	3.3	heat	1.3	2.0	2.6	1.3	2.0	2.7	1.3	2.0	2.7
	0.06	11.3	heat	1.5	2.3	3.1	1.5	2.3	3.2	1.6	2.4	3.2
	0.09	23.3	heat	1.6	2.5	3.3	1.7	2.5	3.4	1.7	2.6	3.4

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.03	3.3	heat	1.8	2.6	3.3	1.8	2.6	3.4	1.8	2.6	3.4
	0.06	11.3	heat	2.1	3.0	3.9	2.1	3.0	3.9	2.2	3.1	4.0
	0.09	23.3	heat	2.3	3.2	4.2	2.3	3.3	4.3	2.3	3.3	4.3
21	0.03	3.3	heat	1.5	2.2	3.0	1.5	2.3	3.0	1.5	2.3	3.1
	0.06	11.3	heat	1.7	2.6	3.5	1.8	2.7	3.6	1.8	2.7	3.6
	0.09	23.3	heat	1.9	2.8	3.8	1.9	2.9	3.9	1.9	2.9	3.9

GMW 80S-3				Low Speed			Medium Speed			High Speed		
				185 L/s			235 L/s			295 L/s		
				Entering water temp			Entering water temp			Entering water temp		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	6	7	8	6	7	8	6	7	8
23/17	0.2	1.1	total	4.0	3.7	3.4	4.5	4.2	3.8	5.0	4.6	4.2
			sensible	2.8	2.7	2.5	3.3	3.2	3.0	3.8	3.7	3.5
	0.4	3.7	total	4.5	4.2	3.8	5.3	4.8	4.4	6.0	5.5	5.0
			sensible	3.1	2.9	2.7	3.7	3.5	3.3	4.3	4.1	3.9
	0.6	7.7	total	4.8	4.4	4.0	5.6	5.2	4.7	6.5	6.0	5.4
			sensible	3.2	3.0	2.8	3.8	3.6	3.4	4.5	4.3	4.1
27/19	0.2	1.1	total	5.0	4.6	4.3	5.6	5.2	4.8	6.1	5.7	5.3
			sensible	3.5	3.4	3.2	4.1	4.0	3.8	4.8	4.6	4.5
	0.4	3.7	total	5.6	5.2	4.8	6.4	6.0	5.6	7.3	6.8	6.3
			sensible	3.8	3.6	3.5	4.5	4.3	4.1	5.3	5.1	4.9
	0.6	7.7	total	5.9	5.5	5.1	6.9	6.5	6.0	8.0	7.4	6.9
			sensible	3.9	3.7	3.6	4.7	4.5	4.3	5.6	5.3	5.1

GMW 80H-3				Low Speed			Medium Speed			High Speed		
				265 L/s			295 L/s			375 L/s		
				Entering water temp			Entering water temp			Entering water temp		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	6	7	8	6	7	8	6	7	8
23/17	0.2	1.1	total	4.8	4.4	4.0	5.0	4.6	4.2	5.4	5.0	4.5
			sensible	3.6	3.4	3.3	3.8	3.7	3.5	4.5	4.3	4.1
	0.4	3.7	total	5.6	5.2	4.7	6.0	5.5	5.0	6.7	6.2	5.6
			sensible	4.0	3.8	3.6	4.3	4.1	3.9	5.0	4.8	4.5
	0.6	7.7	total	6.0	5.5	5.0	6.5	6.0	5.4	7.4	6.8	6.2
			sensible	4.1	3.9	3.7	4.5	4.3	4.1	5.3	5.0	4.8
27/19	0.2	1.1	total	5.8	5.5	5.0	6.1	5.7	5.3	6.6	6.1	5.7
			sensible	4.5	4.3	4.2	4.8	4.6	4.5	5.6	5.4	5.2
	0.4	3.7	total	6.9	6.4	6.0	7.3	6.8	6.3	8.2	7.6	7.1
			sensible	4.9	4.7	4.5	5.3	5.1	4.9	6.2	6.0	5.7
	0.6	7.7	total	7.5	7.0	6.4	8.0	7.4	6.9	9.1	8.5	7.8
			sensible	5.2	5.0	4.7	5.6	5.3	5.1	6.6	6.3	6.0

GMW 80S-2/1				185 L/s			235 L/s			295 L/s		
				Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	2.6	total	3.8	3.5	3.2	4.2	3.9	3.5	4.7	4.3	3.9
			sensible	2.7	2.5	2.4	3.1	3.0	2.8	3.6	3.4	3.3
	0.4	8.9	total	4.3	4.0	3.6	5.0	4.6	4.2	5.7	5.2	4.8
			sensible	2.9	2.7	2.6	3.4	3.3	3.1	4.0	3.8	3.6
	0.6	18.5	total	4.6	4.2	3.8	5.4	4.9	4.5	6.2	5.7	5.1
			sensible	3.0	3.8	2.7	3.6	3.4	3.2	4.2	4.0	3.8
27/19	0.2	2.6	total	4.7	4.4	4.0	5.2	4.9	4.5	5.7	5.3	4.9
			sensible	3.3	3.2	3.1	3.8	3.7	3.6	4.5	4.3	4.1
	0.4	8.9	total	5.3	5.0	4.6	6.2	5.7	5.3	6.9	6.5	6.0
			sensible	3.6	3.4	3.3	4.3	4.1	3.9	4.9	4.7	4.6
	0.6	18.5	total	5.7	5.3	4.9	6.6	6.2	5.7	7.6	7.1	6.6
			sensible	3.7	3.6	3.4	4.4	4.3	4.1	5.2	5.0	4.8

GMW 80H-2/1				265 L/s			295 L/s			375 L/s		
				Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	2.6	total	4.5	4.1	3.7	4.7	4.3	3.9	5.1	4.7	4.2
			sensible	3.3	3.2	3.0	3.6	3.4	3.3	4.1	4.0	3.8
	0.4	8.9	total	5.3	4.9	4.5	5.7	5.2	4.8	6.4	5.9	5.3
			sensible	3.7	3.5	3.3	4.0	3.8	3.6	4.7	4.5	4.2
	0.6	18.5	total	5.8	5.3	4.8	6.2	5.7	5.1	7.1	6.5	5.9
			sensible	3.9	3.7	3.5	4.2	4.0	3.8	5.0	4.7	4.5
27/19	0.2	2.6	total	5.5	5.1	4.7	5.7	5.3	4.9	6.2	5.8	5.4
			sensible	4.2	4.0	3.9	4.5	4.3	4.1	5.2	5.0	4.8
	0.4	8.9	total	6.6	6.1	5.7	6.9	6.5	6.0	7.8	7.3	6.7
			sensible	4.6	4.4	4.3	4.9	4.7	4.6	5.8	5.6	5.4
	0.6	18.5	total	7.2	6.7	6.2	7.6	7.1	6.6	8.8	8.1	7.5
			sensible	4.9	4.7	4.4	5.2	5.0	4.8	6.2	5.9	5.7

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
				50			50			50		
				50	65	80	50	65	80	50	65	80
15	0.1	5.5	heat	2.3	3.4	4.4	2.7	3.9	5.0	3.1	4.4	5.7
	0.15	11	heat	2.4	3.5	4.5	2.8	4.0	5.2	3.3	4.6	6.0
	0.2	18.6	heat	2.5	3.6	4.6	2.9	4.2	5.4	3.4	4.8	6.3
21	0.1	5.5	heat	1.9	2.9	3.9	2.2	3.4	4.5	2.5	3.8	5.1
	0.15	11	heat	2.0	3.0	4.1	2.3	3.5	4.7	2.7	4.1	5.4
	0.2	18.6	heat	2.1	3.1	4.2	2.4	3.6	4.9	2.8	4.2	5.7

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
				50			50			50		
				50	65	80	50	65	80	50	65	80
15	0.1	5.5	heat	2.9	4.1	5.4	3.1	4.4	5.7	3.5	5.0	6.5
	0.15	11	heat	3.1	4.4	5.7	3.3	4.6	6.0	3.7	5.3	6.9
	0.2	18.6	heat	3.2	4.5	5.9	3.4	4.8	6.3	3.9	5.5	7.2
21	0.1	5.5	heat	2.4	3.6	4.8	2.5	3.8	5.1	2.9	4.3	5.8
	0.15	11	heat	2.5	3.8	5.1	2.7	4.1	5.4	3.1	4.7	6.2
	0.2	18.6	heat	2.6	3.9	5.3	2.8	4.2	5.7	3.2	4.9	6.5

GMW 140S-3				Low Speed			Medium Speed			High Speed		
3 row chilled water coil				380 L/s			440 L/s			520 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.4	5.0	total	8.0	7.4	6.7	8.6	7.9	7.2	9.3	8.6	7.8
			sensible	5.7	5.4	5.1	6.3	6.0	5.7	7.0	6.7	6.4
	0.75	15.6	total	9.1	8.4	7.6	10.0	9.2	8.3	11.1	10.2	9.2
			sensible	6.2	5.9	5.5	6.9	6.5	6.1	7.7	7.4	6.9
	1.1	31.0	total	9.6	8.8	8.0	10.7	9.8	8.9	11.9	11.0	10.0
			sensible	6.4	6.0	5.7	7.2	6.7	6.4	8.1	7.7	7.3
27/19	0.4	5.0	total	9.8	9.1	8.5	10.6	9.8	9.1	11.4	10.7	9.8
			sensible	7.0	6.7	6.5	7.8	7.5	7.2	8.7	8.4	8.0
	0.75	15.6	total	11.2	10.4	9.7	12.3	11.4	10.6	13.5	12.6	11.7
			sensible	7.6	7.3	6.9	8.5	8.1	7.8	9.5	9.1	8.8
	1.1	31.0	total	11.8	11.0	10.2	13.1	12.2	11.3	14.6	13.7	12.6
			sensible	7.9	7.6	7.2	8.8	8.5	8.1	10.0	9.6	9.2

GMW 140H-3				Low Speed			Medium Speed			High Speed		
3 row chilled water coil				450 L/s			520 L/s			625 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.4	5.0	total	8.7	8.0	7.3	9.3	8.5	7.7	10.1	9.3	8.5
			sensible	6.3	6.1	5.7	7.0	6.7	6.3	7.9	7.6	7.2
	0.75	15.6	total	10.1	9.3	8.4	11.0	10.1	9.2	12.2	11.2	10.2
			sensible	7.0	6.6	6.2	7.7	7.3	6.9	8.8	8.4	7.9
	1.1	31.0	total	10.8	9.9	9.0	11.9	10.9	9.9	13.4	12.3	11.2
			sensible	7.3	6.9	6.5	8.1	7.7	7.2	9.3	8.8	8.3
27/19	0.4	5.0	total	10.7	9.9	9.2	11.4	10.6	9.8	12.3	11.4	10.6
			sensible	7.9	7.6	7.3	8.7	8.4	8.0	9.8	9.4	9.1
	0.75	15.6	total	12.4	11.6	10.7	13.5	12.6	11.6	15.0	13.9	12.9
			sensible	8.6	8.2	7.9	9.5	9.1	8.7	10.9	10.4	10.0
	1.1	31.0	total	13.3	12.4	11.5	14.6	13.7	12.6	16.4	15.3	14.1
			sensible	9.0	8.6	8.2	10.0	9.6	9.2	11.5	11.0	10.5

GMW 140S-2/1				380 L/s			440 L/s			520 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	7.3	total	7.0	6.4	5.9	7.5	6.9	6.2	8.0	7.3	6.7
			sensible	5.1	4.8	4.6	5.6	5.3	5.1	6.2	5.9	5.6
	0.5	18.3	total	8.0	7.4	6.7	8.7	8.0	7.2	9.5	8.7	7.9
			sensible	5.5	5.2	4.9	6.1	5.8	5.5	6.8	6.5	6.1
	0.7	33.5	total	8.6	7.9	7.2	9.4	8.6	7.8	10.4	9.5	8.7
			sensible	5.8	5.5	5.1	6.4	6.1	5.7	7.2	6.8	6.4
27/19	0.3	7.3	total	8.6	8.1	7.5	9.2	8.5	7.9	9.8	9.1	8.5
			sensible	6.3	6.1	5.8	6.9	6.7	6.4	7.7	7.4	7.2
	0.5	18.3	total	9.9	9.2	8.5	10.7	10.0	9.2	11.6	10.8	10.0
			sensible	6.8	6.5	6.2	7.5	7.2	6.9	8.4	8.1	7.8
	0.7	33.5	total	10.6	9.9	9.1	11.5	10.7	10.0	12.8	11.9	11.0
			sensible	7.1	6.8	6.5	7.9	7.5	7.2	8.9	8.5	8.1

GMW 140H-2/1				450 L/s			520 L/s			625 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	7.3	total	7.5	6.9	6.3	8.0	7.3	6.7	8.6	7.8	7.1
			sensible	5.6	5.4	5.1	6.2	5.9	5.6	6.9	6.6	6.3
	0.5	18.3	total	8.8	8.0	7.3	9.5	8.7	7.9	10.3	9.5	8.6
			sensible	6.2	5.9	5.6	6.8	6.5	6.1	7.6	7.3	6.9
	0.7	33.5	total	9.5	8.7	7.9	10.4	9.5	8.7	11.4	10.5	9.5
			sensible	6.5	6.1	5.8	7.2	6.8	6.4	8.1	7.7	7.3
27/19	0.3	7.3	total	9.2	8.6	8.0	9.8	9.1	8.5	10.4	9.8	9.0
			sensible	7.0	6.7	6.5	7.7	7.4	7.2	8.6	8.3	8.0
	0.5	18.3	total	10.8	10.1	9.3	11.6	10.8	10.0	12.7	11.8	10.9
			sensible	7.6	7.3	7.0	8.4	8.1	7.8	9.5	9.1	8.8
	0.7	33.5	total	11.7	10.9	10.2	12.8	11.9	11.0	14.1	13.1	12.1
			sensible	8.0	7.7	7.3	8.9	8.5	8.1	10.0	9.6	9.3

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.05	2.3	heat	3.6	5.1	6.6	3.8	5.4	7.1	4.1	5.8	7.6
	0.1	7.6	heat	4.1	5.9	7.7	4.4	6.4	8.3	4.8	6.9	9.0
	0.15	15.3	heat	4.4	6.3	8.1	4.8	6.8	8.9	5.2	7.5	9.7
21	0.05	2.3	heat	2.9	4.4	5.9	3.1	4.7	6.4	3.3	5.1	6.9
	0.1	7.6	heat	3.4	5.1	6.9	3.7	5.6	7.5	4.0	6.1	8.1
	0.15	15.3	heat	3.6	5.5	7.3	3.9	6.0	8.0	4.3	6.5	8.8

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.05	2.3	heat	3.8	5.5	7.1	4.1	5.8	7.5	4.3	6.1	8.1
	0.1	7.6	heat	4.5	6.4	8.4	4.8	6.9	9.0	5.3	7.6	9.9
	0.15	15.3	heat	4.8	6.9	9.0	5.2	7.5	9.7	5.8	8.3	10.8
21	0.05	2.3	heat	3.2	4.8	6.4	3.3	5.1	6.8	3.6	5.4	7.3
	0.1	7.6	heat	3.7	5.6	7.6	4.0	6.1	8.1	4.4	6.7	8.9
	0.15	15.3	heat	4.0	6.1	8.1	4.3	6.5	8.8	4.8	7.2	9.7


3 row chilled water coil				Low Speed			Medium Speed			High Speed		
				665 L/s			725 L/s			815 L/s		
				Entering water temp			Entering water temp			Entering water temp		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	6	7	8	6	7	8	6	7	8
23/17	0.4	5.0	total	10.3	9.5	8.6	10.7	9.8	8.9	11.2	10.3	9.4
			sensible	8.2	7.8	7.5	8.6	8.3	7.9	9.3	8.9	8.6
	0.75	15.6	total	12.6	11.6	10.5	13.2	12.1	11.0	14.0	12.8	11.7
			sensible	9.1	8.7	8.2	9.7	9.2	8.7	10.4	10.0	9.5
	1.1	31.0	total	13.9	12.7	11.5	14.6	13.4	12.2	15.7	14.4	13.1
			sensible	9.7	9.2	8.6	10.3	9.7	9.2	11.2	10.7	10.1
27/19	0.4	5.0	total	12.6	11.7	10.9	13.0	12.1	11.2	13.6	12.6	11.7
			sensible	10.2	9.8	9.5	10.7	10.4	10.1	11.6	11.2	10.9
	0.75	15.6	total	15.5	14.4	13.3	16.2	15.1	13.9	17.2	15.9	14.7
			sensible	11.3	10.9	10.5	12.0	11.5	11.1	13.0	12.5	12.0
	1.1	31.0	total	17.0	15.9	14.7	18.0	16.7	15.5	19.2	17.9	16.5
			sensible	12.0	11.5	11.0	12.7	12.2	11.7	13.8	13.3	12.7

2 row chilled water coil				665 L/s			725 L/s			815 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	7.3	total	8.7	8.0	7.3	9.0	8.3	7.5	9.3	8.6	7.8
			sensible	7.2	6.9	6.6	7.5	7.3	7.0	8.1	7.8	7.5
	0.5	18.3	total	10.7	9.8	8.9	11.0	10.2	9.2	11.7	10.7	9.7
			sensible	7.9	7.6	7.2	8.4	8.0	7.6	9.0	8.6	8.2
	0.7	33.5	total	11.9	10.9	9.8	12.4	11.3	10.3	13.1	12.0	10.9
			sensible	8.4	8.0	7.6	8.9	8.5	8.1	9.6	9.1	8.7
27/19	0.3	7.3	total	10.7	9.9	9.2	11.0	10.2	9.5	11.4	10.6	9.8
			sensible	9.0	8.7	8.4	9.4	9.1	8.9	10.1	9.9	9.6
	0.5	18.3	total	13.0	12.1	11.2	13.5	12.6	11.7	14.2	13.2	12.2
			sensible	9.8	9.5	9.1	10.4	10.0	9.7	11.2	10.8	10.4
	0.7	33.5	total	14.5	13.5	12.5	15.2	14.1	13.0	16.1	15.0	13.8
			sensible	10.5	10.0	9.6	11.0	10.6	10.2	11.9	11.5	11.0

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
15	0.05	2.3	heat	4.4	6.3	8.2	4.5	6.5	8.5	4.7	6.8	8.7
	0.1	7.6	heat	5.5	7.8	10.2	5.7	8.2	10.6	6.0	8.6	11.2
	0.15	15.3	heat	6.0	8.5	11.1	6.3	9.0	11.7	6.7	9.5	12.4
21	0.05	2.3	heat	3.6	5.5	7.4	3.7	5.7	7.6	3.9	5.9	7.9
	0.1	7.6	heat	4.5	6.9	9.2	4.7	7.1	9.6	4.9	7.5	10.1
	0.15	15.3	heat	4.9	7.5	10.0	5.2	7.9	10.6	5.5	8.4	11.2

Performance Data

Dimensions

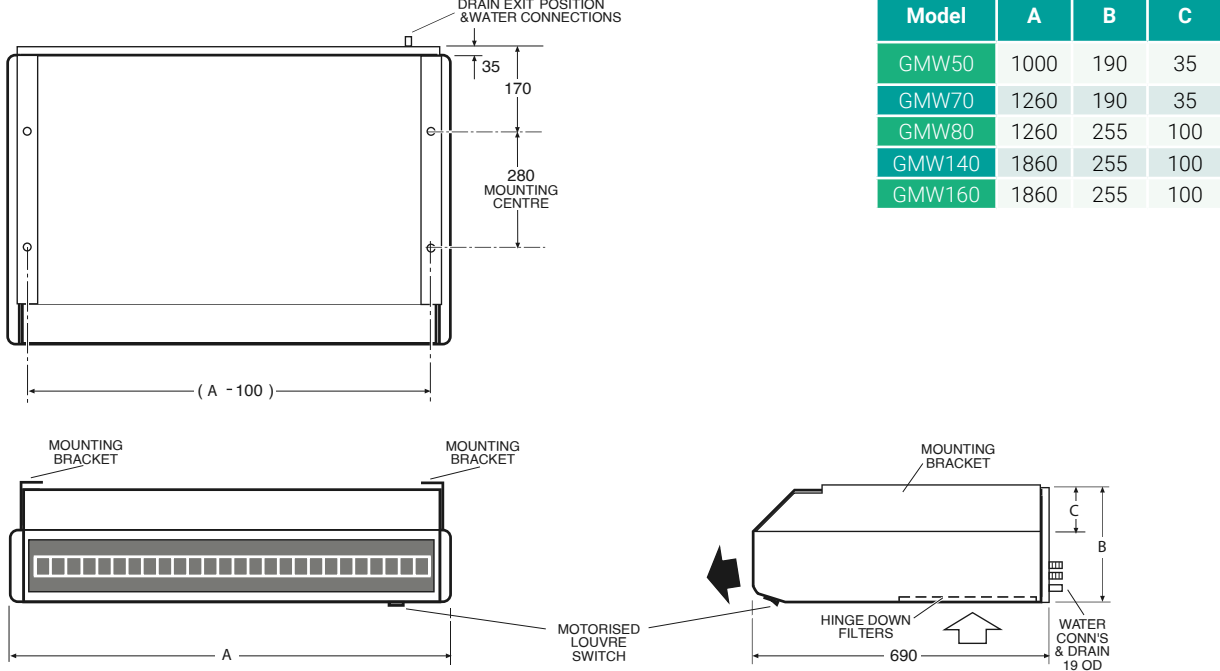


Model	A	B	C
GMW50	1000	190	35
GMW70	1260	190	35
GMW80	1260	255	100
GMW140	1860	255	100
GMW160	1860	255	100

Sound Levels

As measured in an anechoic chamber 1m below and 1m to the front of the unit.
No allowance for sound reflection in a room. Add 13dB to convert to sound power levels (SWL)

Supply Air Outlet									
Model	Air Flow L/s	Fan Speed	Sound Pressure Levels (SPL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
GMW50S	135	LOW	33	37	32	33	27	19	13
	140	MED	34	38	33	34	28	20	14
	150	HIGH	34	37	33	34	28	22	16
GMW50H	155	LOW	41	39	39	41	37	32	24
	165	MED	43	40	40	42	39	34	26
	175	HIGH	44	41	42	43	40	35	28
GMW70S	160	LOW	33	37	32	34	27	20	13
	167	MED	34	39	34	35	28	20	14
	170	HIGH	34	40	34	35	30	22	14
GMW70H	220	LOW	44	40	42	44	40	33	27
	230	MED	45	41	43	43	41	36	29
	240	HIGH	46	42	44	46	42	37	30
GMW80S	185	LOW	33	37	34	32	25	21	13
	235	MED	37	38	38	36	31	25	17
	295	HIGH	42	43	43	41	38	32	23
GMW80H	265	LOW	41	41	45	41	35	28	20
	295	MED	43	42	46	44	37	31	24
	375	HIGH	48	48	48	47	44	39	32
GMW140S	380	LOW	37	43	37	36	31	25	17
	440	MED	40	45	40	39	35	29	20
	520	HIGH	43	44	43	41	38	33	25
GMW140H	450	LOW	43	44	43	42	39	32	24
	520	MED	46	47	47	45	43	36	29
	625	HIGH	51	51	51	49	48	42	35
GMW160H	665	LOW	51	51	51	50	47	41	35
	725	MED	53	53	53	51	50	44	37
	815	HIGH	53	55	55	53	52	46	40

Advantage IMDL Range (Low Profile)



3 Speed Fan Motor



Easy Clean Plastic Drain



Electric Heating



Opposite Hand

Advantage Range (IMDL) Specifications

Model	IMDL 40	IMDL 60	IMDL 90	IMDL 130
Features				
Nominal Air Flow (l/s) * ¹	200	330	400	650
Fan Type	Forward Curved Centrifugal Double Inlet Double Width			
Number of Fan Scrolls	1	2	2	3
Motor Type	Three Speed, Direct Drive			
Power Source * ²	1 Phase 230 Volt AC 50 Hz			
Number of Motors	1	1	1	2
Motor Rating (W)	50	75	150	75 + 150
Full Load Amps (A) * ³	0.6	0.7	1.4	0.7 + 1.4 (2.1)
Optional Electric Heating (kW) * ⁴	1.5	2.0	3.0	4.0
Electric Heat Current (A)	6.6	8.8	13.2	17.6
Heat Exchanger Type	Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tube			
Finish	Zinc galvanised steel			
Test Pressure	2100 kPa			
Cooling/Heating Medium	Chilled Water / Hot Water or Electric Heat			
Connection Sizes Cooling Coil (mm)	Ø 20 (¾" BSP)	Ø 20 (¾" BSP)	Ø 25 (1" BSP)	Ø 25 (1" BSP)
Connection Sizes Heating Coil (mm)	Ø 15 (½ " BSP)			
Filters				
Air Filter Type	G2 / EU2 Washable			
Number of Air Filters	1	1	1	2
Air Filter Size (mm)	545 x 234 x 13	795 x 234 x 13	1045 x 243 x 13	725 x 243 x 13
Weight				
Weight Incl. Water (kg)	25	34	46	67
Nett Dry Weight (kg)	24	32	42	62
Shipping Weight (kg)	25	34	45	65

Notes: *1 With no filters fitted and with a dry coil surface
*2 Voltage range 220-240V
*3 Fan only, excluding Electric Heating
*4 Complete with high temperature safety cutout thermostats required to meet AS/NZS 3350.2.40 2019

Cooling and Heating Coil options:
4 Row Cooling only
3 Row Cooling + 1 Row Heating
4 Row Cooling plus Electric Heating

IMDL 40H-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				100 L/s			150 L/s			200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.15	6.7	total	2.6	2.4	2.2	3.6	3.3	3.0	3.9	3.6	3.3
			sensible	1.6	1.5	1.4	2.3	2.2	2.1	2.6	2.5	2.4
	0.25	16.7	total	2.9	2.6	2.4	4.1	3.8	3.5	4.6	4.2	3.9
			sensible	1.7	1.6	1.5	2.6	2.4	2.3	2.9	2.7	2.6
	0.35	30.5	total	3.0	2.7	2.5	4.4	4.1	3.7	4.9	4.6	4.2
			sensible	1.8	1.7	1.6	2.7	2.5	2.4	3.0	2.9	2.7
27/19	0.15	6.7	total	3.3	3.1	2.9	4.1	3.8	3.5	4.7	4.4	4.1
			sensible	2.0	1.9	1.8	2.6	2.5	2.4	3.2	3.1	2.9
	0.25	16.7	total	3.5	3.3	3.1	4.6	4.3	4.0	5.6	5.2	4.8
			sensible	2.1	2.0	1.9	2.9	2.7	2.6	3.5	3.4	3.2
	0.35	30.5	total	3.6	3.4	3.2	4.9	4.5	4.2	6.0	5.6	5.2
			sensible	2.2	2.1	2.0	3.0	2.8	2.7	3.7	3.5	3.4


IMDL 40H-3/1				100 L/s			150 L/s			200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.1	5.4	total	2.1	2.0	1.8	2.5	2.3	2.1	2.8	2.5	2.3
			sensible	1.4	1.4	1.3	1.8	1.7	1.6	2.1	2.0	1.9
	0.2	18.8	total	2.5	2.3	2.1	3.1	2.9	2.6	3.6	3.3	3.0
			sensible	1.6	1.5	1.4	2.0	1.9	1.8	2.5	2.3	2.2
	0.25	27.9	total	2.6	2.4	2.1	3.3	3.0	2.7	3.8	3.5	3.2
			sensible	1.6	1.5	1.4	2.1	2.0	1.9	2.5	2.4	2.3
27/19	0.1	5.4	total	2.6	2.4	2.2	3.0	2.8	2.6	3.4	3.1	2.9
			sensible	1.8	1.7	1.6	2.2	2.1	2.0	2.7	2.6	2.5
	0.2	18.8	total	3.1	2.8	2.6	3.7	3.5	3.2	4.4	4.1	3.8
			sensible	2.0	1.9	1.8	2.5	2.4	2.3	3.1	2.9	2.8
	0.25	27.9	total	3.1	2.9	2.7	4.0	3.8	3.5	4.7	4.3	4.0
			sensible	2.0	1.9	1.8	2.6	2.5	2.4	3.1	3.0	2.9

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.04	6.4	heat	1.8	2.6	3.4	2.1	3.0	3.9	2.3	3.4	4.4
	0.07	17.4	heat	2.0	2.9	3.8	2.4	3.5	4.5	2.7	3.9	5.0
	0.1	33	heat	2.1	3.1	4.0	2.6	3.7	4.8	2.9	4.1	5.4
21	0.04	6.4	heat	1.5	2.3	3.0	1.8	2.6	3.5	2.0	3.0	4.0
	0.07	17.4	heat	1.7	2.6	3.4	2.0	3.0	4.0	2.3	3.5	4.6
	0.1	33	heat	1.8	2.7	3.7	2.1	3.2	4.3	2.4	3.7	5.0


Performance Data

IMDL 40H

Air Handling

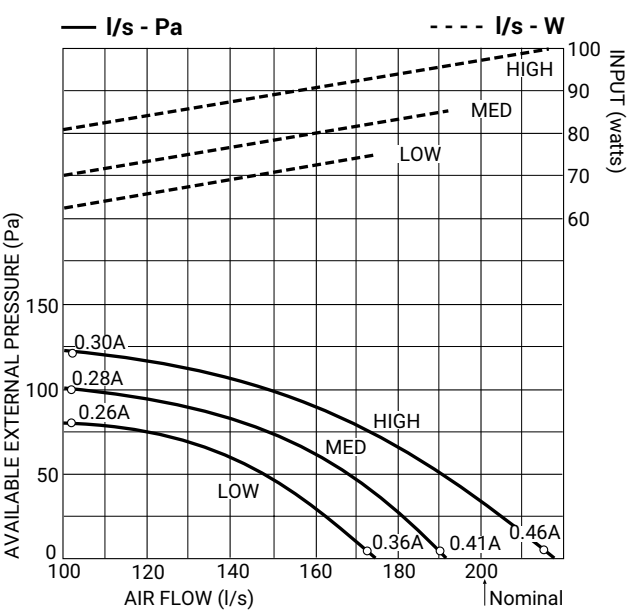

Dimensions

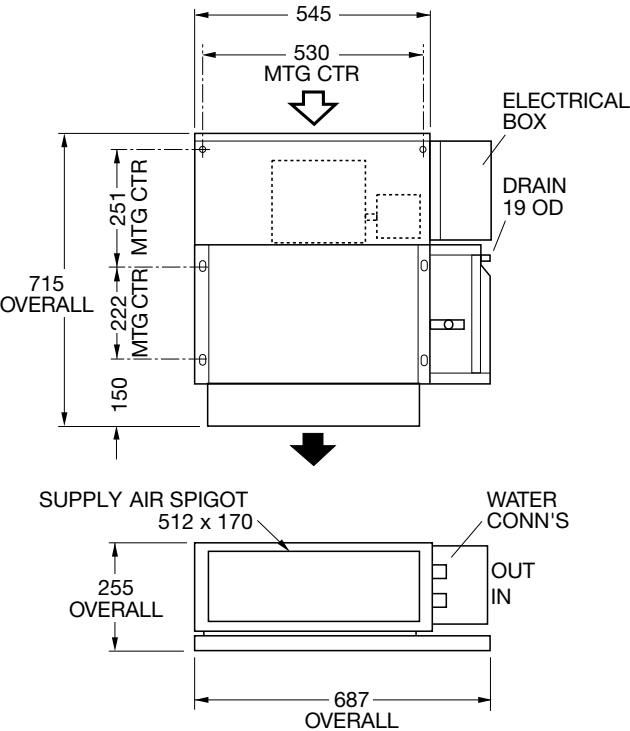

Sound Levels

Supply Air Outlet

Fan Speed	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	40	51	45	35	26	20	13
Med	42	52	48	38	29	23	17
High	45	57	50	40	31	25	19

Return Air Inlet + Case Breakout

	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
	49	55	51	47	43	38	30
	51	54	54	50	46	41	34
	54	59	57	52	49	44	37

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com


IMDL 60H-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				250 L/s			300 L/s			330 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.15	8.5	total	4.9	4.5	4.1	5.2	4.8	4.4	5.4	5.0	4.6
			sensible	3.3	3.1	3.0	3.6	3.5	3.3	3.9	3.7	3.5
	0.22	17.1	total	5.6	5.2	4.7	6.1	5.6	5.1	6.4	5.9	5.4
			sensible	3.6	3.4	3.2	4.0	3.8	3.6	4.2	4.0	3.8
	0.3	29.4	total	6.1	5.6	5.1	6.7	6.2	5.7	7.1	6.6	6.0
			sensible	3.8	3.6	3.4	4.2	4.0	3.8	4.5	4.3	4.1
27/19	0.15	8.5	total	6.0	5.6	5.2	6.4	6.0	5.6	6.6	6.2	5.7
			sensible	4.1	3.9	3.8	4.5	4.4	4.2	4.8	4.6	4.4
	0.22	17.1	total	6.9	6.4	6.0	7.5	7.0	6.5	7.8	7.3	6.8
			sensible	4.4	4.2	4.1	4.9	4.8	4.6	5.2	5.0	4.8
	0.3	29.4	total	7.5	7.0	6.5	8.3	7.7	7.2	8.7	8.1	7.5
			sensible	4.7	4.5	4.3	5.2	5.0	4.8	5.6	5.3	5.1

IMDL 60H-3/1				250 L/s			300 L/s			330 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.11	8.2	total	3.7	3.4	3.1	3.9	3.6	3.2	4.0	3.7	3.3
			sensible	2.8	2.7	2.6	3.1	3.0	2.9	3.3	3.2	3.1
	0.17	18.1	total	4.5	4.0	3.7	4.8	4.4	4.0	5.0	4.6	4.1
			sensible	3.1	3.0	2.8	3.4	3.3	3.1	3.7	3.5	3.3
	0.23	30.6	total	4.9	4.5	4.1	5.3	4.9	4.4	5.6	5.1	4.6
			sensible	3.3	3.1	3.0	3.7	3.5	3.3	3.9	3.7	3.5
27/19	0.11	8.2	total	4.5	4.2	3.9	4.7	4.4	4.0	4.8	4.5	4.1
			sensible	3.5	3.4	3.3	3.9	3.8	3.6	4.1	4.0	3.9
	0.17	18.1	total	5.4	5.0	4.6	5.8	5.4	5.0	6.0	5.5	5.1
			sensible	3.9	3.7	3.6	4.3	4.1	4.0	4.5	4.4	4.2
	0.23	30.6	total	6.0	5.5	5.1	6.5	6.0	5.5	6.7	6.3	5.8
			sensible	4.1	3.9	3.8	4.5	4.4	4.2	4.8	4.6	4.4

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.04	8.1	heat	3.0	4.3	5.5	3.2	4.6	6.0	3.3	4.7	6.2
	0.06	16.8	heat	3.4	4.9	6.4	3.6	5.2	6.8	3.8	5.4	7.0
	0.08	28.1	heat	3.7	5.3	6.9	3.9	5.7	7.3	4.1	5.8	7.6
21	0.04	8.1	heat	2.5	3.8	5.1	2.7	4.1	5.4	2.8	4.2	5.7
	0.06	16.8	heat	2.8	4.3	5.8	3.0	4.6	6.2	3.2	4.8	6.4
	0.08	28.1	heat	3.1	4.6	6.2	3.3	5.0	6.7	3.4	5.2	6.9


Performance DataIMDL 60H

Air Handling

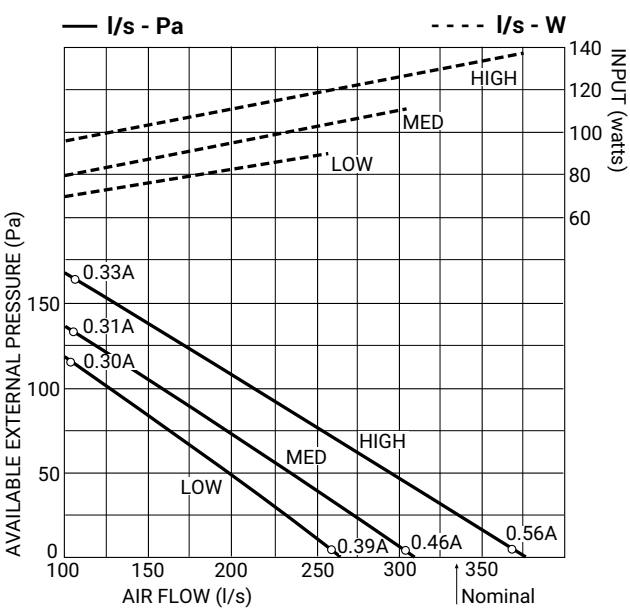

- Note:**
- Airflows given are for a standard unit with rectangular air spigot and no filter installed.
 - Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions.
 - In a free blow application, beware of exceeding indoor fan motor's full load amp limit.
 - Refer to page 51 for filter pressure drop.

Dimensions

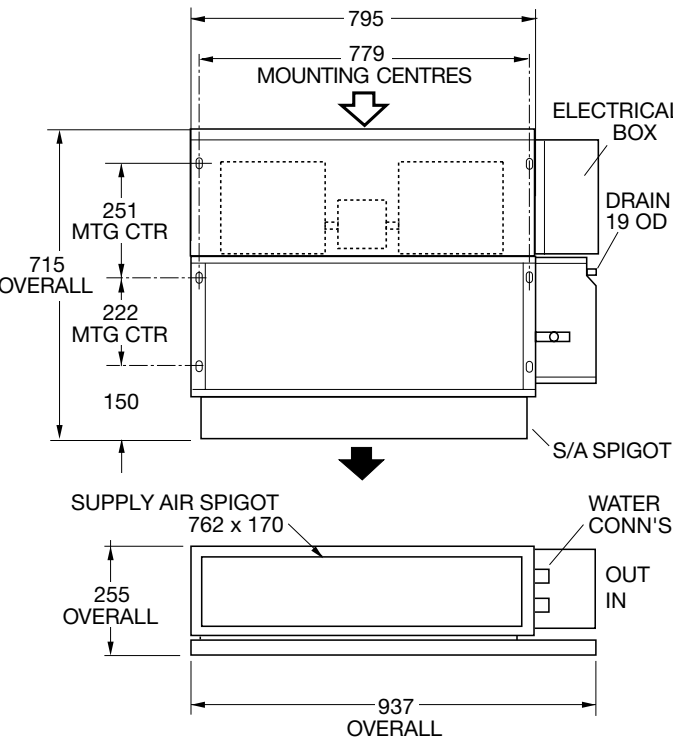

Sound Levels

Supply Air Outlet

Fan Speed	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	43	50	48	42	31	25	16
Med	44	51	49	43	33	28	19
High	47	55	52	45	37	31	24

Return Air Inlet + Case Breakout

	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
	47	51	49	46	42	37	29
	50	52	52	49	45	41	33
	53	55	54	52	48	44	37

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMDL 90H-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				290 L/s			350 L/s			480 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	8.2	total	6.5	6.0	5.5	7.2	6.7	6.0	8.4	7.7	7.4
			sensible	4.6	4.3	4.1	5.2	5.0	4.7	6.4	6.1	6.0
	0.45	16.7	total	7.1	6.5	5.9	8.0	7.3	6.7	9.5	8.8	8.0
			sensible	4.8	4.6	4.3	5.5	5.2	5.0	6.9	6.6	6.2
	0.6	28.5	total	7.5	6.9	6.3	8.5	7.8	7.1	10.4	9.5	8.7
			sensible	5.0	4.7	4.4	5.8	5.4	5.1	7.2	6.9	6.5
27/19	0.3	8.2	total	8.0	7.4	6.9	8.8	8.2	7.6	10.2	9.5	8.8
			sensible	5.6	5.4	5.2	6.4	6.1	5.9	7.9	7.6	7.3
	0.45	16.7	total	8.7	8.1	7.5	9.8	9.1	8.5	11.7	10.9	10.1
			sensible	5.9	5.7	5.4	6.8	6.5	6.3	8.5	8.2	7.8
	0.6	28.5	total	9.1	8.5	7.9	10.4	9.7	9.0	12.7	11.8	10.9
			sensible	6.1	5.9	5.6	7.1	6.8	6.5	8.9	8.5	8.2


IMDL 90H-3/1				290 L/s			350 L/s			480 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.25	9.9	total	5.6	5.1	4.7	6.1	5.6	5.1	7.0	6.4	5.9
			sensible	4.0	3.8	3.6	4.5	4.3	4.1	5.5	5.3	5.1
	0.35	18.1	total	6.1	5.6	5.1	6.8	6.3	5.6	7.9	7.3	6.6
			sensible	4.2	4.0	3.8	4.8	4.6	4.3	5.9	5.6	5.4
	0.45	28.1	total	6.5	5.9	5.4	7.3	6.7	6.0	8.6	7.9	7.2
			sensible	4.4	4.2	3.9	5.0	4.8	4.5	6.2	5.9	5.6
27/19	0.25	9.9	total	6.8	6.4	5.9	7.5	7.0	6.4	8.5	7.9	7.3
			sensible	4.9	4.8	4.6	5.6	5.4	5.2	6.8	6.6	6.4
	0.35	18.1	total	7.5	7.0	6.5	8.3	7.8	7.2	9.7	9.0	8.4
			sensible	5.2	5.0	4.8	5.9	5.7	5.5	7.3	7.0	6.8
	0.45	28.5	total	8.0	7.4	6.9	8.9	8.3	7.7	10.6	9.8	9.1
			sensible	5.4	5.2	5.0	6.2	5.9	5.7	7.6	7.3	7.0

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.1	10.3	heat	5.2	7.5	9.8	5.8	8.2	10.7	6.6	9.4	12.3
	0.14	18.8	heat	5.6	8.0	10.5	6.2	8.8	11.5	7.3	10.4	13.5
	0.18	29.4	heat	5.9	8.4	11.0	6.5	9.3	12.2	7.8	11.1	14.4
21	0.1	10.3	heat	4.4	6.6	8.9	4.8	7.3	9.7	5.5	8.3	11.2
	0.14	18.8	heat	4.7	7.1	9.5	5.1	7.8	10.4	6.0	9.2	12.3
	0.18	29.4	heat	4.9	7.4	10.0	5.4	8.2	11.0	6.4	9.7	13.1

Performance Data


IMDL 90H

Air Handling

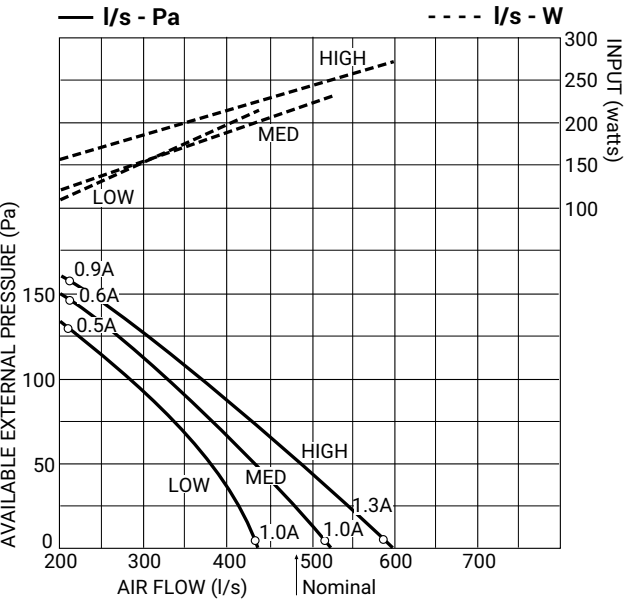

- Note:**
1. Airflows given are for a standard unit with rectangular air spigot and no filter installed.
 2. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions.
 3. In a free blow application, beware of exceeding indoor fan motor's full load amp limit.
 4. Refer to page 51 for filter pressure drop.

Dimensions

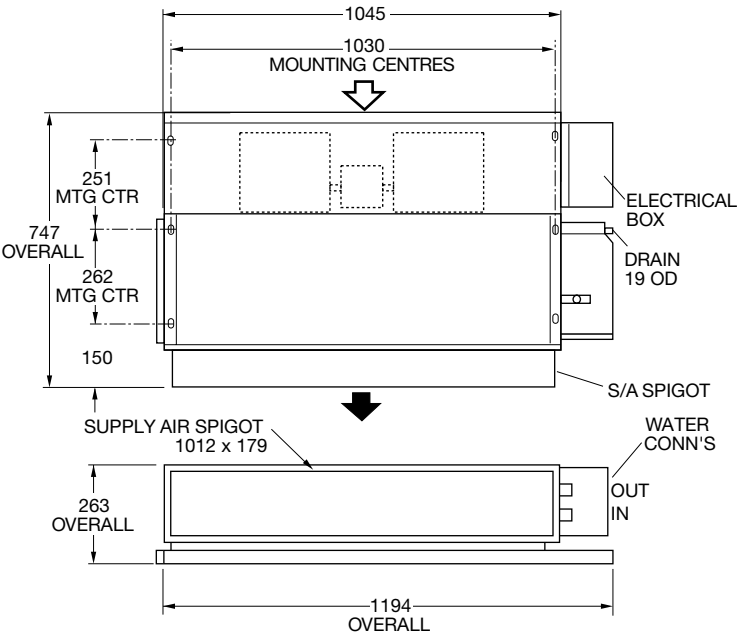

Sound Levels

Supply Air Outlet

Fan Speed	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	44	53	48	42	35	30	22
Med	47	55	51	44	38	32	26
High	49	57	53	47	41	35	30

Return Air Inlet + Case Breakout

	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
	52	58	54	50	46	44	37
	55	60	56	53	49	46	40
	56	58	56	55	50	47	43

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMDL 130H-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				400 L/s			525 L/s			650 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	10.5	total	8.5	7.9	7.2	9.7	8.9	8.2	10.6	9.7	8.9
			sensible	6.1	5.8	5.5	7.3	7.0	6.7	8.3	8.0	7.6
	0.45	21.8	total	9.5	8.7	7.9	11.1	10.2	9.3	12.4	11.3	10.3
			sensible	6.5	6.1	5.8	7.9	7.5	7.1	9.1	8.6	8.2
	0.6	36.7	total	10.1	9.3	8.4	12.0	11.0	10.0	13.5	12.4	11.3
			sensible	6.8	6.4	6.0	8.3	7.8	7.4	9.6	9.1	8.6
27/19	0.3	10.5	total	10.5	9.8	9.1	11.9	11.0	10.3	12.9	12.0	11.1
			sensible	7.5	7.2	6.9	9.0	8.7	8.4	10.4	10.0	9.7
	0.45	21.8	total	11.7	10.9	10.1	13.6	12.7	11.8	15.2	14.1	13.1
			sensible	8.0	7.7	7.4	9.8	9.4	9.0	11.3	10.9	10.4
	0.6	36.7	total	12.4	11.6	10.7	14.7	13.7	12.7	16.6	15.5	14.3
			sensible	8.4	8.0	7.7	10.2	9.8	9.4	11.9	11.4	10.9


IMDL 130H-3/1

3 row chilled water coil				400 L/s			525 L/s			650 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	8.5	total	6.7	6.2	5.6	7.4	6.8	6.2	7.9	7.2	6.7
			sensible	5.1	4.9	4.7	6.0	5.8	5.6	6.9	6.6	6.4
	0.3	17.6	total	7.7	7.1	6.4	8.7	8.0	7.3	9.5	8.8	8.0
			sensible	5.5	5.3	5.0	6.6	6.3	6.0	7.5	7.2	6.9
	0.4	29.5	total	8.4	7.7	7.0	9.7	8.9	8.1	10.7	9.9	9.0
			sensible	5.8	5.5	5.2	7.0	6.7	6.3	8.0	7.7	7.3
27/19	0.2	8.5	total	8.2	7.7	7.1	9.1	8.4	7.8	9.6	9.0	8.3
			sensible	6.3	6.1	5.9	7.5	7.2	7.0	8.5	8.3	8.1
	0.3	17.6	total	9.5	8.8	8.2	10.7	10.0	9.2	11.6	10.9	10.0
			sensible	6.8	6.6	6.3	8.2	7.9	7.6	9.3	9.0	8.7
	0.4	29.5	total	10.3	9.6	8.9	11.9	11.1	10.3	13.2	12.2	11.3
			sensible	7.2	6.9	6.6	8.6	8.3	8.0	9.9	9.5	9.2

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50			65			80		
				50	65	80	50	65	80	50	65	80
15	0.08	9.0	heat	6.4	9.2	11.9	7.1	10.1	13.1	7.6	10.8	14.1
	0.12	18.4	heat	7.2	10.3	13.3	8.2	11.7	15.2	8.9	12.7	16.5
	0.16	30.0	heat	7.7	11.0	14.3	8.9	12.7	16.5	9.6	14.0	18.2
21	0.08	9.0	heat	5.3	8.0	10.8	5.8	8.9	11.9	6.3	9.5	12.7
	0.12	18.4	heat	5.9	9.0	12.1	6.8	10.2	13.7	7.4	11.2	15.0
	0.16	30.8	heat	6.4	9.6	13.0	7.3	11.2	15.0	8.1	13.3	16.5

Performance Data

Air Handling

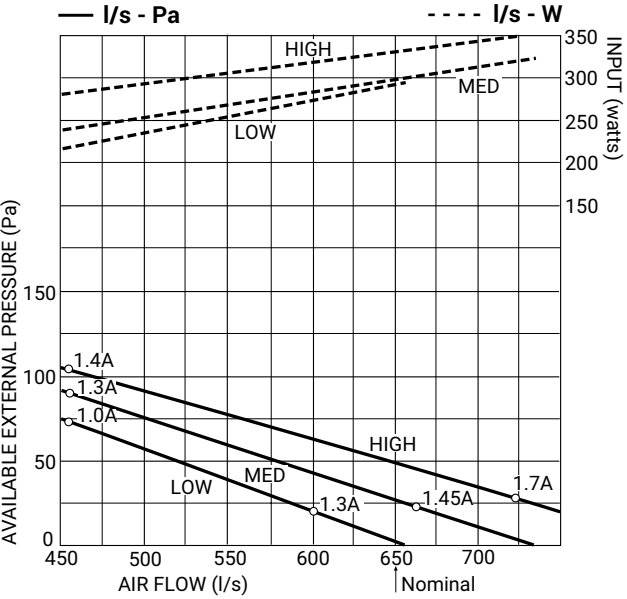

- Note:**
- Airflows given are for a standard unit with rectangular air spigot and no filter installed.
 - Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions.
 - In a free blow application, beware of exceeding indoor fan motor's full load amp limit.
 - Refer to page 51 for filter pressure drop.

Sound Levels


Supply Air Outlet

Fan Speed	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	46	55	50	44	37	31	23
Med	48	55	52	46	40	34	26
High	50	57	55	48	42	37	30

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMDL 130H

Dimensions

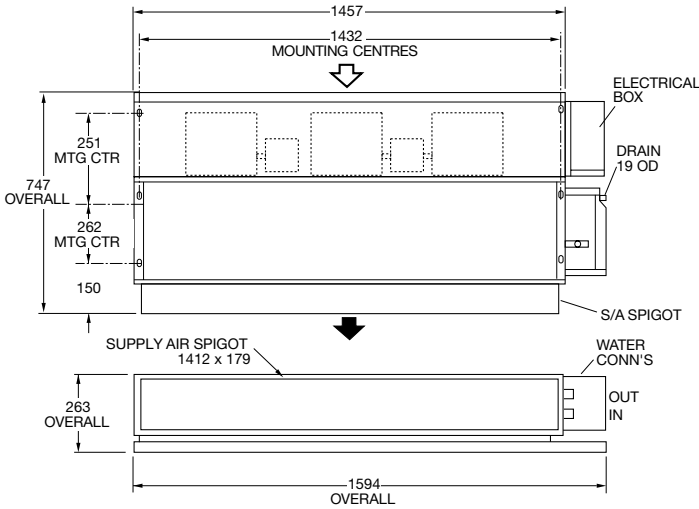

Return Air Inlet + Case Breakout

	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
	51	55	54	50	43	39	33
	53	57	55	52	47	41	36
	55	59	58	54	48	44	39

Premium IMDL-Y Range (Low Profile)





High Efficiency EC Motor



Easy Clean Plastic Drain



Opposite Hand

Premium Range (IMDL-Y) Specifications

Model	IMDL 40Y	IMDL 60Y	IMDL 90Y	IMDL 130Y
Features				
Nominal Air Flow (l/s) * ¹	200	330	400	650
Fan Type	Forward Curved Centrifugal Double Inlet Double Width			
Number of Fan Scrolls	1	2	2	3
Motor Type	Electronically Commutated (EC) DC Direct Drive			
Power Source * ²	1 Phase 230 Volt AC 50 Hz			
Number of Motors	1	1	1	2
Motor Rating (W)	182	243	243	182 + 243
Full Load Amps (A) * ³	1.4	1.8	1.8	1.4 + 1.8 (3.2)
Electric Heating (kW) * ⁴	1.5	2.0	3.0	4.0
Electric Heat Current (A)	6.6	8.8	13.2	17.6
Heat Exchanger Type	Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tube			
Finish	Zinc galvanised steel			
Test Pressure	2100 kPa			
Cooling/Heating Medium	Chilled Water or Hot Water			
Connection Sizes Cooling Coil (mm)	Ø 20 (¾" BSP)	Ø 20 (¾" BSP)	Ø 25 (1" BSP)	Ø 25 (1" BSP)
Connection Sizes Heating Coil (mm)	Ø 15 (½ " BSP)			
Filters				
Air Filter Type	Washable G2 / EU2 (Supplied Standard)			
Number of Air Filters	1	1	1	2
Air Filter Size (mm)	545 x 234 x 13	795 x 234 x 13	1045 x 243 x 13	725 x 243 x 13
Weight				
Weight Incl. Water (kg)	25	34	46	67
Nett Dry Weight (kg)	24	32	42	62
Shipping Weight (kg)	25	34	45	65
Notes:	^{*1} With no filters fitted and with a dry coil surface ^{*2} Voltage range 220–240V ^{*3} Fan only, excluding Electric Heating ^{*4} Complete with high temperature safety cutout thermostats required to meet AS/NZS 3350.2.40 2019		Cooling and Heating Coil options: 4 Row Cooling only 3 Row Cooling + 1 Row Heating 4 Row Cooling plus Electric Heating	


IMDL 40Y-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				100 L/s			150 L/s			200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.15	6.7	total	2.6	2.4	2.2	3.6	3.3	3.0	3.9	3.6	3.3
			sensible	1.6	1.5	1.4	2.3	2.2	2.1	2.6	2.5	2.4
	0.25	16.7	total	2.9	2.6	2.4	4.1	3.8	3.5	4.6	4.2	3.9
			sensible	1.7	1.6	1.5	2.6	2.4	2.3	2.9	2.7	2.6
	0.35	30.5	total	3.0	2.7	2.5	4.4	4.1	3.7	4.9	4.6	4.2
			sensible	1.8	1.7	1.6	2.7	2.5	2.4	3.0	2.9	2.7
27/19	0.15	6.7	total	3.3	3.1	2.9	4.1	3.8	3.5	4.7	4.4	4.1
			sensible	2.0	1.9	1.8	2.6	2.5	2.4	3.2	3.1	2.9
	0.25	16.7	total	3.5	3.3	3.1	4.6	4.3	4.0	5.6	5.2	4.8
			sensible	2.1	2.0	1.9	2.9	2.7	2.6	3.5	3.4	3.2
	0.35	30.5	total	3.6	3.4	3.2	4.9	4.5	4.2	6.0	5.6	5.2
			sensible	2.2	2.1	2.0	3.0	2.8	2.7	3.7	3.5	3.4

IMDL 40Y-3/1				100 L/s			150 L/s			200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.1	5.4	total	2.1	2.0	1.8	2.5	2.3	2.1	2.8	2.5	2.3
			sensible	1.4	1.4	1.3	1.8	1.7	1.6	2.1	2.0	1.9
	0.2	18.78	total	2.5	2.3	2.1	3.1	2.9	2.6	3.6	3.3	3.0
			sensible	1.6	1.5	1.4	2.0	1.9	1.8	2.5	2.3	2.2
	0.25	27.9	total	2.6	2.4	2.1	3.3	3.0	2.7	3.8	3.5	3.2
			sensible	1.6	1.5	1.4	2.1	2.0	1.9	2.5	2.4	2.3
27/19	0.1	5.4	total	2.6	2.4	2.2	3.0	2.8	2.6	3.4	3.1	2.9
			sensible	1.8	1.7	1.6	2.2	2.1	2.0	2.7	2.6	2.5
	0.2	18.8	total	3.1	2.8	2.6	3.7	3.5	3.2	4.4	4.1	3.8
			sensible	2.0	1.9	1.8	2.5	2.4	2.3	3.1	2.9	2.8
	0.25	27.9	total	3.1	2.9	2.7	4.0	3.8	3.5	4.7	4.3	4.0
			sensible	2.0	1.9	1.8	2.6	2.5	2.4	3.1	3.0	2.9

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.04	6.4	heat	1.8	2.6	3.4	2.1	3.0	3.9	2.3	3.4	4.4
	0.07	17.4	heat	2.0	2.9	3.8	2.4	3.5	4.5	2.7	3.9	5.0
	0.1	33	heat	2.1	3.1	4.0	2.6	3.7	4.8	2.9	4.1	5.4
21	0.04	6.4	heat	1.5	2.3	3.0	1.8	2.6	3.5	2.0	3.0	4.0
	0.07	17.4	heat	1.7	2.6	3.4	2.0	3.0	4.0	2.3	3.5	4.6
	0.1	33	heat	1.8	2.7	3.7	2.1	3.2	4.3	2.4	3.7	5.0

Performance Data

Air Handling

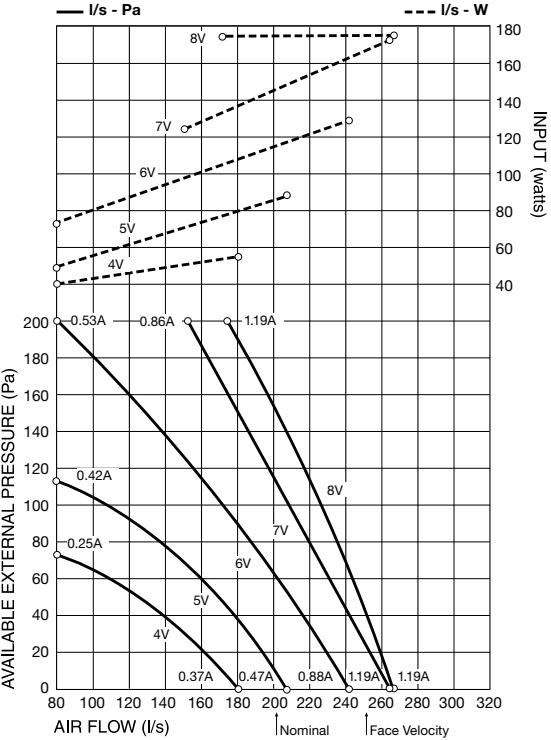

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. **Air flows given are for IMDL-Y units without filter installed.** Refer to page 51 for filter pressure drop.


Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
8	56	56	58	54	50	48	47
7	56	56	58	54	49	47	46
6	53	53	55	51	47	44	42
5	49	50	51	47	44	40	38
4	46	48	48	44	41	36	33
3	40	46	42	39	35	29	25
2	35	41	38	33	28	24	21
Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
8	50	61	55	45	37	35	29
7	48	59	54	44	37	34	28
6	46	57	51	41	35	31	24
5	42	53	47	37	32	27	20
4	39	49	45	34	28	23	16
3	34	45	40	29	22	15	7
2	33	46	38	24	14	7	0

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMDL 40Y

Dimensions

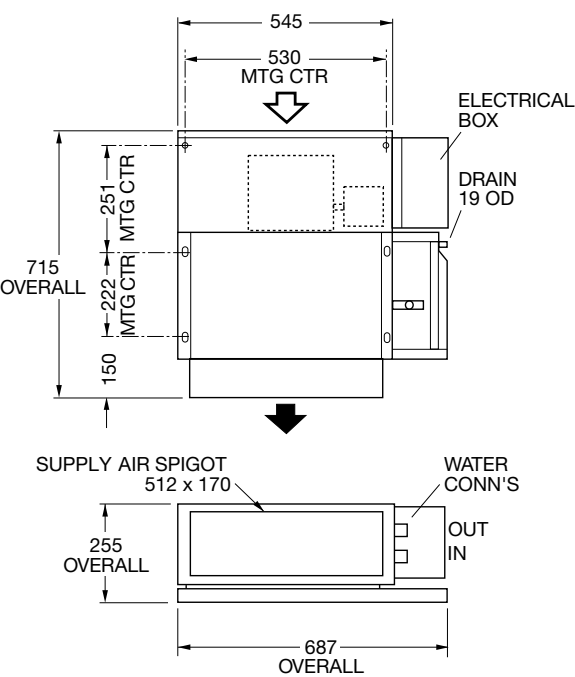


IMDL 60Y-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				250 L/s			300 L/s			330 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.15	8.5	total	4.9	4.5	4.1	5.2	4.8	4.4	5.4	5.0	4.6
			sensible	3.3	3.1	3.0	3.6	3.5	3.3	3.9	3.7	3.5
	0.22	17.1	total	5.6	5.2	4.7	6.1	5.6	5.1	6.4	5.9	5.4
			sensible	3.6	3.4	3.2	4.0	3.8	3.6	4.2	4.0	3.8
	0.3	29.4	total	6.1	5.6	5.1	6.7	6.2	5.7	7.1	6.6	6.0
			sensible	3.8	3.6	3.4	4.2	4.0	3.8	4.5	4.3	4.1
27/19	0.15	8.5	total	6.0	5.6	5.2	6.4	6.0	5.6	6.6	6.2	5.7
			sensible	4.1	3.9	3.8	4.5	4.4	4.2	4.8	4.6	4.4
	0.22	17.1	total	6.9	6.4	6.0	7.5	7.0	6.5	7.8	7.3	6.8
			sensible	4.4	4.2	4.1	4.9	4.8	4.6	5.2	5.0	4.8
	0.3	29.4	total	7.5	7.0	6.5	8.3	7.7	7.2	8.7	8.1	7.5
			sensible	4.7	4.5	4.3	5.2	5.0	4.8	5.6	5.3	5.1

IMDL 60Y-3/1				250 L/s			300 L/s			330 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.11	8.2	total	3.7	3.4	3.1	3.9	3.6	3.2	4.0	3.7	3.3
			sensible	2.8	2.7	2.6	3.1	3.0	2.9	3.3	3.2	3.1
	0.17	18.1	total	4.5	4.0	3.7	4.8	4.4	4.0	5.0	4.6	4.1
			sensible	3.1	3.0	2.8	3.4	3.3	3.1	3.7	3.5	3.3
	0.23	30.6	total	4.9	4.5	4.1	5.3	4.9	4.4	5.6	5.1	4.6
			sensible	3.3	3.1	3.0	3.7	3.5	3.3	3.9	3.7	3.5
27/19	0.11	8.2	total	4.5	4.2	3.9	4.7	4.4	4.0	4.8	4.5	4.1
			sensible	3.5	3.4	3.3	3.9	3.8	3.6	4.1	4.0	3.9
	0.17	18.1	total	5.4	5.0	4.6	5.8	5.4	5.0	6.0	5.5	5.1
			sensible	3.9	3.7	3.6	4.3	4.1	4.0	4.5	4.4	4.2
	0.23	30.6	total	6.0	5.5	5.1	6.5	6.0	5.5	6.7	6.3	5.8
			sensible	4.1	3.9	3.8	4.5	4.4	4.2	4.8	4.6	4.4

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.04	8.1	heat	3.0	4.3	5.5	3.2	4.6	6.0	3.3	4.7	6.2
	0.06	16.8	heat	3.4	4.9	6.4	3.6	5.2	6.8	3.8	5.4	7.0
	0.08	28.1	heat	3.7	5.3	6.9	3.9	5.7	7.3	4.1	5.8	7.6
21	0.04	8.1	heat	2.5	3.8	5.1	2.7	4.1	5.4	2.8	4.2	5.7
	0.06	16.8	heat	2.8	4.3	5.8	3.0	4.6	6.2	3.2	4.8	6.4
	0.08	28.1	heat	3.1	4.6	6.2	3.3	5.0	6.7	3.4	5.2	6.9

Performance Data

Air Handling

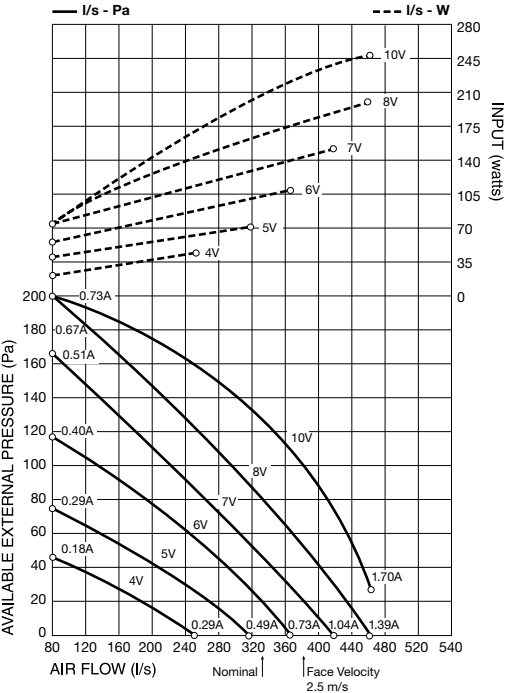

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. **Air flows given are for IMDL-Y units without filter installed.** Refer to page 51 for filter pressure drop.

Sound Levels


Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
10	57	58	59	55	52	48	44
8	57	56	58	55	51	48	43
7	55	54	56	53	49	46	41
6	53	52	54	51	47	43	38
5	50	48	52	48	44	40	34
4	46	46	48	45	40	36	29
3	42	42	44	42	35	32	25
2	35	44	40	32	26	24	18

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
10	50	59	55	48	40	35	30
8	47	57	52	45	37	32	27
7	46	56	51	43	35	30	24
6	43	52	48	40	33	26	20
5	39	50	44	37	28	22	15
4	37	47	42	34	24	18	10
3	33	43	40	29	17	10	5
2	33	46	39	25	11	7	4

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMDL 60Y

Dimensions

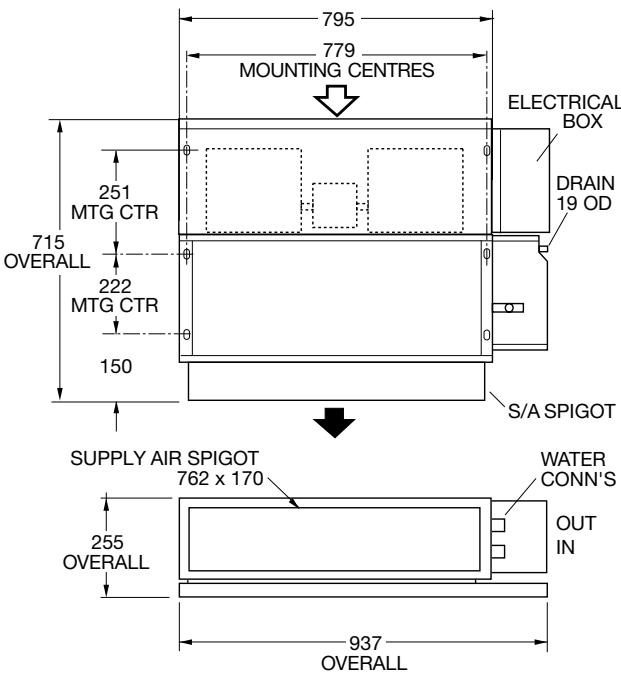


IMDL 90Y-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				200 L/s			300 L/s			400 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	8.2	total	5.2	4.8	4.4	6.6	6.1	5.5	7.7	7.1	6.4
			sensible	3.5	3.3	3.1	4.7	4.4	4.2	5.7	5.4	5.1
	0.45	16.7	total	5.5	5.1	4.6	7.3	6.7	6.1	8.6	7.9	7.2
			sensible	3.6	3.4	3.2	4.9	4.7	4.1	6.1	5.8	5.5
	0.6	28.5	total	5.6	5.2	4.7	7.6	7.0	6.4	9.2	8.5	7.7
			sensible	3.7	3.5	3.3	5.1	4.8	4.5	6.3	6.0	5.7
27/19	0.3	8.2	total	6.4	6.0	5.5	8.2	7.6	7.1	9.4	8.8	8.1
			sensible	4.3	4.1	3.9	5.8	5.5	5.3	7.0	6.7	6.5
	0.45	16.7	total	6.7	6.3	5.8	8.9	8.3	7.7	10.6	9.9	9.2
			sensible	4.5	4.3	4.0	6.1	5.8	5.6	7.5	7.2	6.9
	0.6	28.5	total	6.9	6.5	6.0	9.4	8.8	8.1	11.3	10.6	9.8
			sensible	4.6	4.4	4.1	6.3	6.0	5.7	7.8	7.5	7.2

IMDL 90Y-3/1				290 L/s			350 L/s			480 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.25	9.9	total	4.6	4.2	3.8	5.7	5.2	4.7	6.5	5.9	5.4
			sensible	3.1	3.0	2.8	4.1	3.9	3.7	4.9	4.7	4.5
	0.35	18.1	total	4.9	4.5	4.1	6.2	5.7	5.2	7.2	6.7	6.0
			sensible	3.2	3.1	2.9	4.3	4.1	3.9	5.2	5.0	4.7
	0.45	28.1	total	5.1	4.7	4.3	6.6	6.1	5.5	7.8	7.2	6.5
			sensible	3.3	3.2	3.0	4.5	4.3	4.0	5.5	5.2	4.9
27/19	0.25	9.9	total	5.6	5.3	4.9	7.0	6.5	6.0	7.9	7.4	6.8
			sensible	3.9	3.7	3.5	5.1	4.9	4.7	6.1	5.9	5.7
	0.35	18.1	total	6.0	5.6	5.2	7.7	7.1	6.6	8.9	8.3	7.7
			sensible	4.0	3.9	3.6	5.4	5.1	4.9	6.5	6.2	6.0
	0.45	28.5	total	6.2	5.8	5.4	8.1	7.6	7.0	9.6	8.9	8.3
			sensible	4.1	4.0	3.8	5.5	5.3	5.1	6.8	6.5	6.2

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.1	10.3	heat	4.4	6.2	8.1	5.3	7.6	9.9	6.1	8.7	11.4
	0.14	18.8	heat	4.6	6.5	8.6	5.7	8.2	10.7	6.7	9.6	12.5
	0.18	29.4	heat	4.8	6.8	8.8	6.0	8.6	11.2	7.0	10.0	13.0
21	0.1	10.3	heat	3.6	5.4	7.3	4.4	6.7	9.0	5.0	7.7	10.3
	0.14	18.8	heat	3.8	5.7	7.7	4.7	7.2	9.6	5.5	8.4	11.2
	0.18	29.4	heat	3.9	5.9	8.0	5.0	7.5	10.1	5.8	8.8	11.8

Performance DataIMDL 90Y

Air Handling

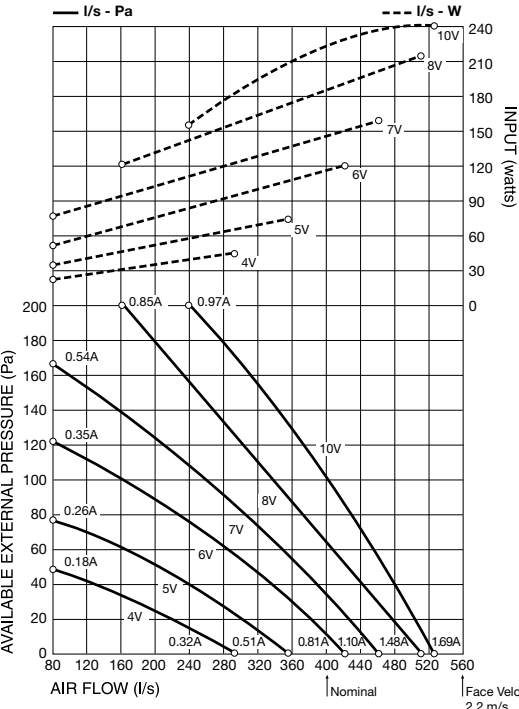

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. **Air flows given are for IMDL-Y units without filter installed.** Refer to page 51 for filter pressure drop.

Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
10	58	60	60	55	51	49	45
8	56	58	59	53	50	47	42
7	53	56	56	51	47	44	40
6	51	54	54	48	44	41	36
5	47	49	49	45	40	37	31
4	43	46	46	42	35	32	24
3	39	43	43	37	31	28	20
2	35	43	39	32	26	22	15

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
10	51	60	55	49	43	37	33
8	49	59	53	46	41	34	30
7	47	57	51	43	38	32	27
6	44	54	48	41	34	29	24
5	41	51	45	38	32	25	19
4	37	47	40	35	26	21	12
3	33	42	40	28	19	13	4
2	31	45	35	24	15	9	2

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMDL 130Y-4				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				400 L/s			525 L/s			650 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	10.5	total	8.5	7.9	7.2	9.7	8.9	8.2	10.6	9.7	8.9
			sensible	6.1	5.8	5.5	7.3	7.0	6.7	8.3	8.0	7.6
	0.45	21.8	total	9.5	8.7	7.9	11.1	10.2	9.3	12.4	11.3	10.3
			sensible	6.5	6.1	5.8	7.9	7.5	7.1	9.1	8.6	8.2
	0.6	36.7	total	10.1	9.3	8.4	12.0	11.0	10.0	13.5	12.4	11.3
			sensible	6.8	6.4	6.0	8.3	7.8	7.4	9.6	9.1	8.6
27/19	0.3	10.5	total	10.5	9.8	9.1	11.9	11.0	10.3	12.9	12.0	11.1
			sensible	7.5	7.2	6.9	9.0	8.7	8.4	10.4	10.0	9.7
	0.45	21.8	total	11.7	10.9	10.1	13.6	12.7	11.8	15.2	14.1	13.1
			sensible	8.0	7.7	7.4	9.8	9.4	9.0	11.3	10.9	10.4
	0.6	36.7	total	12.4	11.6	10.7	14.7	13.7	12.7	16.6	15.5	14.3
			sensible	8.4	8.0	7.7	10.2	9.8	9.4	11.9	11.4	10.9


IMDL 130Y-3/1				400 L/s			525 L/s			650 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	8.5	total	6.7	6.2	5.6	7.4	6.8	6.2	7.9	7.2	6.7
			sensible	5.1	4.9	4.7	6.0	5.8	5.6	6.9	6.6	6.4
	0.3	17.6	total	7.7	7.1	6.4	8.7	8.0	7.3	9.5	8.8	8.0
			sensible	5.5	5.3	5.0	6.6	6.3	6.0	7.5	7.2	6.9
	0.4	29.5	total	8.4	7.7	7.0	9.7	8.9	8.1	10.7	9.9	9.0
			sensible	5.8	5.5	5.2	7.0	6.7	6.3	8.0	7.7	7.3
27/19	0.2	8.5	total	8.2	7.7	7.1	9.1	8.4	7.8	9.6	9.0	8.3
			sensible	6.3	6.1	5.9	7.5	7.2	7.0	8.5	8.3	8.1
	0.3	17.6	total	9.5	8.8	8.2	10.7	10.0	9.2	11.6	10.9	10.0
			sensible	6.8	6.6	6.3	8.2	7.9	7.6	9.3	9.0	8.7
	0.4	29.5	total	10.3	9.6	8.9	11.9	11.1	10.3	13.2	12.2	11.3
			sensible	7.2	6.9	6.6	8.6	8.3	8.0	9.9	9.5	9.2

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.08	9.0	heat	6.4	9.2	11.9	7.1	10.1	13.1	7.6	10.8	14.1
	0.12	18.4	heat	7.2	10.3	13.3	8.2	11.7	15.2	8.9	12.7	16.5
	0.16	30.0	heat	7.7	11.0	14.3	8.9	12.7	16.5	9.6	14.0	18.2
21	0.08	9.0	heat	5.3	8.0	10.8	5.8	8.9	11.9	6.3	9.5	12.7
	0.12	18.4	heat	5.9	9.0	12.1	6.8	10.2	13.7	7.4	11.2	15.0
	0.16	30.8	heat	6.4	9.6	13.0	7.3	11.2	15.0	8.1	13.3	16.5

Performance Data


IMDL 130Y

Air Handling

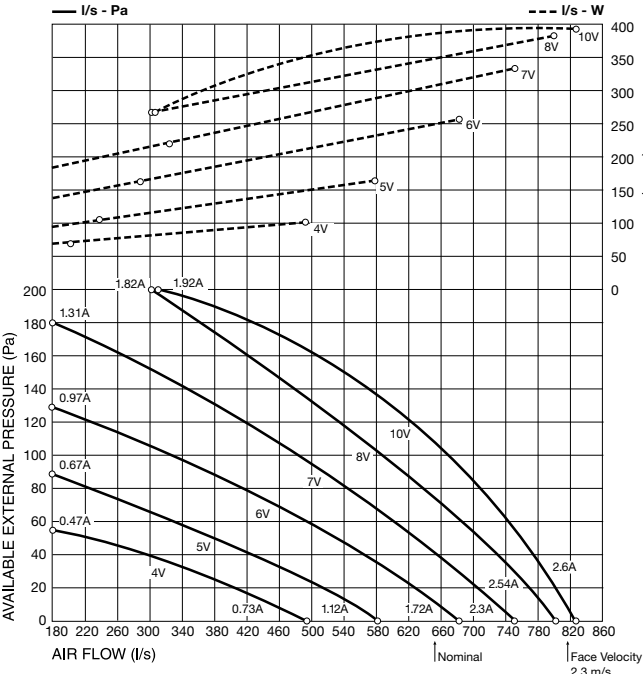

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. **Air flows given are for IMDL-Y units without filter installed.** Refer to page 51 for filter pressure drop.

Dimensions

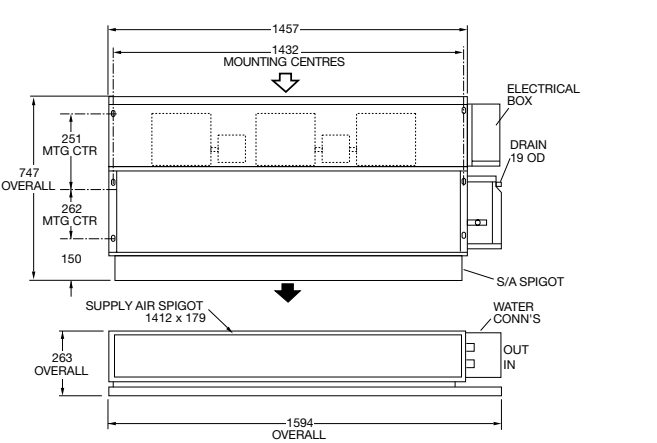

Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
10	62	62	64	60	56	54	52
8	61	61	63	59	54	52	51
7	61	61	63	58	54	52	51
6	57	58	60	54	51	49	48
5	55	55	57	52	49	46	45
4	51	51	54	49	45	42	40
3	46	47	48	44	40	36	33
2	40	45	44	37	32	28	23

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
10	56	63	61	53	49	46	40
8	56	63	59	53	48	45	39
7	55	62	59	52	47	45	39
6	52	59	56	48	45	42	36
5	49	56	53	46	42	39	32
4	46	53	50	42	38	35	28
3	42	53	46	36	32	29	20
2	36	46	42	32	25	20	12

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Premium IXDL-Y Range (Multizone)



Multiple EC Motor



Multiple Zone Supply
Spigot

Premium Range (IXDL-Y) Specifications

Model	IXDL 40Y	IXDL 90Y	IXDL 130Y	IXDL 160Y	IXDL 200Y
Features					
Nominal Air Flow (l/s) @ 100 Pa external static *1	200	400	600	800	1000
Air Flow Range (l/s)	0-225	0-450	0-675	0-900	0-1125
Fan Type	Forward Curved Centrifugal Double Inlet Double Width				
Power Source *2	1 Phase 230 Volt AC 50 Hz				
Number of Outlet Spigots	1	2	3	4	5
Number of Fans	1	2	3	4	5
Number of Motors	1	2	3	4	5
Motor Type	Electronically Commutated (EC) DC Direct Drive				
Motor Rating (W)	182	182 (x2)	182 (x3)	182 (x4)	182 (x5)
Control	0-10Vdc (High/Med/Low optional with conversion boards added)				
Heat Exchanger Type	Epoxy Coated Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tubing				
Finish	Natural Zinc Galvanised Steel				
Test Pressure	2100 kPa				
Full Load Amps (A)	1.4	1.4 x 2 (2.8)	1.4 x 3 (4.2)	1.4 x 4 (5.6)	1.4 x 5 (7.0)
Amps at Nominal Air Flow (A)	0.4	0.4 x 2 (0.8)	0.4 x 3 (1.2)	0.4 x 4 (1.6)	0.4 x 5 (2.0)
Cooling & Heating					
Cooling/Heating Medium	Chilled Water or Hot Water				
Coil Connection - Cooling Coil (mm)	Ø 25 (1" BSP)				
Coil Connection - Heating Coil (mm)	Ø 13 (1/2" BSP)				
Filters					
Air Filter Type	Washable G2 / EU2				
Number of Air Filters	1	2	2	2	2
Air Filter Size (mm)	466 x 161 x 13	484 x 161 x 13	984 x 161 x 13	858 x 161 x 13	1058 x 161 x 13
Outlet Spigot Options (mm)	250 Ø				
Weight					
Weight Incl. Water (kg)	34	53	73	92	112
Nett Dry Weight (kg)	32	49	68	84	103
Shipping Weight (kg)	34	53	72	90	110
Notes:	*1 With no filters fitted and a dry coil surface. *2 Voltage range 220-240V		Cooling and Heating Coil options: 3 Row or 4 Row Cooling Only 3 Row or 4 Row Cooling + 1 Row Heating		


IXDL 40-4-Y				Low Speed			Medium Speed			High Speed		
4 row chilled water coil				100 L/s			150 L/s			200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	2.0	total	2.3	2.2	2.0	2.9	2.7	2.4	3.4	3.1	2.8
			sensible	1.6	1.5	1.4	2.1	2.0	1.9	2.6	2.5	2.4
	0.4	7.3	total	2.6	2.4	2.2	3.4	3.1	2.8	4.0	3.7	3.4
			sensible	1.7	1.6	1.5	2.3	2.2	2.1	2.9	2.7	2.6
	0.6	14.6	total	2.7	2.5	2.3	3.6	3.3	3.0	4.4	4.0	3.7
			sensible	1.8	1.7	1.6	2.4	2.3	2.2	3.0	2.9	2.7
27/19	0.2	2.0	total	2.9	2.7	2.5	3.6	3.3	3.1	4.1	3.9	3.6
			sensible	2.0	1.9	1.8	2.6	2.5	2.5	3.2	3.1	3.0
	0.4	7.3	total	3.2	3.0	2.8	4.2	3.9	3.6	5.0	4.6	4.3
			sensible	2.1	2.0	1.9	2.9	2.7	2.6	3.6	3.4	3.3
	0.6	14.6	total	3.3	3.1	2.9	4.5	4.2	3.9	5.4	5.0	4.7
			sensible	2.2	2.1	2.0	3.0	2.9	2.8	3.8	3.6	3.5

IXDL 40-3/1-Y				100 L/s			150 L/s			200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	3.4	total	2.1	1.9	1.8	2.6	2.4	2.2	3.0	2.7	2.5
			sensible	1.5	1.4	1.3	1.9	1.8	1.7	2.3	2.2	2.1
	0.4	11.6	total	2.4	2.2	2.0	3.0	2.8	2.6	3.7	3.3	3.0
			sensible	1.6	1.5	1.4	2.1	2.0	1.9	2.6	2.5	2.3
	0.6	24.2	total	2.5	2.3	2.1	3.3	3.0	2.8	4.0	3.7	3.3
			sensible	1.6	1.5	1.4	2.2	2.1	2.0	2.7	2.6	2.4
27/19	0.2	3.4	total	2.6	2.4	2.2	3.2	3.0	2.7	3.7	3.4	3.1
			sensible	1.8	1.7	1.6	2.4	2.3	2.2	2.9	2.8	2.7
	0.4	11.6	total	2.9	2.7	2.5	3.8	3.5	3.3	4.5	4.2	3.9
			sensible	1.9	1.8	1.7	2.6	2.5	2.4	3.2	3.1	2.9
	0.6	24.2	total	3.1	2.9	2.7	4.1	3.8	3.5	4.9	4.6	4.3
			sensible	2.0	1.9	1.8	2.7	2.6	2.5	3.4	3.2	3.1

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.06	2.0	heat	1.9	2.8	3.6	2.4	3.5	4.5	2.7	3.9	5.1
	0.12	6.9	heat	2.1	3.0	3.9	2.7	3.8	5.0	3.1	4.5	5.8
	0.18	14.3	heat	2.2	3.2	4.1	2.8	4.1	5.3	3.4	4.8	6.2
21	0.06	2.0	heat	1.6	2.4	3.3	2.0	3.0	4.1	2.3	3.4	4.6
	0.12	6.9	heat	1.7	2.6	3.6	2.2	3.3	4.5	2.6	3.9	5.2
	0.18	14.3	heat	1.8	2.8	3.8	2.3	3.5	4.7	2.8	4.2	5.6

Performance Data

Air Handling

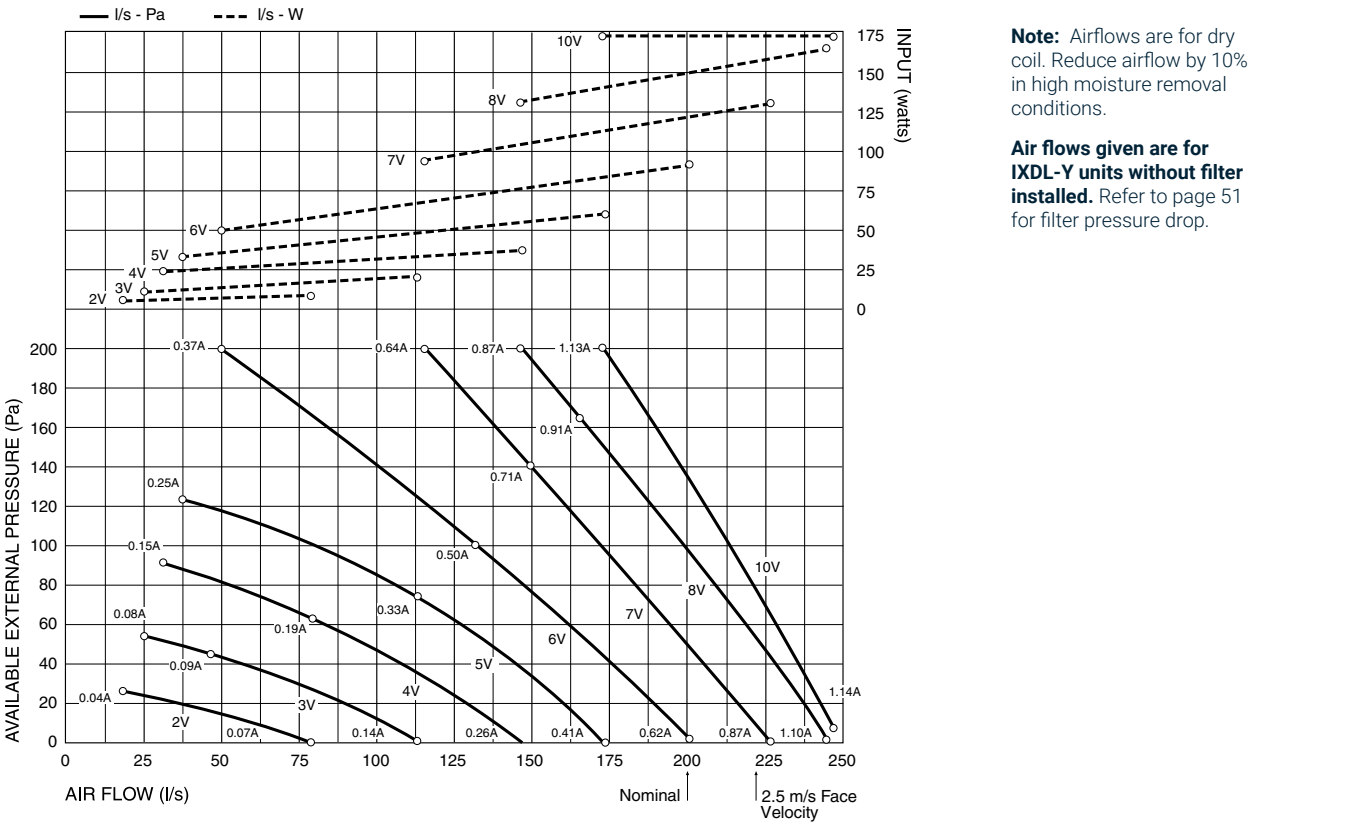

Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	57	64	61	55	47	46	42
8	57	64	61	55	46	46	42
7	55	63	59	53	45	43	40
6	53	61	58	51	43	41	37
5	50	58	54	48	41	37	34
4	47	55	52	44	37	32	28
3	43	52	47	40	33	27	22
2	36	48	39	34	25	20	16

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	52	65	57	43	35	32	29
8	52	65	57	43	35	32	32
7	50	63	55	41	33	29	27
6	48	61	54	39	32	27	25
5	45	58	51	37	29	23	21
4	42	55	47	30	25	18	15
3	38	52	43	28	21	12	9
2	34	49	36	23	14	6	2

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com


IXDL 90-4-Y				Low Speed			Medium Speed			High Speed		
4 row chilled water coil				200 L/s			300 L/s			400 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	3.0	total	4.4	4.0	3.7	5.3	4.9	4.5	6.0	5.5	5.0
			sensible	3.1	2.9	2.8	4.0	3.9	3.7	4.9	4.7	4.5
	0.4	10.7	total	5.0	4.6	4.2	6.5	6.0	5.4	7.6	7.0	6.4
			sensible	3.4	3.2	3.0	4.6	4.3	4.1	5.5	5.3	5.0
	0.6	22.6	total	5.3	4.9	4.5	7.1	6.5	5.9	8.5	7.8	7.1
			sensible	3.5	3.3	3.1	4.8	4.6	4.3	5.9	5.6	5.3
27/19	0.2	3.0	total	5.4	5.0	4.7	6.5	6.1	5.6	7.3	6.8	6.3
			sensible	3.8	3.7	3.5	5.1	4.9	4.7	6.1	5.9	5.7
	0.4	10.7	total	6.2	5.8	5.3	8.0	7.4	6.9	9.3	8.7	8.0
			sensible	4.2	4.0	3.8	5.6	5.4	5.2	6.9	6.6	6.3
	0.6	22.6	total	6.5	6.1	5.7	8.7	8.1	7.5	10.4	9.7	8.9
			sensible	4.3	4.1	4.0	6.0	5.7	5.5	7.3	7.1	6.7

IXDL 90-3/1-Y				200 L/s			300 L/s			400 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	5.1	total	3.9	3.6	3.3	4.7	4.4	4.0	5.3	4.9	4.4
			sensible	2.8	2.7	2.5	3.6	3.5	3.3	4.3	4.2	4.0
	0.4	17.6	total	4.6	4.2	3.8	5.9	5.4	4.9	6.8	6.3	5.7
			sensible	3.1	2.9	2.8	4.1	3.9	3.7	5.0	4.7	4.5
	0.6	36.7	total	4.9	4.5	4.1	6.4	5.9	5.3	7.7	7.0	6.4
			sensible	3.2	3.1	2.9	4.4	4.1	3.9	5.3	5.0	4.8
27/19	0.2	5.1	total	4.9	4.5	4.2	5.8	5.4	5.0	6.5	6.0	5.6
			sensible	3.5	3.4	3.2	4.5	4.4	4.2	5.4	5.2	5.1
	0.4	17.6	total	5.7	5.3	4.9	7.2	6.7	6.2	8.4	7.8	7.2
			sensible	3.8	3.7	3.5	5.1	4.9	4.7	6.1	5.9	5.7
	0.6	36.7	total	6.1	5.7	5.2	7.9	7.4	6.8	9.4	8.8	8.1
			sensible	4.0	3.8	3.6	5.4	5.1	4.9	6.6	6.3	6.0

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.06	3.1	heat	3.5	5.1	6.6	4.2	6.1	7.9	4.7	6.7	8.7
	0.12	10.6	heat	4.1	5.8	7.5	5.1	7.2	9.4	5.8	8.3	10.8
	0.18	21.9	heat	4.3	6.2	8.1	5.4	7.7	10.1	6.4	9.1	11.9
21	0.06	3.1	heat	2.9	4.4	6.0	3.5	5.3	7.1	3.9	5.9	8.0
	0.12	10.6	heat	3.3	5.1	6.8	4.1	6.3	8.5	4.8	7.3	9.7
	0.18	21.9	heat	3.5	5.4	7.2	4.4	6.8	9.1	5.3	8.0	10.7

Performance Data

Air Handling

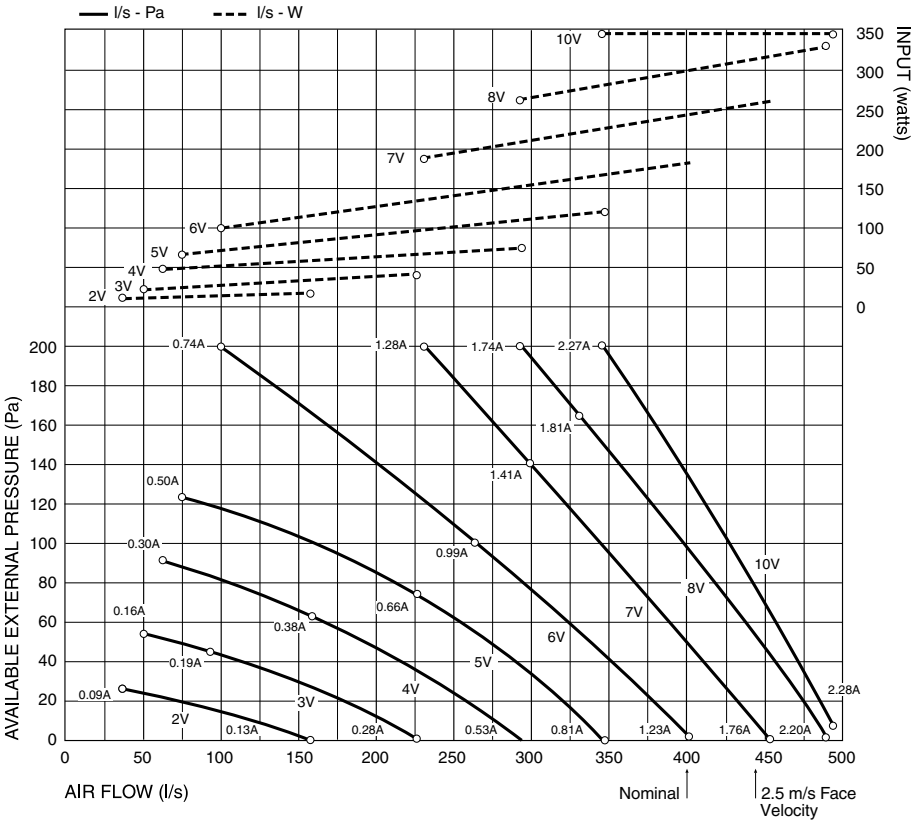

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions.

Air flows given are for IXDL-Y units without filter installed. Refer to page 51 for filter pressure drop.

For **individual fan performance** see page 41 - IXDL 40Y Fan Curve

Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	58	65	62	56	47	46	43
8	58	65	62	56	47	47	43
7	56	63	60	54	45	44	40
6	53	60	58	51	43	41	37
5	50	58	54	48	40	37	33
4	47	55	52	44	37	32	28
3	42	50	47	39	31	26	21
2	35	47	38	32	24	19	15

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	53	65	59	47	40	38	36
8	53	65	58	46	40	38	36
7	51	63	56	44	38	36	33
6	49	61	55	41	36	32	30
5	46	57	51	38	33	28	26
4	42	55	47	34	29	23	20
3	38	50	43	30	24	17	13
2	33	47	35	24	16	11	6

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com


IXDL 130-4-Y				Low Speed			Medium Speed			High Speed		
4 row chilled water coil				300 L/s			450 L/s			600 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	3.9	total	6.0	5.5	5.1	7.1	6.5	5.9	7.7	7.1	6.5
			sensible	4.4	4.2	4.0	5.7	5.5	5.2	6.8	6.5	6.3
	0.4	13.5	total	7.2	6.6	6.0	9.1	8.3	7.6	10.4	9.5	8.7
			sensible	4.9	4.6	4.4	6.5	6.2	5.9	7.9	7.5	7.2
	0.6	28	total	7.7	7.1	6.5	10.1	9.2	8.4	11.9	10.9	9.9
			sensible	5.2	4.8	4.6	7.0	6.6	6.2	8.5	8.1	7.7
27/19	0.2	3.9	total	7.4	6.9	6.4	8.6	8.0	7.4	9.4	8.8	8.1
			sensible	5.4	5.2	5.0	7.1	6.8	6.6	8.5	8.3	8.0
	0.4	13.5	total	8.8	8.3	7.7	11.1	10.3	9.6	12.7	11.8	11.0
			sensible	6.1	5.8	5.6	8.1	7.8	7.5	9.8	9.4	9.1
	0.6	28	total	9.5	8.9	8.2	12.4	11.6	10.7	14.6	13.6	12.6
			sensible	6.4	6.1	5.8	8.6	8.3	7.9	10.5	10.1	9.7

IXDL 130-3/1-Y				300 L/s			450 L/s			600 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	6.6	total	5.4	4.9	4.5	6.3	5.8	5.3	6.9	6.3	5.8
			sensible	4.0	3.8	3.6	5.1	4.9	4.7	6.1	5.8	5.6
	0.35	17.8	total	6.3	5.8	5.3	7.8	7.2	6.5	8.9	8.2	7.4
			sensible	4.4	4.2	3.9	5.7	5.5	5.2	6.8	6.5	6.3
	0.5	33.7	total	6.8	6.3	5.7	8.7	8.0	7.3	10.1	9.3	8.5
			sensible	4.6	4.4	4.1	6.1	5.8	5.5	7.4	7.0	6.7
27/19	0.2	6.6	total	6.6	6.2	5.7	7.7	7.2	6.6	8.4	7.9	7.3
			sensible	5.0	4.8	4.6	6.4	6.2	6.0	7.6	7.4	7.2
	0.35	17.8	total	7.8	7.3	6.7	9.6	8.9	8.3	10.9	10.1	9.4
			sensible	5.4	5.2	5.0	7.1	6.8	6.6	8.5	8.2	7.9
	0.5	33.7	total	8.4	7.9	7.3	10.7	10.0	9.2	12.4	11.6	10.8
			sensible	5.7	5.5	5.2	7.5	7.3	6.9	9.1	8.8	8.4

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
15	0.06	4.0	heat	4.8	6.8	8.8	5.5	7.8	10.2	5.9	8.5	11.1
	0.12	13.6	heat	5.7	8.1	10.5	6.9	9.9	12.9	7.8	11.2	14.5
	0.18	28.0	heat	6.1	8.7	11.4	7.7	11.0	14.2	8.8	12.6	16.4
21	0.06	4.0	heat	3.9	6.0	8.0	4.5	6.9	9.2	4.9	7.5	10.0
	0.12	13.6	heat	4.7	7.1	9.5	5.7	8.7	11.6	6.5	9.8	13.2
	0.18	28.0	heat	5.0	7.7	10.3	6.3	9.6	12.9	7.3	11.1	14.8

Performance Data

Air Handling

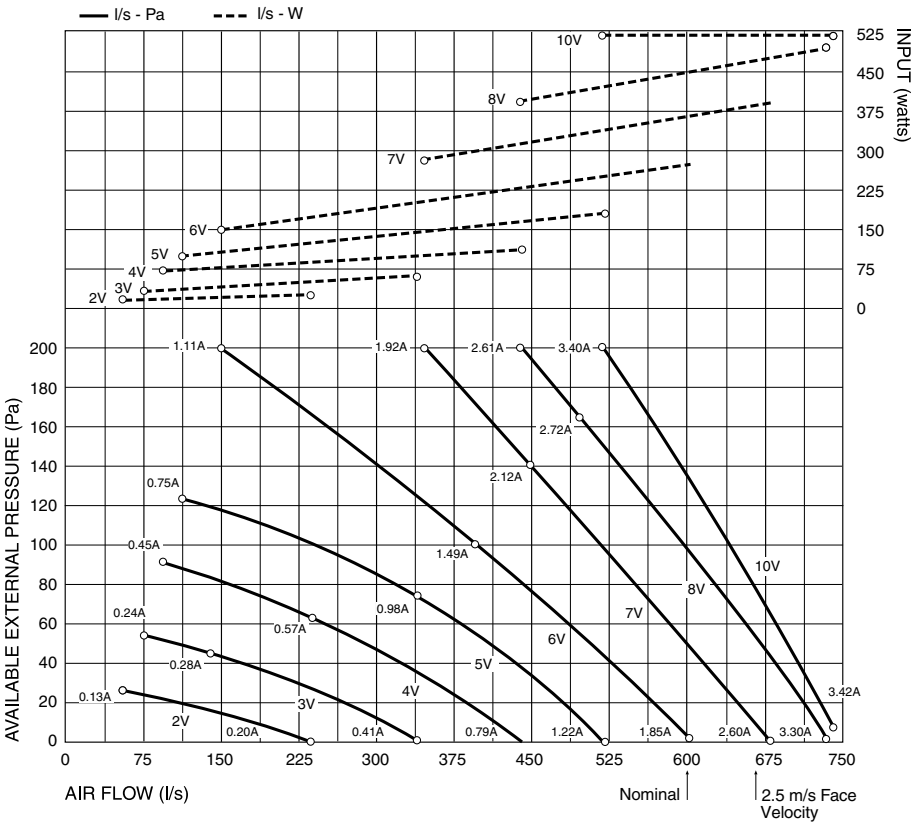

Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	64	71	69	63	54	53	49
8	64	71	69	62	53	52	48
7	62	69	67	60	52	49	45
6	59	67	65	57	49	46	41
5	56	63	61	53	46	43	37
4	52	60	57	50	42	36	31
3	45	53	51	43	36	28	23
2	39	47	43	37	29	26	19

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	61	73	66	54	47	45	42
8	61	73	65	53	46	44	41
7	58	70	64	51	44	42	38
6	56	68	61	48	42	39	35
5	53	65	58	44	39	34	30
4	49	61	55	41	35	29	25
3	44	57	48	35	29	23	17
2	36	49	41	29	20	14	8

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com


IXDL 160-4-Y				Low Speed			Medium Speed			High Speed		
4 row chilled water coil				400 L/s			600 L/s			800 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.25	6.9	total	7.9	7.3	6.6	9.3	8.5	7.8	10.1	9.3	8.4
			sensible	5.8	5.5	5.2	7.5	7.2	6.9	8.9	8.6	8.3
	0.45	19.8	total	9.4	8.6	7.8	11.6	10.7	9.7	13.3	12.2	11.1
			sensible	6.5	6.1	5.8	8.5	8.1	7.7	10.2	9.8	9.3
	0.65	38.3	total	10.1	9.3	8.4	13.0	12.0	10.9	15.2	14.0	12.7
			sensible	6.8	6.4	6.0	9.1	8.6	8.2	11.0	10.5	10.0
27/19	0.25	6.9	total	9.7	9.1	8.4	11.3	10.6	9.8	12.3	11.5	10.7
			sensible	7.2	6.9	6.7	9.3	9.1	8.8	11.2	10.9	10.6
	0.45	19.8	total	11.5	10.7	10.0	14.3	13.3	12.3	16.2	15.2	14.0
			sensible	8.0	7.6	7.3	10.5	10.1	9.7	12.7	12.3	11.8
	0.65	38.3	total	12.4	11.5	10.7	16.0	14.9	13.8	18.7	17.4	16.2
			sensible	8.3	8.0	7.6	11.3	10.8	10.3	13.7	13.2	12.7

IXDL 160-3/1-Y				400 L/s			600 L/s			800 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.25	11.6	total	7.1	6.5	5.9	8.3	7.6	7.0	9.1	8.4	7.7
			sensible	5.3	5.0	4.8	6.7	6.5	6.2	8.0	7.7	7.4
	0.35	21.0	total	7.9	7.3	6.6	9.6	8.7	8.0	10.8	9.9	9.0
			sensible	5.6	5.3	5.0	7.3	6.9	6.6	8.6	8.3	8.0
	0.45	33.0	total	8.5	7.8	7.1	10.5	9.7	8.8	12.0	11.0	10.1
			sensible	5.9	5.5	5.3	7.6	7.3	6.9	9.1	8.7	8.4
27/19	0.25	11.6	total	8.7	8.1	7.5	10.2	9.5	8.8	11.2	10.4	9.7
			sensible	6.5	6.3	6.1	8.4	8.1	7.9	10.0	9.7	9.4
	0.35	21.0	total	9.8	9.1	8.4	11.8	11.0	10.1	13.2	12.3	11.4
			sensible	7.0	6.7	6.4	9.0	8.7	8.4	10.7	10.4	10.1
	0.45	33.0	total	10.4	9.7	9.0	12.9	12.0	11.1	14.8	13.8	12.7
			sensible	7.2	7.0	6.7	9.5	9.1	8.8	11.3	11.0	10.6

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.06	4.8	heat	5.6	8.1	10.5	6.3	9.1	11.7	6.8	9.7	12.6
	0.12	16.3	heat	7.0	10.1	13.1	8.4	12.1	15.7	9.4	13.5	17.5
	0.18	33.4	heat	7.7	11.0	14.4	9.6	13.7	17.7	10.9	15.6	20.2
21	0.06	4.8	heat	4.7	7.1	9.5	5.2	7.9	10.7	5.6	8.5	11.4
	0.12	16.3	heat	5.8	8.8	11.8	7.0	10.6	14.2	7.8	11.8	15.9
	0.18	33.4	heat	6.4	9.6	13.0	7.9	12.0	16.1	8.9	13.6	18.3

Performance Data

Air Handling

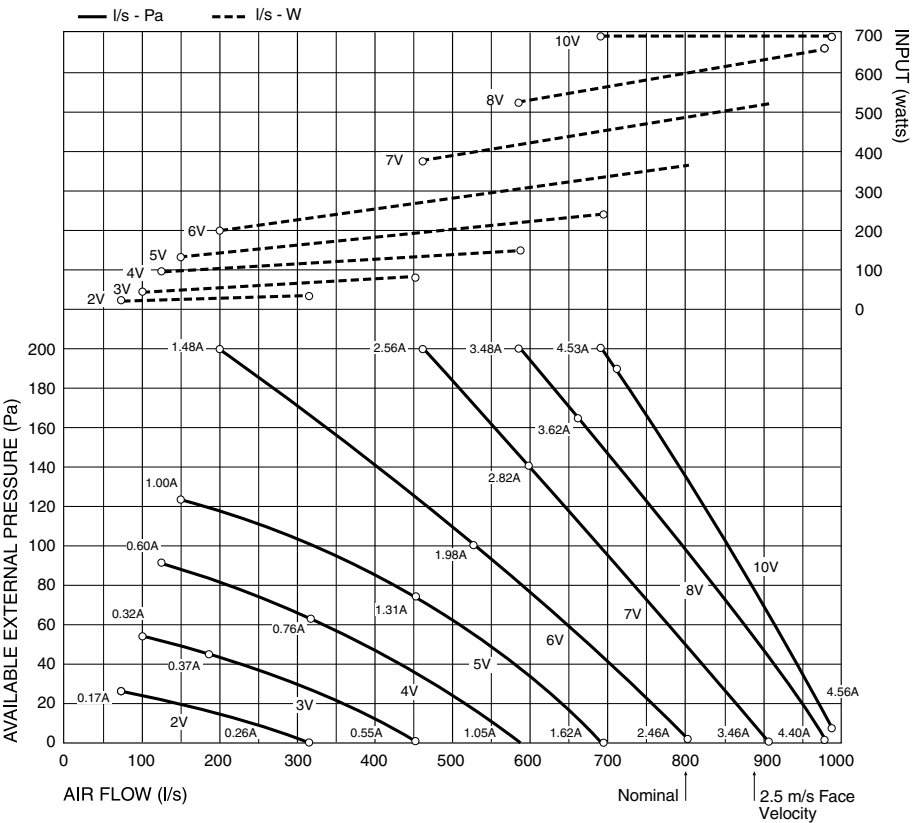

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions.

Air flows given are for IXDL-Y units without filter installed. Refer to page 51 for filter pressure drop.

For **individual fan performance** see page 41 - IXDL 40Y Fan Curve

Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	70	76	75	68	59	57	53
8	69	75	74	66	58	56	52
7	67	73	72	64	56	53	49
6	64	71	70	61	54	50	45
5	60	67	66	58	50	45	40
4	56	63	61	54	46	40	35
3	50	58	56	48	40	34	30
2	43	52	48	41	33	30	26

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	67	78	72	60	53	52	49
8	66	78	72	60	52	51	48
7	65	76	70	57	50	49	45
6	62	74	69	54	48	46	42
5	59	70	64	51	45	41	37
4	55	67	60	47	41	36	32
3	49	62	54	41	34	28	23
2	42	55	46	34	26	21	14

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

				Low Speed			Medium Speed			High Speed		
4 row chilled water coil				500 L/s			750 L/s			1000 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	5.4	total	8.4	7.7	7.1	9.4	8.7	7.9	10.0	9.4	8.8
			sensible	6.6	6.3	6.1	8.5	8.2	7.9	10.0	9.4	8.8
	0.4	18.7	total	10.9	10.0	9.1	13.2	12.1	11.0	14.7	13.5	12.3
			sensible	7.7	7.3	6.9	10.0	9.6	9.1	12.0	11.5	11.0
	0.6	38.9	total	12.1	11.1	10.1	15.2	14.0	12.8	17.6	16.2	14.7
			sensible	8.2	7.8	7.3	10.9	10.4	9.9	13.2	12.6	12.0
27/19	0.2	5.4	total	10.3	9.6	8.9	11.5	10.7	10.0	12.3	11.8	11.2
			sensible	8.3	8.0	7.7	10.6	10.4	10.0	12.3	11.8	11.2
	0.4	18.7	total	13.4	12.5	11.6	16.2	15.0	13.9	17.8	16.8	15.5
			sensible	9.5	9.2	8.8	12.5	12.0	11.6	14.9	14.5	14.0
	0.6	38.9	total	14.8	13.9	12.9	18.7	17.4	16.1	21.5	20.1	18.6
			sensible	10.1	9.7	9.3	13.5	13.0	12.5	16.3	15.8	15.2


IXDL 200-3/1-Y

3 row chilled water coil				500 L/s			750 L/s			1000 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.25	13.5	total	8.4	7.7	7.0	9.6	8.9	8.1	10.4	9.6	8.9
			sensible	6.4	6.1	5.8	8.1	7.8	7.5	9.6	9.3	8.9
	0.35	24.8	total	9.5	8.7	7.9	11.3	10.3	9.4	12.6	11.6	10.5
			sensible	6.5	6.5	6.2	8.8	8.4	8.0	10.4	10.0	9.6
	0.45	39	total	10.2	9.4	8.6	12.5	11.5	10.4	14.1	13.0	11.8
			sensible	7.1	6.8	6.4	9.3	8.8	8.4	11.0	10.6	10.1
27/19	0.25	13.5	total	10.2	9.6	8.9	11.7	10.9	10.1	12.7	11.9	11.2
			sensible	7.9	7.6	7.3	10.1	9.8	9.5	12.0	11.7	11.2
	0.35	24.8	total	11.6	10.8	10.0	13.7	12.9	11.9	15.4	14.3	13.3
			sensible	8.5	8.1	7.8	10.9	10.5	10.2	13.0	12.6	12.2
	0.45	39	total	12.6	11.7	10.9	15.3	14.3	13.3	17.3	16.1	14.9
			sensible	8.8	8.5	8.1	11.5	11.1	10.7	13.7	13.3	12.8

1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
15	0.06	5.6	heat	6.4	9.1	11.9	7.0	10.0	13.1	7.4	10.7	13.7
	0.12	19.4	heat	8.4	12.0	15.6	9.8	14.0	18.3	10.8	15.5	20.2
	0.18	39.4	heat	9.3	13.3	17.3	11.3	16.2	21.1	12.8	18.3	23.9
21	0.06	5.6	heat	5.3	8.0	10.7	5.8	8.8	11.9	6.1	9.3	12.5
	0.12	19.4	heat	6.9	10.5	14.1	8.1	12.3	16.5	9.0	13.6	18.3
	0.18	39.4	heat	7.7	11.7	15.6	9.3	14.2	19.0	10.6	16.1	21.6

Performance Data

Air Handling

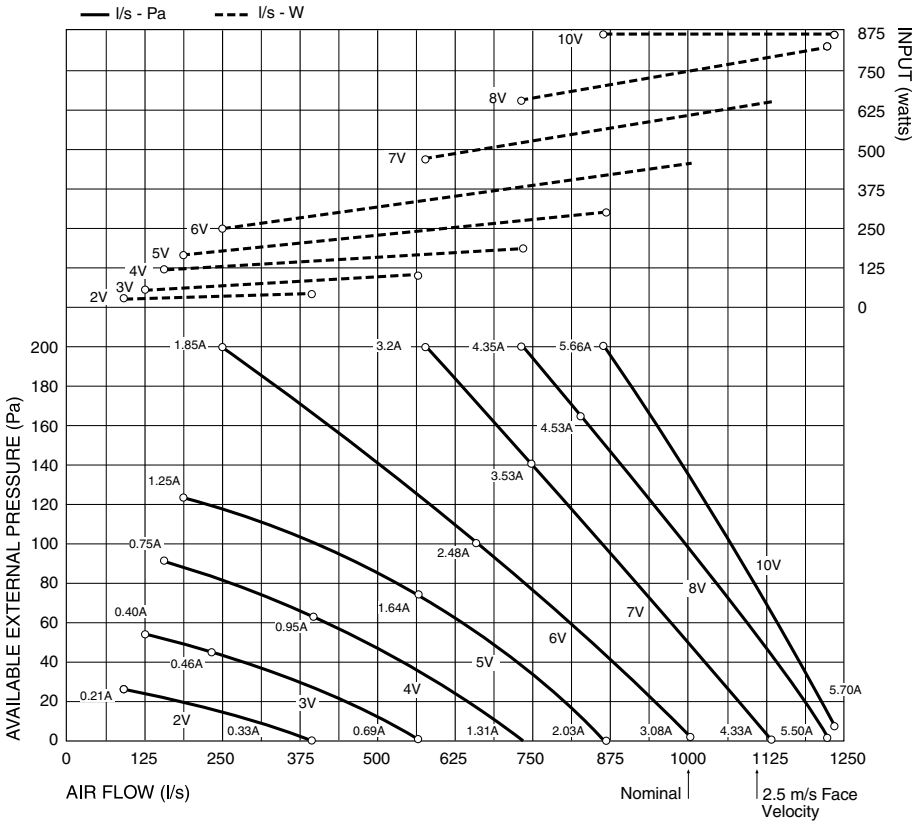

Note: Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions.

Air flows given are for IXDL-Y units without filter installed. Refer to page 51 for filter pressure drop.

For **individual fan performance** see page 41 - IXDL 40Y Fan Curve


Sound Levels

Return Air Inlet + Case Breakout							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	71	77	76	68	60	57	54
8	69	76	74	67	59	56	53
7	67	74	72	65	57	53	49
6	66	72	70	62	54	60	46
5	61	68	66	59	51	46	41
4	57	64	62	55	47	41	36
3	51	59	56	49	41	34	30
2	44	53	48	41	34	31	27

Supply Air Outlet							
Vdc	Sound Pressure Levels (SPL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
9	68	79	73	61	53	54	50
8	67	78	72	60	53	53	49
7	65	76	70	58	51	50	46
6	63	74	69	55	49	47	43
5	60	71	65	51	45	43	38
4	56	67	61	48	42	38	32
3	50	62	54	41	35	30	24
2	42	55	46	35	27	22	15

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Dimensional Data

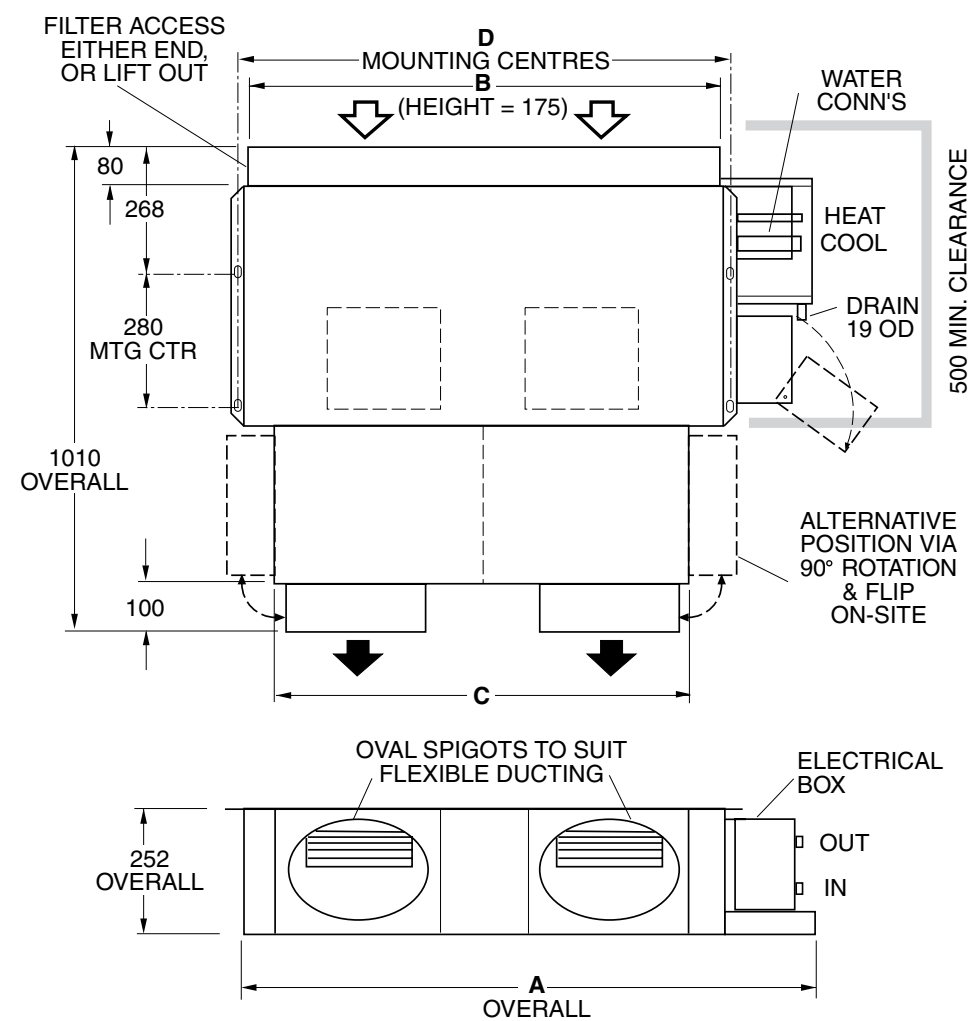

Model IXDL 90Y Shown.


- Note:**
1. Allow adequate clearance for the filter (if fitted) to be removed.
 2. IXDL have two half length filters except for IXDL 40Y.

Model	A	B	C	D	S/A Spigots	Water Conn's BSP Male		No. Fans / Outlets / Zones
						Cold	Hot	
IXDL 40Y	706	473	332	529	250 dia (x1)	25	13	1
IXDL 90Y	1250	973	820	1030	250 dia (x2)	25	13	2
IXDL 130Y	1605	1373	1252	1430	250 dia (x3)	25	13	3
IXDL 160Y	1954	1722	1630	1780	250 dia (x4)	25	13	4
IXDL 200Y	2355	2122	2037	2178	250 dia (x5)	25	13	5

Filter Pressure Drop


IMDL & IMD Series - EU2 rated filter media (standard)

G2/EU2

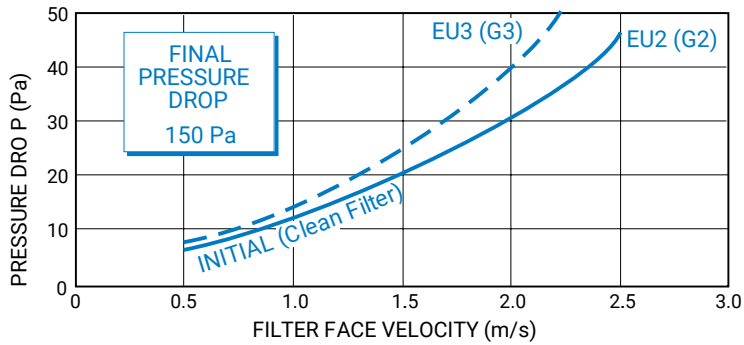

Filter Area	m ²
IMDL 40	0.13m ²
IMDL 60	0.19m ²
IMDL 90	0.25m ²
IMDL 130	0.35m ²
IMD 95	0.163m ²
IMD 135	0.211m ²
IMD 170	0.259m ²
IMD 210	0.293m ²
IMD 280	0.408m ²
IMD 420	0.569m ²
IMDL 550	0.772m ²
IXDL 40Y	0.075m ²
IXDL 90Y	0.15m ²
IXDL 130Y	0.22m ²
IXDL 160Y	0.275m ²
IXDL 200Y	0.34m ²


G4/EU4 - Optional for IJD Series

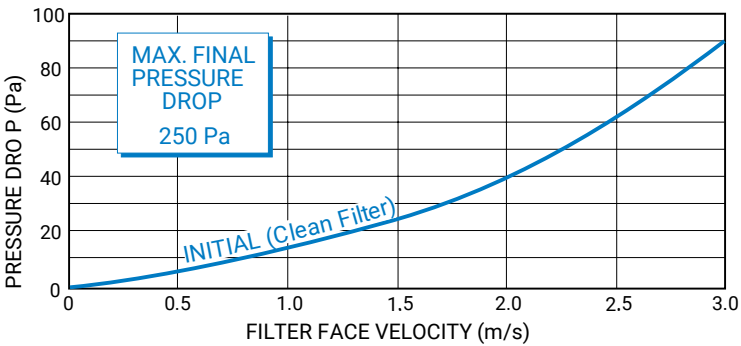

Filter Area	m ²
IJD 370	0.600m ²
IJD 450	0.750m ²
IJD 620	0.937m ²
IJD 950	1.350m ²
IJD 1400	1.900m ²
IJD 2000	3.000m ²
IJD 2400	3.600m ²

Note:
G2/EU2 filters do not meet Australian standards so are not used in the Australian market. G4/EU4 filters, that meet Australian standard, are best located behind return air grilles or in the ducting to reduce the velocity and therefore resistance losses.

Advantage IMD Range
(Compact FCU)



3 Speed Fan Motor



Electric Heating



Opposite Hand

Advantage Range (IMD)
Specifications

Model ● IMD 95 ● IMD 135 ● IMD 170 ● IMD 210 ● IMD 280 ● IMD 420 ● IMD 550

Features

Nominal Air Flow (l/s) * ¹	450	600	750	900	1200	1800	2350
Fan Type	Forward Curved Centrifugal Double Inlet Double Width						
Number of Fan Scrolls	1	1	1	2	2	2	2
Motor Type	Three Speed, Direct Drive						
Power Source * ²	1 Phase 230 Volt AC 50 Hz						
Number of Motors	1	1	1	1	2	2	2
Motor Rating (W)	316	373	550	550	550 (x2)	746 (x2)	746 (x2)
Full Load Current (A) * ²	3.5	3.7	5.0	5.7	5.7 x 2 (11.4)	6.3 x 2 (12.6)	6.3 x 2 (12.6)
Optional Electric Heating (kW)* ³	4	6	6	9	9	12	18
Electric Heat Current (A/ph)	17.6/1ph	8.8/3ph	8.8/3ph	13.2/3ph	13.2/3ph	17.6/3ph	26.4/3ph
Heat Exchanger Type	Epoxy Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tube						
Finish	Zinc Galvanised Steel						
Test Pressure	2100 kPa						
Cooling/Heating Medium	Chilled Water or Hot Water						
Connection Sizes Cooling Coil (mm)	Ø 25 (1" BSP)	Ø 25 (1" BSP)	Ø 25 (1" BSP)	Ø 25 (1" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)
Connection Sizes Heating Coil (mm)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 25 (1" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)

Filters

Optional Air Filter Type	G2 / EU2 Washable						
Number of Optional Air Filters	1	1	1	1	2	2	2
Optional Air Filter Size (mm)	593x275x13	767x275x13	914x275x13	1064x275x13	593x345x13	685x415x13	712x542x13

Weight

Weight (4/1) Incl. Water (kg)	47	55	62	72	96	135	165
Nett Dry Weight (kg)	42	49	55	64	85	120	145
Shipping Weight (kg)	48	55	62	72	93	147	173

Notes: *¹ With no filters fitted and with a dry coil surface
 *² Voltage range 220–240V fan motor only excluding electric heat
 *³ Optional Electric Heating - models IMD135 through IMD550 require a 3 phase AC power supply, 342-436V 50Hz. Complete with high temperature safety cutout thermostats required to meet AS/NZS 3350.2.40 2019

Cooling and Heating Coil options:
4 Row Cooling only
3 Row Cooling + 1 Row Heating
4 Row Cooling plus Electric Heating


IMD 95				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				250 L/s			350 L/s			450 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	7.0	total	5.4	5.0	4.5	6.4	5.9	5.4	7.2	6.7	6.1
			sensible	3.8	3.6	3.4	4.8	4.6	4.3	5.6	5.4	5.2
	0.5	17.6	total	6.0	5.5	5.0	7.4	6.8	6.1	8.5	7.9	7.1
			sensible	4.1	3.9	3.7	5.2	5.0	4.7	6.2	5.9	5.6
	0.7	32.4	total	6.4	5.8	5.3	8.0	7.3	6.7	9.3	8.6	7.8
			sensible	4.3	4.0	3.8	5.5	5.2	4.9	6.5	6.2	5.9
27/19	0.3	7.0	total	6.6	6.2	5.7	7.9	7.4	6.8	8.8	8.2	7.6
			sensible	4.7	4.5	4.3	5.9	5.7	5.5	7.0	6.8	6.6
	0.5	17.6	total	7.4	6.9	6.4	9.1	8.5	7.9	10.6	9.8	9.0
			sensible	5.1	4.8	4.6	6.5	6.2	5.9	7.7	7.4	7.1
	0.7	32.4	total	7.8	7.3	6.8	9.8	9.2	8.5	11.5	10.7	10.0
			sensible	5.2	5.0	4.8	6.8	6.5	6.2	8.1	7.8	7.5
31/21	0.3	7.0	total	8.0	7.5	7.1	9.4	8.9	8.3	10.5	9.9	8.3
			sensible	5.6	5.4	5.3	7.1	6.9	6.6	8.3	8.1	7.9
	0.5	17.6	total	8.9	8.4	7.9	10.9	10.3	9.6	12.5	11.8	11.1
			sensible	6.0	5.8	5.6	7.7	7.4	7.1	9.1	8.8	8.6
	0.7	32.4	total	9.4	8.9	8.3	11.8	11.1	10.4	13.8	13.0	12.2
			sensible	6.2	6.0	5.8	8.0	7.8	7.5	9.6	9.3	9.0
35/24	0.3	7.0	total	10.1	9.6	9.1	11.8	11.2	10.6	13.1	12.4	11.7
			sensible	6.3	6.1	5.9	7.9	7.7	7.5	9.2	9.0	8.8
	0.5	17.6	total	11.3	10.8	10.2	13.9	13.2	12.5	15.8	15.0	14.2
			sensible	6.8	6.6	6.4	8.6	8.4	8.1	10.2	9.9	9.6
	0.7	32.4	total	12.0	11.5	10.9	15.0	14.3	13.6	17.5	16.6	15.7
			sensible	7.1	6.9	6.6	9.1	8.8	8.5	10.8	10.5	10.2
1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.04	1.6	heat	4.2	5.7	7.2	4.7	6.4	7.9	5.0	6.8	8.5
	0.12	10.4	heat	5.6	7.5	9.5	6.6	9.0	11.3	7.5	10.0	12.7
	0.2	25.7	heat	6.1	8.2	10.4	7.4	10.0	12.6	8.4	11.4	14.3
15	0.04	1.6	heat	3.4	4.9	6.4	3.8	5.4	7.1	4.1	5.8	7.6
	0.12	10.4	heat	4.5	6.5	8.4	5.4	7.7	10.0	6.0	8.6	11.2
	0.2	25.7	heat	4.9	7.1	9.2	6.0	8.6	11.1	6.8	9.8	12.7
21	0.04	1.6	heat	2.8	4.3	5.8	3.2	4.8	6.4	3.4	5.1	6.9
	0.12	10.4	heat	3.7	5.7	7.6	4.4	6.7	9.0	5.0	7.6	10.1
	0.2	25.7	heat	4.1	6.2	8.3	5.0	7.5	10.1	5.7	8.6	11.5

Performance Data

Air Handling

- Notes:**
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.



Dimensions

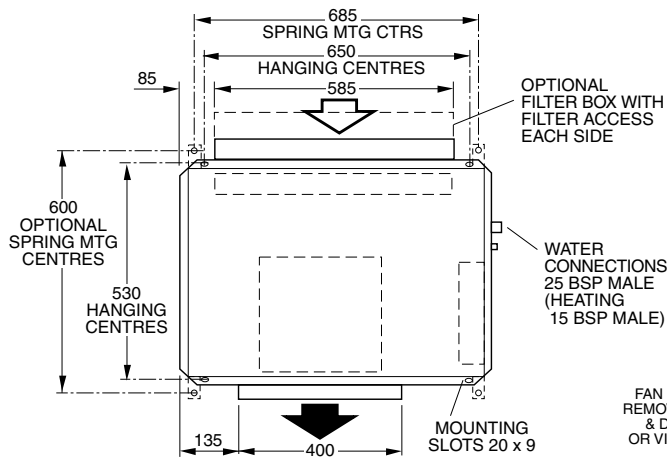

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMD 95

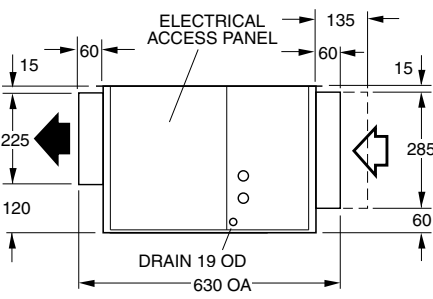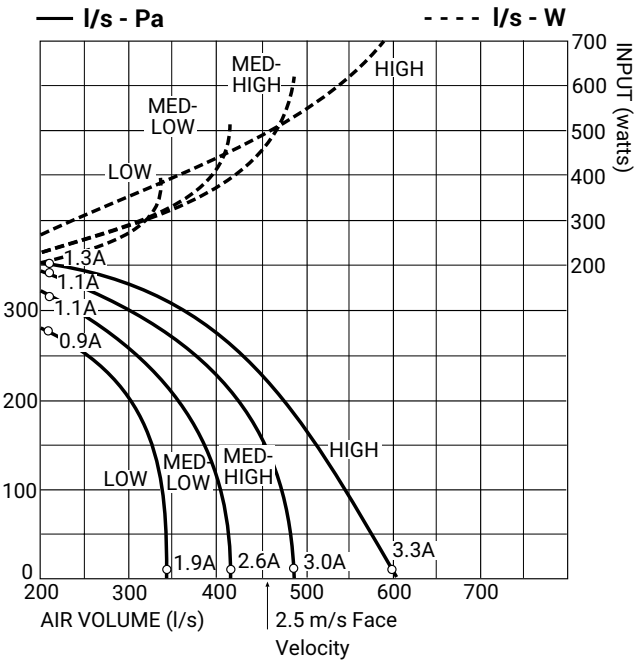

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	50	58	55	47	39	31	30
Med/Low	55	61	61	51	44	36	36
Med/High	58	66	65	54	47	39	39
High	60	68	67	55	48	42	41

IMD 135

IMD 135				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				300 L/s			450 L/s			600 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	4.0	total	5.8	5.3	4.9	6.8	6.3	5.7	7.5	6.8	6.3
			sensible	4.3	4.1	3.9	5.6	5.3	5.1	6.6	6.2	6.2
	0.4	13.9	total	7.0	6.4	5.8	8.7	8.0	7.3	10.1	9.2	8.4
			sensible	4.8	4.6	4.3	6.4	6.0	5.7	7.7	7.3	7.0
	0.6	28.9	total	7.5	6.9	6.3	9.8	9.0	8.2	11.5	10.6	9.6
			sensible	5.1	4.8	4.5	6.8	6.5	6.1	8.3	7.9	7.5
27/19	0.2	4.0	total	7.1	6.6	6.2	8.3	7.7	7.2	9.0	8.4	7.9
			sensible	5.3	5.1	4.9	6.9	6.7	6.5	8.3	8.1	7.9
	0.4	13.9	total	8.6	8.0	7.4	10.7	10.0	9.2	12.3	11.4	10.6
			sensible	5.9	5.7	5.5	7.9	7.6	7.3	9.5	9.2	8.9
	0.6	28.9	total	9.3	8.6	8.0	12.0	11.2	10.4	14.1	13.2	12.2
			sensible	6.3	6.0	5.7	8.4	8.1	7.7	10.3	9.9	9.5
31/21	0.2	4.0	total	8.5	8.0	7.5	9.8	9.3	8.7	10.7	10.1	9.5
			sensible	6.3	6.1	5.9	8.2	8.0	7.8	9.9	9.7	9.5
	0.4	13.9	total	10.3	9.7	9.1	12.8	12.1	11.3	14.7	13.8	12.9
			sensible	7.1	6.8	6.6	9.4	9.1	8.8	11.4	11.0	10.7
	0.6	28.9	total	11.1	10.5	9.8	14.4	13.5	12.7	16.9	15.9	14.9
			sensible	7.4	7.1	6.9	10.0	9.7	9.3	12.2	11.8	11.4
35/24	0.2	4.0	total	10.6	10.1	9.6	12.1	11.6	11.0	13.1	12.5	11.9
			sensible	7.0	6.9	6.7	9.1	8.9	8.7	10.9	10.7	10.5
	0.4	13.9	total	13.0	12.5	11.8	16.1	15.3	14.5	18.2	17.3	16.4
			sensible	8.0	7.7	7.5	10.5	10.2	9.9	12.5	12.2	11.9
	0.6	28.9	total	14.2	13.6	12.9	18.3	17.4	16.5	21.3	20.2	19.2
			sensible	8.5	8.2	7.9	11.3	10.9	10.6	13.6	13.3	12.9


1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.04	2.0	heat	4.9	6.6	8.2	5.4	7.3	9.1	5.8	7.8	9.8
	0.12	13.5	heat	6.7	9.1	11.4	8.2	11.1	14.0	9.3	12.5	15.8
	0.2	33.3	heat	7.4	10.0	12.6	9.3	12.6	15.9	10.8	14.5	18.3
15	0.04	2.0	heat	4.0	5.7	7.3	4.4	6.3	8.2	4.7	6.7	8.7
	0.12	13.5	heat	5.5	7.8	10.1	6.7	9.5	12.4	7.6	10.8	14.0
	0.2	33.3	heat	6.0	8.6	11.2	7.5	10.8	14.0	8.7	12.5	16.2
21	0.04	2.0	heat	3.3	5.0	6.6	3.6	5.5	7.4	3.9	5.9	7.8
	0.12	13.5	heat	4.5	6.8	9.2	5.5	8.4	11.2	6.2	9.5	12.7
	0.2	33.3	heat	5.0	7.5	10.1	6.2	9.4	12.7	7.2	10.9	14.7

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

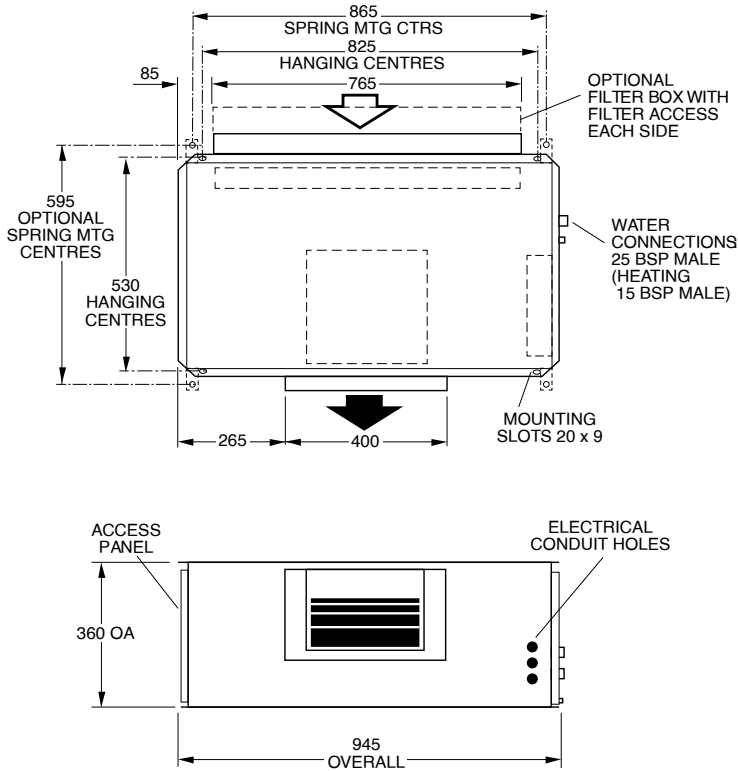

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMD 135

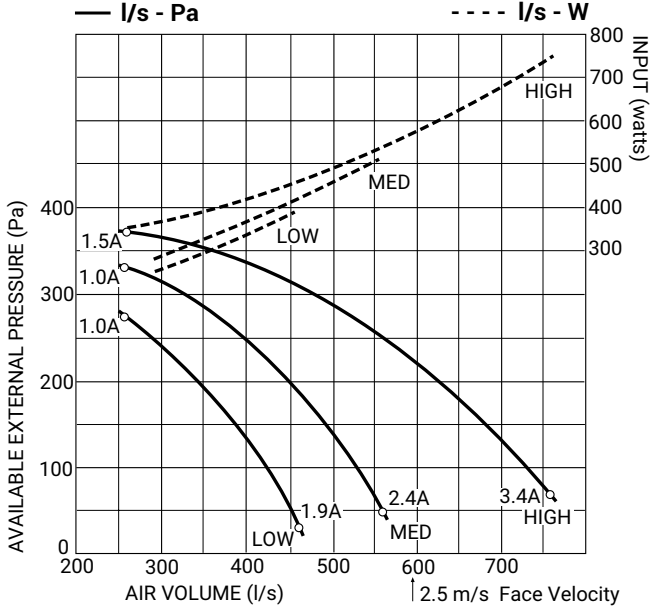



IMD 170				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				350 L/s			550 L/s			750 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	9.3	total sensible	7.5 5.3	6.9 5.1	6.3 4.8	9.2 7.2	8.5 6.8	7.7 6.5	10.3 8.7	9.5 8.4	8.8 8.0
	0.45	19.4	total sensible	8.3 5.7	7.6 5.4	6.9 5.1	10.6 7.7	9.7 7.4	8.9 7.0	12.3 9.5	11.3 9.1	10.3 8.6
	0.6	33.4	total sensible	8.8 5.9	8.0 5.6	7.3 5.2	11.6 8.2	10.6 7.8	9.7 7.4	13.8 10.1	12.6 9.6	11.5 9.2
27/19	0.3	9.3	total sensible	9.2 6.6	8.6 6.3	8.0 6.1	11.2 8.9	10.5 8.6	9.7 8.3	12.6 10.8	11.8 10.5	11.0 10.2
	0.45	19.4	total sensible	10.2 7.0	9.5 6.7	8.8 6.4	13.1 9.6	12.2 9.3	11.3 8.9	15.1 11.8	14.0 11.4	13.0 11.0
	0.6	33.4	total sensible	10.8 7.3	10.0 7.0	9.3 6.6	14.2 10.1	13.3 9.7	12.3 9.3	16.9 12.5	15.7 12.0	14.6 11.6
31/21	0.3	9.3	total sensible	11.0 7.8	10.4 7.6	9.8 7.3	13.4 10.6	12.7 10.3	11.9 10.0	15.0 12.9	14.1 12.6	13.3 12.3
	0.45	19.4	total sensible	12.2 8.3	11.5 8.0	10.8 7.8	15.6 11.4	14.7 11.1	13.8 10.7	18.0 14.0	16.9 13.6	15.9 13.2
	0.6	33.4	total sensible	12.9 8.6	12.2 8.3	11.4 8.0	17.0 12.0	16.0 11.6	15.0 11.2	20.2 14.8	18.9 14.4	17.8 13.9
35/24	0.3	9.3	total sensible	13.9 8.8	13.2 8.5	12.5 8.3	16.7 11.7	15.8 11.4	15.0 11.1	18.4 14.2	17.5 13.9	16.6 13.6
	0.45	19.4	total sensible	15.5 9.4	14.8 9.1	14.0 8.8	19.6 12.7	18.6 12.4	17.7 12.1	22.4 15.5	21.3 15.1	20.2 14.8
	0.6	33.4	total sensible	16.5 9.8	15.7 9.5	15.0 9.2	21.6 13.5	20.6 13.1	19.5 12.7	25.2 16.5	23.9 16.0	22.7 15.6
1 row heating water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
7	0.06	4.5	heat	6.4	8.6	10.8	7.3	9.9	12.4	8.0	10.7	13.4
	0.12	13.4	heat	7.8	10.5	13.2	9.5	12.9	16.2	10.8	14.6	18.3
	0.18	31.4	heat	8.5	11.4	14.6	10.7	14.4	18.2	12.4	16.7	21.0
15	0.06	4.5	heat	5.2	7.4	9.6	5.9	8.5	11.0	6.4	9.2	11.9
	0.12	15.4	heat	6.3	9.0	11.7	7.7	11.1	14.4	8.8	12.5	16.3
	0.18	31.4	heat	7.0	9.8	12.7	8.7	12.4	16.1	10.0	14.4	18.7
21	0.06	4.5	heat	4.3	6.4	8.7	4.9	7.4	10.0	5.3	8.1	10.9
	0.12	15.4	heat	5.2	7.9	10.5	6.4	9.7	13.0	7.3	11.0	14.8
	0.18	31.4	heat	5.6	8.6	11.5	7.2	10.9	14.6	8.3	12.6	16.9

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

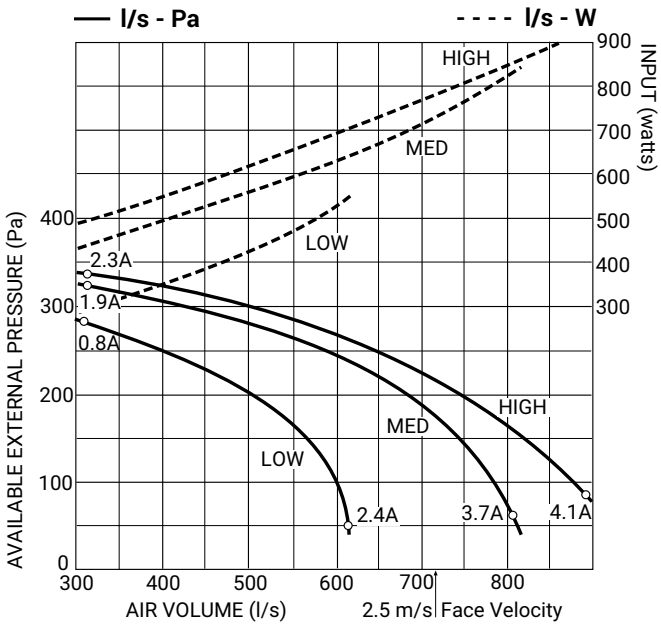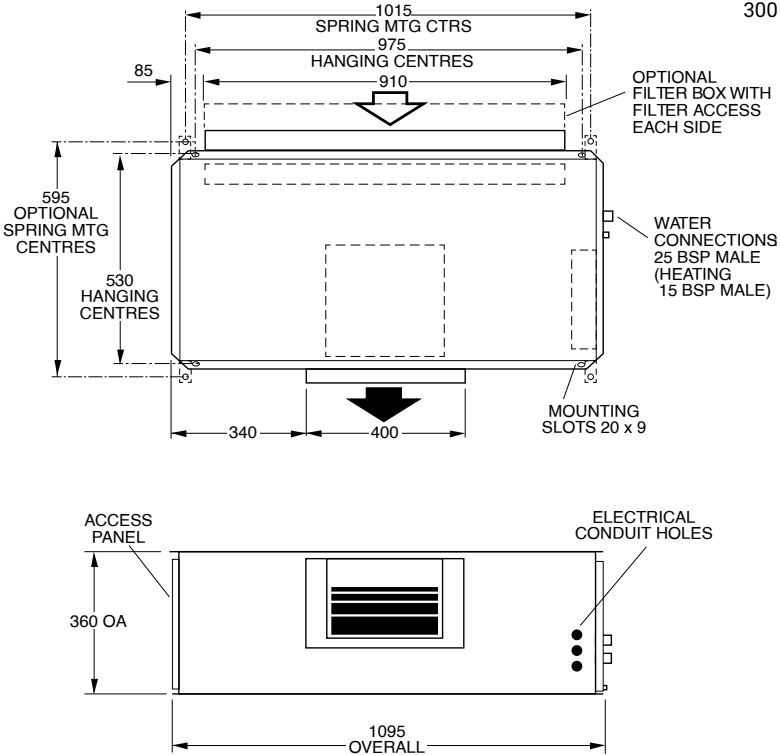

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	54	57	59	54	44	37	37
Med	61	63	66	59	53	45	45
High	63	65	69	61	56	47	47

IMD 210


				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				400 L/s			650 L/s			900 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.4	9.5	total	8.9	8.2	7.5	11.3	10.3	9.4	12.8	11.8	10.7
			sensible	6.2	5.9	5.6	8.6	8.2	7.8	10.6	10.1	9.7
	0.6	19.6	total	9.7	8.9	8.1	12.9	11.8	10.8	15.2	13.9	12.7
27/19	0.4	9.5	total	10.2	9.4	8.6	14.0	12.8	11.7	16.8	15.4	14.0
			sensible	6.8	6.5	6.1	9.8	9.3	8.8	12.2	11.6	11.0
	0.6	19.6	total	10.9	10.2	9.4	13.8	12.9	11.9	15.6	14.7	13.6
31/21	0.4	9.5	total	11.9	11.1	10.4	15.8	14.8	13.7	18.6	17.3	16.1
			sensible	8.2	7.8	7.5	11.5	11.1	10.6	14.3	13.8	13.3
	0.6	19.6	total	12.6	10.7	10.9	17.2	16.0	14.8	20.6	19.2	17.7
35/24	0.4	9.5	total	8.5	8.1	7.7	12.1	11.6	11.1	15.1	14.5	14.0
			sensible	10.0	9.7	9.3	14.3	13.9	13.4	17.9	17.4	16.9
	0.6	19.6	total	15.1	14.3	13.4	20.6	19.4	18.2	24.6	23.1	21.8
35/24	0.4	9.5	total	10.3	10.0	9.7	14.1	13.7	13.4	17.2	16.9	16.6
			sensible	11.0	10.7	10.3	15.3	14.9	14.4	18.8	18.4	17.9
	0.8	33.5	total	19.3	18.4	17.5	26.1	24.9	23.6	30.9	29.4	27.8
1 row hot water coil	0.4	9.5	total	11.4	11.0	10.7	16.2	15.7	15.2	20.0	19.5	18.9
			sensible	10.0	9.7	9.3	14.3	13.9	13.4	17.9	17.4	16.9
	0.8	33.5	total	15.1	14.3	13.4	20.6	19.4	18.2	24.6	23.1	21.8

1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
7	0.08	8.4	heat	7.8	10.5	13.2	9.2	12.4	15.6	10.1	13.6	17.1
	0.12	17.3	heat	8.7	11.7	14.7	10.8	14.5	18.3	12.2	16.4	20.7
	0.16	28.8	heat	9.3	12.6	15.8	11.8	16.0	20.1	13.6	18.3	23.0
15	0.08	8.4	heat	6.3	9.0	11.7	7.4	10.6	13.9	8.2	11.7	15.2
	0.12	17.3	heat	7.1	10.1	13.1	8.7	12.5	16.2	9.9	14.1	18.3
	0.16	28.8	heat	7.7	10.8	14.0	9.6	13.7	17.8	11.0	15.7	20.4
21	0.08	8.4	heat	5.2	7.9	10.6	6.2	9.4	12.5	6.8	10.3	13.8
	0.12	17.3	heat	5.8	8.8	11.8	7.2	11.0	14.7	8.2	12.4	16.6
	0.16	28.8	heat	6.4	9.5	12.7	8.2	12.0	16.1	9.1	13.8	18.5


Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

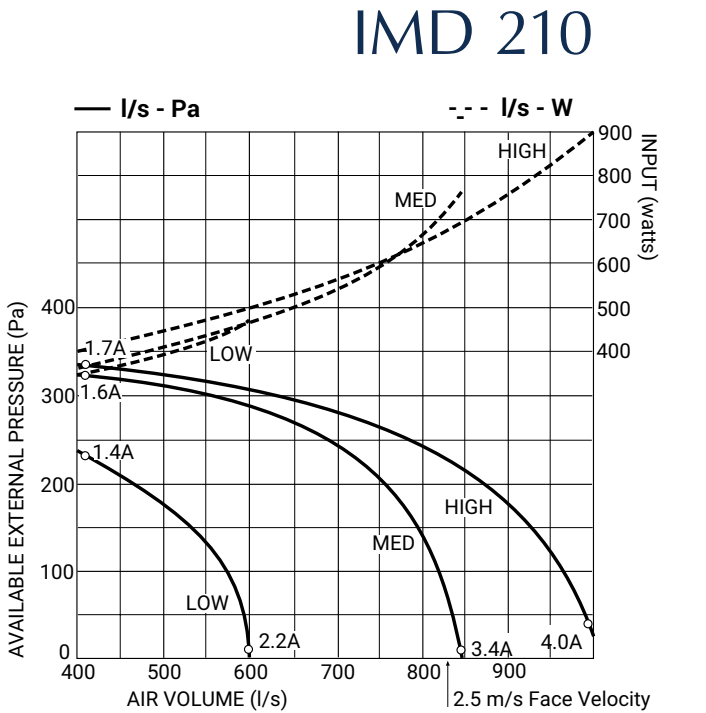

Dimensions

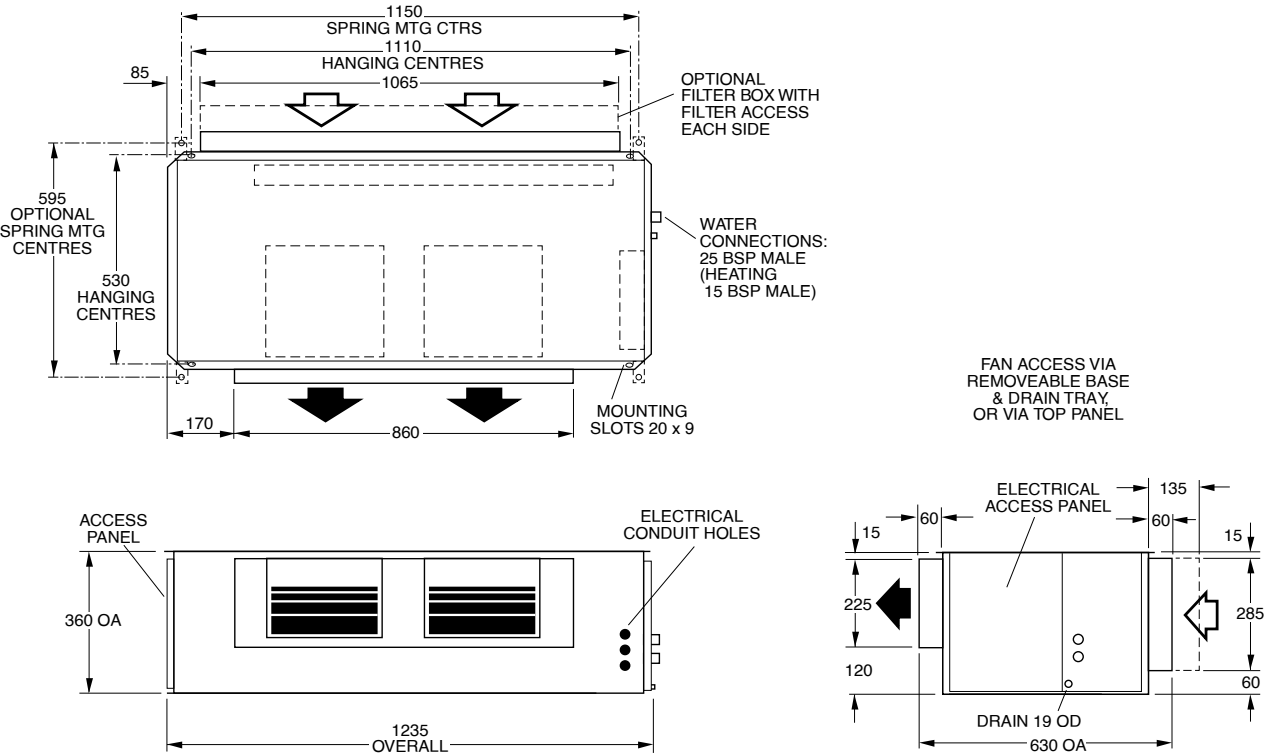

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	51	54	54	51	41	34	31
Med	57	61	62	56	50	42	41
High	61	64	65	59	55	46	45

IMD 280


				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				600 L/s			900 L/s			1200 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.6	7.0	total	12.8	11.7	10.7	15.5	14.2	13.0	17.4	16.0	14.6
			sensible	9.1	8.6	8.2	11.9	11.3	10.8	14.2	13.7	13.1
	1.0	17.8	total	14.5	13.2	12.0	18.3	16.8	15.3	21.2	19.5	17.7
27/19	0.6	7.0	total	15.7	14.6	13.5	19.0	17.7	16.4	21.2	19.8	18.4
			sensible	11.2	10.8	10.3	14.7	14.2	13.7	17.7	17.2	16.6
	1.0	17.8	total	17.7	16.5	15.3	22.4	20.9	19.3	26.0	24.2	22.4
31/21	0.6	7.0	total	18.8	17.7	16.6	22.7	21.3	20.0	25.4	23.9	22.4
			sensible	13.4	12.9	12.5	17.5	17.0	16.5	21.1	20.6	20.0
	1.0	17.8	total	21.2	20.0	18.7	26.9	25.3	23.7	31.1	29.3	27.5
35/24	0.6	7.0	total	23.7	22.5	21.4	28.3	26.9	25.5	31.4	29.8	28.3
			sensible	15.0	14.5	14.1	19.4	19.0	18.5	23.3	22.8	22.3
	1.0	17.8	total	26.9	25.7	24.3	33.9	32.2	30.6	38.9	37.0	35.0
1 row hot water coil	0.6	7.0	total	16.3	15.7	15.2	21.5	20.9	20.2	25.9	25.2	24.5
			sensible	17.0	16.5	15.9	22.7	22.1	21.4	26.6	26.9	26.1
	1.4	33.1	total	28.7	27.4	26.1	37.2	35.6	33.7	43.8	41.7	39.5
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.2	2.8	heat	12.5	16.9	21.2	14.8	20.0	25.2	16.6	22.4	28.2
	0.4	9.6	heat	14.1	19.0	23.9	17.5	23.6	29.7	20.1	27.1	34.1
	0.6	20.2	heat	15.0	20.2	25.4	18.9	25.6	32.2	22.1	29.8	37.5
15	0.2	2.8	heat	9.9	15.1	18.5	11.8	16.9	22.0	13.3	18.9	24.6
	0.4	9.6	heat	12.2	17.0	20.8	13.9	19.9	25.9	16.0	22.9	29.8
	0.6	20.2	heat	13.0	18.1	22.1	15.1	21.5	28.0	17.6	25.2	32.7
21	0.2	2.8	heat	8.2	12.5	16.8	9.8	14.9	19.9	10.9	16.6	22.3
	0.4	9.6	heat	9.3	14.0	18.8	11.5	17.5	23.4	13.2	20.1	26.9
	0.6	20.2	heat	9.8	14.9	20.0	12.5	18.9	25.3	14.5	22.1	29.6

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

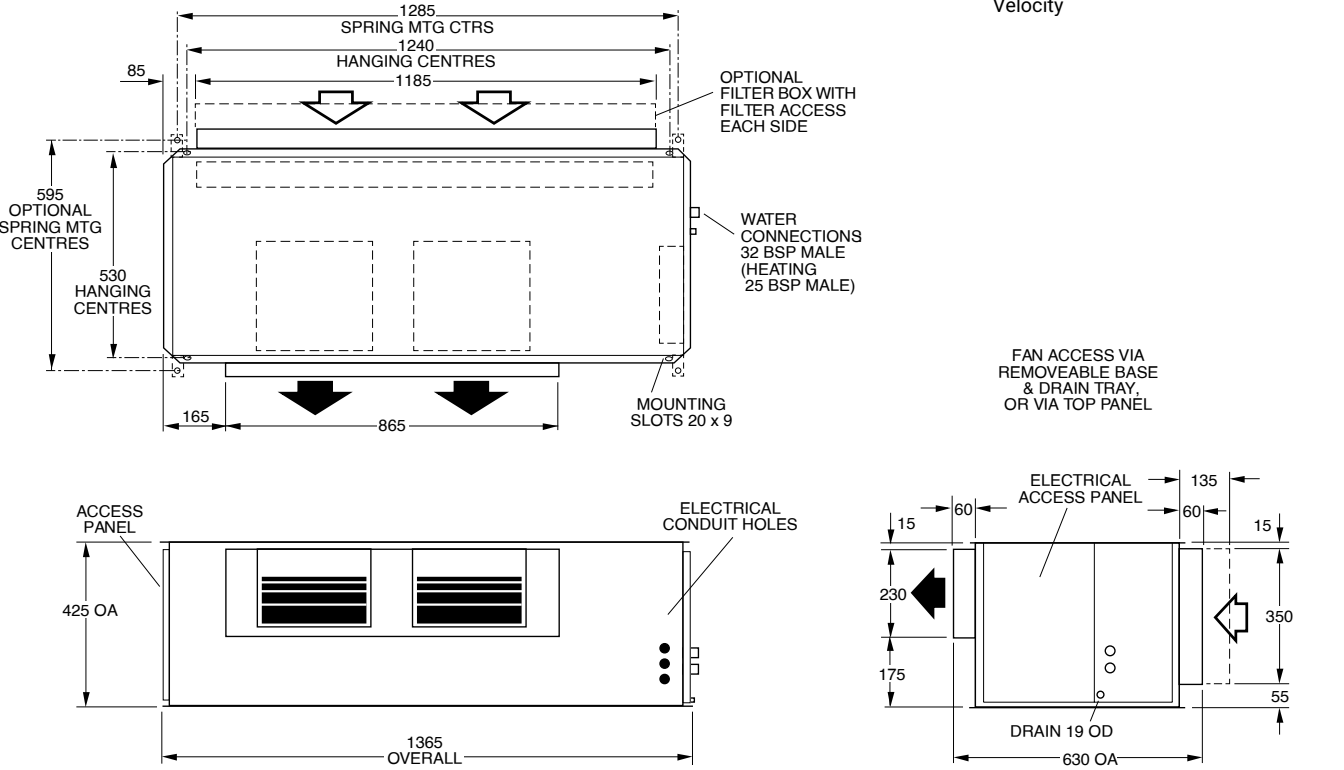

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMD 280

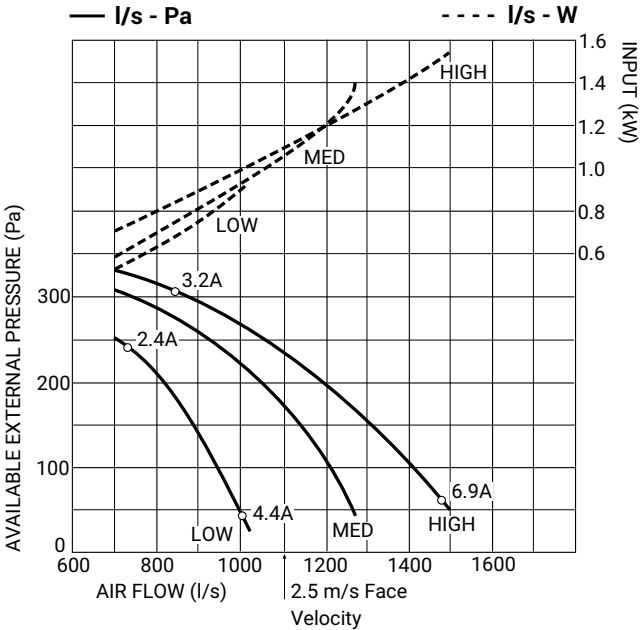


IMD 420				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				1000 L/s			1400 L/s			1800 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	1.0	3.9	total	20.4	18.8	17.1	23.9	21.9	19.9	26.4	24.4	22.2
			sensible	14.7	14.0	13.3	18.3	17.5	16.7	21.5	20.7	19.8
	2.0	13.9	total	23.8	21.9	19.9	29.2	26.8	24.4	33.6	31.1	28.2
			sensible	16.2	15.4	14.5	20.6	19.6	18.6	24.5	23.4	22.2
	3.0	29.8	total	25.3	23.3	21.2	32.0	29.3	26.7	37.4	34.5	31.2
			sensible	16.9	16.0	15.1	21.8	20.7	19.5	26.1	24.8	23.4
27/19	1.0	3.9	total	25.0	23.3	21.6	29.1	27.2	25.2	32.1	30.2	27.9
			sensible	18.2	17.5	16.8	22.8	22.0	21.2	26.7	26.0	25.1
	2.0	13.9	total	29.3	27.3	25.3	35.8	33.4	30.9	41.6	38.6	35.6
			sensible	20.0	19.2	18.3	25.5	24.5	23.5	30.5	29.3	28.1
	3.0	29.8	total	31.2	29.1	27.0	39.4	36.7	34.0	46.2	43.1	40.1
			sensible	20.9	20.0	19.1	27.0	25.9	24.7	32.4	31.1	29.9
31/21	1.0	3.9	total	29.9	28.2	26.5	34.8	32.8	30.7	38.6	36.0	34.0
			sensible	21.6	20.9	20.3	27.1	26.3	25.6	32.0	31.0	30.3
	2.0	13.9	total	35.1	33.1	31.0	43.0	40.5	38.0	49.5	46.4	43.7
			sensible	23.8	23.0	22.1	30.3	29.3	28.3	36.1	34.9	33.9
	3.0	29.8	total	37.5	35.3	33.2	47.3	44.6	41.8	55.3	52.3	49.2
			sensible	24.9	23.9	23.0	32.2	31.0	29.8	38.4	37.2	36.0
35/24	1.0	3.9	total	37.7	35.9	34.0	43.4	41.3	39.1	47.4	45.1	42.8
			sensible	24.2	23.5	22.9	30.0	29.3	28.6	35.1	34.4	33.6
	2.0	13.9	total	44.6	42.5	40.6	54.5	51.8	49.2	62.1	59.0	56.0
			sensible	27.0	26.1	25.3	34.1	33.1	32.1	40.2	39.1	38.0
	3.0	29.8	total	48.1	45.9	43.6	60.1	57.3	54.4	70.2	66.7	63.2
			sensible	28.4	27.5	26.5	36.3	35.2	34.0	43.2	41.9	40.7
1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.3	3.9	heat	20.0	27.0	34.0	23.1	31.1	39.2	25.4	34.3	43.2
	0.6	12.2	heat	22.9	30.9	38.9	27.5	37.1	46.7	31.0	41.8	52.6
	0.9	27.4	heat	24.5	33.0	41.5	29.8	40.3	50.7	34.1	46.0	57.9
15	0.3	3.9	heat	16.2	23.2	30.1	18.7	26.7	34.8	20.7	29.5	38.4
	0.6	12.2	heat	18.5	26.5	34.4	22.3	31.8	41.4	25.1	35.9	46.6
	0.9	27.4	heat	19.8	28.3	36.8	24.2	34.5	44.9	27.6	39.5	51.3
21	0.3	3.9	heat	13.4	20.3	27.3	15.5	23.5	31.5	17.0	25.9	34.7
	0.6	12.2	heat	15.3	23.2	31.1	18.4	27.9	37.4	20.7	31.5	42.2
	0.9	27.4	heat	16.3	24.8	33.2	19.9	30.2	40.5	22.8	34.6	46.4


Performance Data

Air Handling

- Notes:**
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

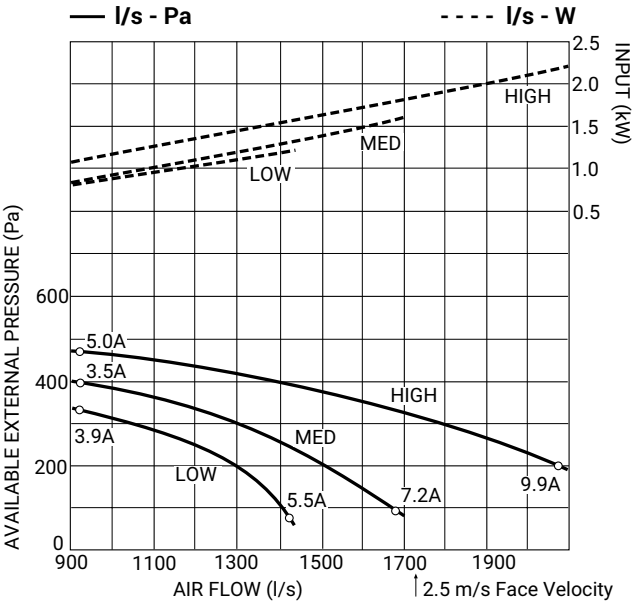

Dimensions

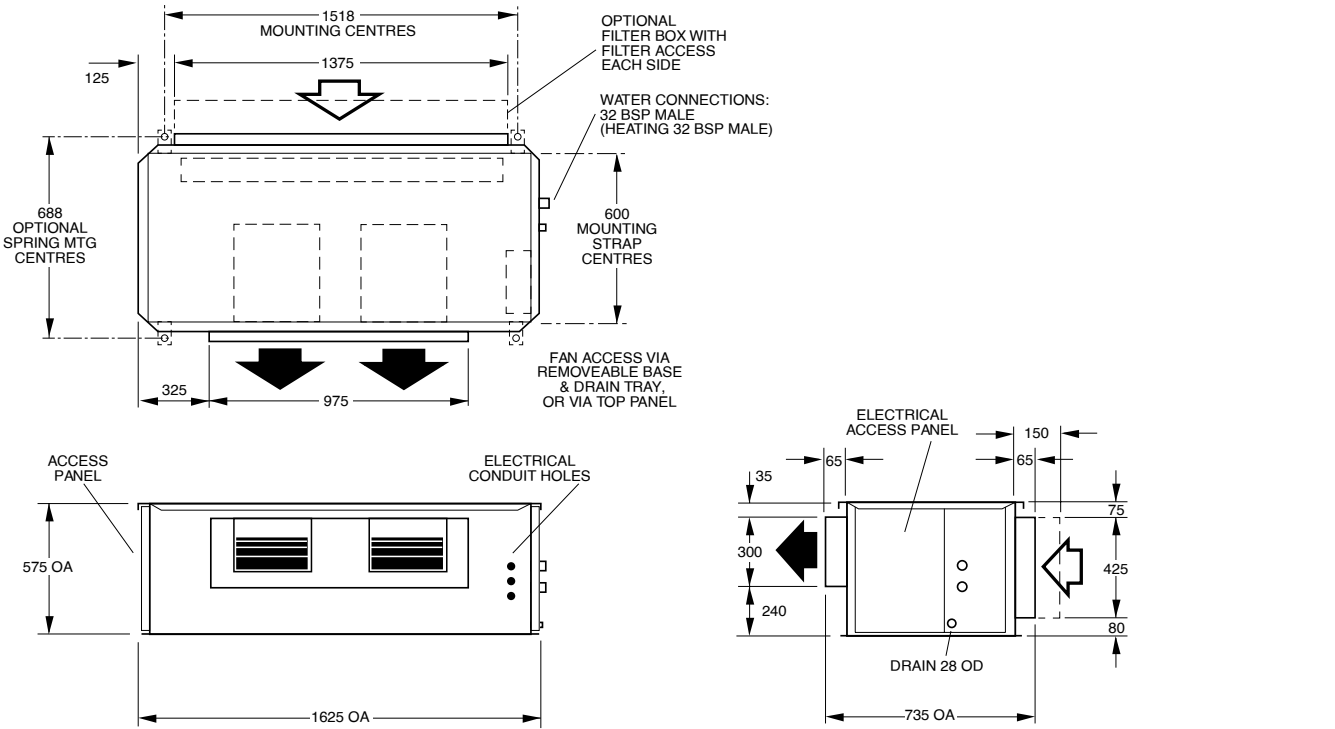

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com


Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	53	58	56	52	45	39	35
Med	58	63	61	57	49	44	41
High	65	69	68	64	56	51	49

IMD 550				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				1300 L/s			1800 L/s			2350 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	2.0	9.5	total	29.5	27.1	24.6	35.2	32.5	29.3	40.5	37.2	33.8
			sensible	20.4	19.3	18.3	25.5	24.3	23.1	30.5	29.1	27.7
	3.0	20.6	total	31.7	29.3	26.6	39.3	36.1	32.8	46.1	42.3	38.5
			sensible	21.4	20.3	19.2	27.3	25.9	24.5	32.9	31.2	29.6
	4.0	32.8	total	33.2	30.5	27.8	41.6	38.2	34.7	49.5	45.2	41.4
			sensible	22.1	20.9	19.7	28.3	26.8	25.3	34.3	32.5	30.8
27/19	2.0	9.5	total	36.2	33.7	31.2	43.5	40.5	37.4	49.5	46.1	43.0
			sensible	25.2	24.2	23.1	31.7	30.5	29.2	37.8	36.4	35.2
	3.0	20.6	total	39.2	36.6	33.9	48.2	45.0	41.6	56.7	52.8	48.8
			sensible	26.6	25.4	24.3	33.7	32.3	31.0	40.7	39.1	37.5
	4.0	32.8	total	40.8	38.1	35.3	51.1	47.8	44.1	60.6	56.2	52.3
			sensible	27.3	26.1	24.9	35.0	33.5	32.0	42.3	40.5	38.9
31/21	2.0	9.5	total	43.3	40.9	38.3	52.0	49.0	45.9	59.5	56.0	52.1
			sensible	30.0	28.9	27.9	37.6	36.5	35.3	45.1	43.7	42.3
	3.0	20.6	total	47.1	44.4	41.7	57.9	54.4	51.1	67.7	63.6	59.6
			sensible	31.6	30.4	29.2	40.1	38.7	37.3	48.2	46.7	45.1
	4.0	32.8	total	49.1	46.3	43.5	61.6	58.1	54.5	73.1	68.6	64.5
			sensible	32.5	31.2	30.0	41.6	40.1	38.7	50.4	48.6	47.0
35/24	2.0	9.5	total	55.1	52.6	49.9	65.5	62.3	59.0	74.1	70.4	66.7
			sensible	33.9	32.8	31.8	42.1	40.9	39.8	50.0	48.7	47.5
	3.0	20.6	total	60.0	57.2	54.3	73.6	70.1	66.5	85.3	81.2	76.9
			sensible	35.8	34.7	33.5	45.2	43.8	42.5	54.1	52.5	51.0
	4.0	32.8	total	62.7	60.0	57.0	78.5	74.7	70.9	92.5	88.0	83.5
			sensible	37.0	35.9	34.6	47.1	45.7	44.2	56.8	55.1	53.4
1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.4	4.5	heat	26.2	34.1	44.5	30.1	40.6	51.1	33.4	45.1	56.8
	0.8	15.4	heat	30.0	39.0	50.9	35.8	48.3	60.8	40.7	54.9	69.1
	1.2	31.5	heat	32.0	41.7	54.3	38.7	52.2	65.7	44.8	60.4	76.1
15	0.4	4.5	heat	21.2	30.4	39.4	24.4	34.9	45.4	27.2	38.8	50.4
	0.8	15.4	heat	24.3	34.6	45.1	29.0	41.4	53.9	33.0	47.1	61.3
	1.2	31.5	heat	25.9	37.0	48.1	31.5	45.0	58.5	36.3	51.9	67.4
21	0.4	4.5	heat	17.5	26.6	35.7	20.2	30.6	41.1	22.5	34.0	45.6
	0.8	15.4	heat	20.0	30.4	40.7	24.0	36.3	48.7	27.2	41.3	55.4
	1.2	31.5	heat	21.4	32.4	43.5	26.0	39.4	52.8	30.0	45.4	60.9


Performance DataIMD 550

Air Handling

- Notes:**
- Air flows given are for a unit with no filter installed.
 - In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

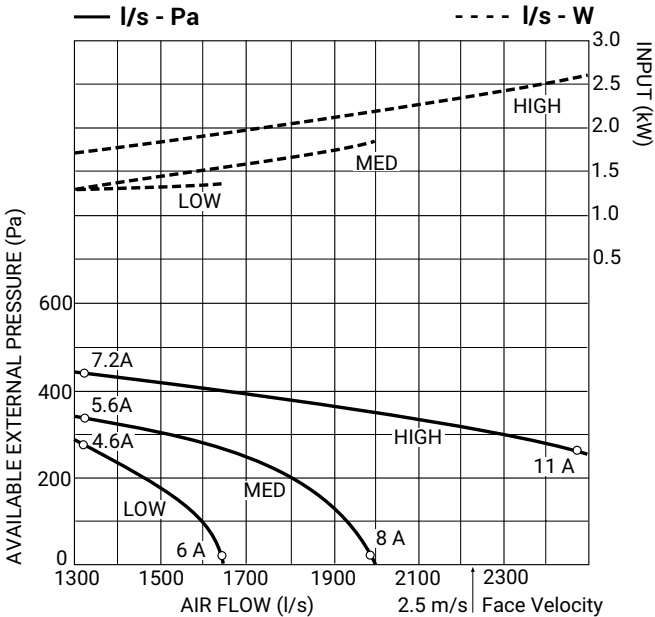

Dimensions

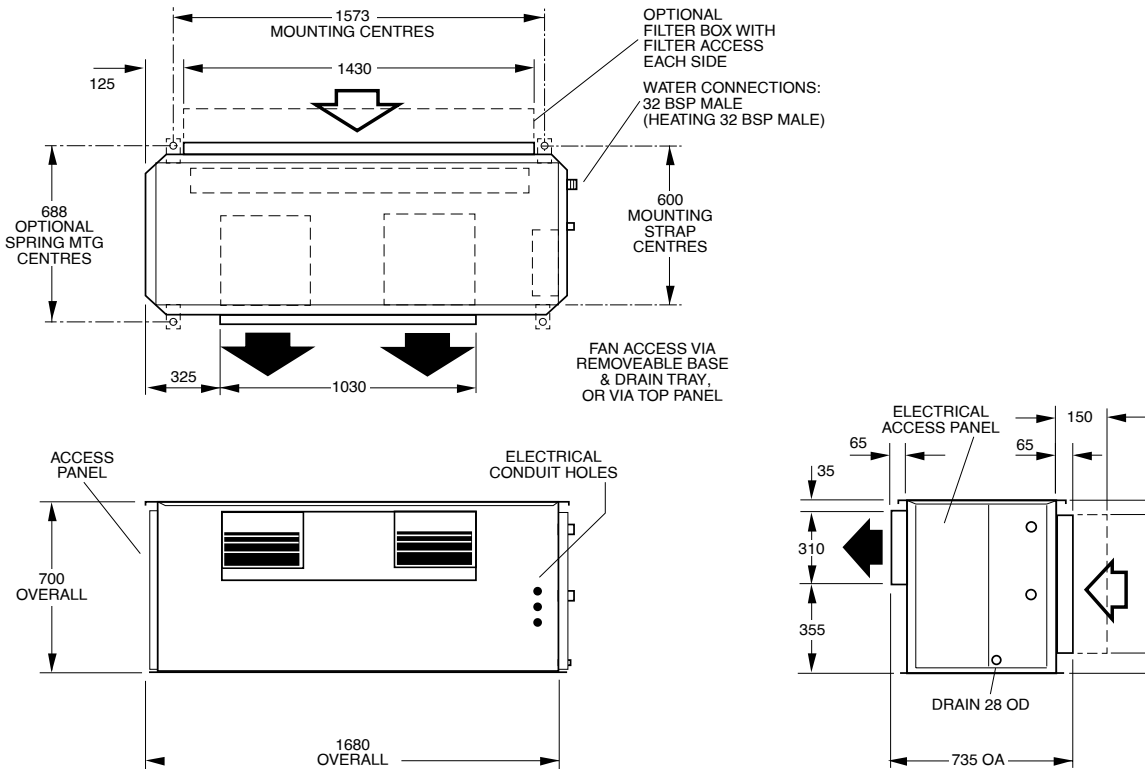


Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
Low	57	61	61	57	49	41	39
Med	61	65	65	61	53	46	44
High	66	69	70	66	58	51	49

Premium IMD-Y Range
(Compact FCU)





High Efficiency EC Motor



Electric Heating



Opposite Hand

Premium Range (IMD-Y)
Specifications

Model	IMD 95Y	IMD 135Y	IMD 170Y	IMD 210	IMD 280Y	IMD 420Y	IMD 550Y
Features							
Nominal Air Flow (l/s) *1	450	600	750	900	1250	1800	2350
Fan Type	Forward Curved Centrifugal Double Inlet Double Width						
Number of Fan Scrolls	1	1	1	2	2	2	2
Motor Type	Electronically Commutated (EC) DC Direct Drive						
Power Source *2	1 Phase 230 Volt AC 50 Hz						
Number of Motors	1	1	1	1	1	2	2
Motor Rating (W)	600	900	1250	1250	1250	1250 (x2)	1250 (x2)
Full Load Amps (A) *2	3.3	4.9	6.8	6.8	6.8	9 x 2 (18)	9 x 2 (18)
Optional Electric Heating (kW)*3	4	6	6	9	9	12	18
Electric Heat Current (A/ph)	17.6/1ph	8.8/3ph	8.8/3ph	13.2/3ph	13.2/3ph	17.6/3ph	26.4/3ph
Heat Exchanger Type	Epoxy Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tube						
Finish	Zinc Galvanised Steel						
Test Pressure	2100 kPa						
Cooling/Heating Medium	Chilled Water or Hot Water						
Connection Sizes Cooling Coil (mm)	Ø 25 (1" BSP)	Ø 25 (1" BSP)	Ø 25 (1" BSP)	Ø 25 (1" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)
Connection Sizes Heating Coil (mm)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 15 (½" BSP)	Ø 25 (1" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)
Filters							
Optional Air Filter Type	G2 / EU2 Washable						
Number of Optional Air Filters	1	1	1	1	2	2	2
Optional Air Filter Size (mm)	593x275x13	767x275x13	914x275x13	1064x275x13	593x345x13	685x415x13	712x542x13
Weight							
Weight (4/1) Incl. Water (kg)	54	61	65	76	99	158	183
Nett Dry Weight (kg)	49	55	58	68	88	145	166
Shipping Weight (kg)	55	61	65	76	96	170	196
Notes:							
*1 With no filters fitted and with a dry coil surface							
*2 Voltage range 220–240V fan motor only excluding electric heat							
*3 Optional Electric Heating - models IMD135 through IMD550 require a 3 phase AC power supply, 342-436V 50Hz. Complete with high temperature safety cutout thermostats required to meet AS/NZS 3350.2.40 2019							
Cooling and Heating Coil options: 4 Row Cooling only 4 Row Cooling + 1 Row Heating 4 Row Cooling plus Electric Heating							

IMD 95Y


				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				250 L/s			350 L/s			450 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	7.0	total	5.4	5.0	4.5	6.4	5.9	5.4	7.2	6.7	6.1
			sensible	3.8	3.6	3.4	4.8	4.6	4.3	5.6	5.4	5.2
	0.5	17.6	total	6.0	5.5	5.0	7.4	6.8	6.1	8.5	7.9	7.1
			sensible	4.1	3.9	3.7	5.2	5.0	4.7	6.2	5.9	5.6
			total	6.4	5.8	5.3	8.0	7.3	6.7	9.3	8.6	7.8
	0.7	32.4	sensible	4.3	4.0	3.8	5.5	5.2	4.9	6.5	6.2	5.9
27/19	0.3	7.0	total	6.6	6.2	5.7	7.9	7.4	6.8	8.8	8.2	7.6
			sensible	4.7	4.5	4.3	5.9	5.7	5.5	7.0	6.8	6.6
	0.5	17.6	total	7.4	6.9	6.4	9.1	8.5	7.9	10.6	9.8	9.0
			sensible	5.1	4.8	4.6	6.5	6.2	5.9	7.7	7.4	7.1
			total	7.8	7.3	6.8	9.8	9.2	8.5	11.5	10.7	10.0
	0.7	32.4	sensible	5.2	5.0	4.8	6.8	6.5	6.2	8.1	7.8	7.5
31/21	0.3	7.0	total	8.0	7.5	7.1	9.4	8.9	8.3	10.5	9.9	8.3
			sensible	5.6	5.4	5.3	7.1	6.9	6.6	8.3	8.1	7.9
	0.5	17.6	total	8.9	8.4	7.9	10.9	10.3	9.6	12.5	11.8	11.1
			sensible	6.0	5.8	5.6	7.7	7.4	7.1	9.1	8.8	8.6
			total	9.4	8.9	8.3	11.8	11.1	10.4	13.8	13.0	12.2
	0.7	32.4	sensible	6.2	6.0	5.8	8.0	7.8	7.5	9.6	9.3	9.0
35/24	0.3	7.0	total	10.1	9.6	9.1	11.8	11.2	10.6	13.1	12.4	11.7
			sensible	6.3	6.1	5.9	7.9	7.7	7.5	9.2	9.0	8.8
	0.5	17.6	total	11.3	10.8	10.2	13.9	13.2	12.5	15.8	15.0	14.2
			sensible	6.8	6.6	6.4	8.6	8.4	8.1	10.2	9.9	9.6
			total	12.0	11.5	10.9	15.0	14.3	13.6	17.5	16.6	15.7
	0.7	32.4	sensible	7.1	6.9	6.6	9.1	8.8	8.5	10.8	10.5	10.2
1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.04	1.6	heat	4.2	5.7	7.2	4.7	6.4	7.9	5.0	6.8	8.5
	0.12	10.4	heat	5.6	7.5	9.5	6.6	9.0	11.3	7.5	10.0	12.7
	0.2	25.7	heat	6.1	8.2	10.4	7.4	10.0	12.6	8.4	11.4	14.3
15	0.04	1.6	heat	3.4	4.9	6.4	3.8	5.4	7.1	4.1	5.8	7.6
	0.12	10.4	heat	4.5	6.5	8.4	5.4	7.7	10.0	6.0	8.6	11.2
	0.2	25.7	heat	4.9	7.1	9.2	6.0	8.6	11.1	6.8	9.8	12.7
21	0.04	1.6	heat	2.8	4.3	5.8	3.2	4.8	6.4	3.4	5.1	6.9
	0.12	10.4	heat	3.7	5.7	7.6	4.4	6.7	9.0	5.0	7.6	10.1
	0.2	25.7	heat	4.1	6.2	8.3	5.0	7.5	10.1	5.7	8.6	11.5

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

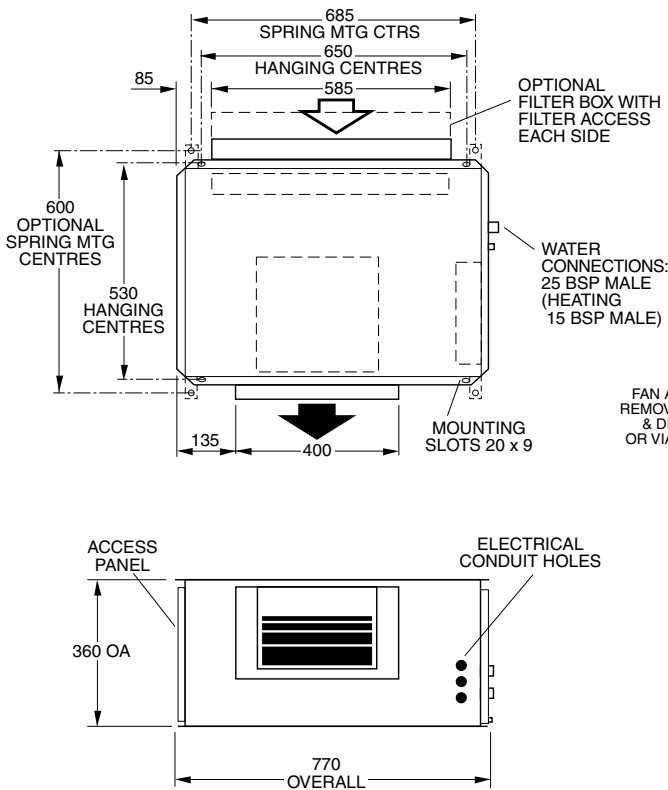

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

IMD 95Y

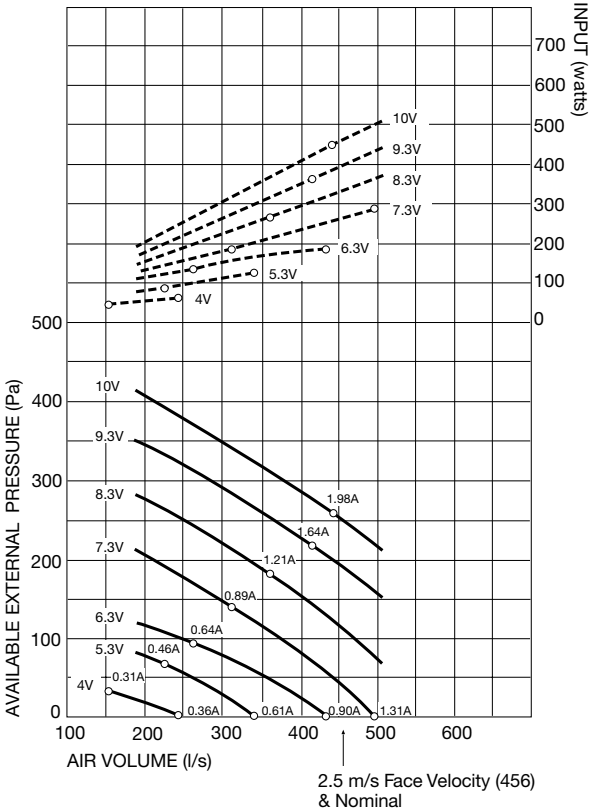

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	7.3	1100	48	56	51	45	40	34	33
Med	8.3	1250	52	59	57	49	45	39	39
High	9.3	1400	58	66	63	53	49	45	44

IMD 135Y

				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				300 L/s			450 L/s			600 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.2	4.0	total	5.8	5.3	4.9	6.8	6.3	5.7	7.5	6.8	6.3
			sensible	4.3	4.1	3.9	5.6	5.3	5.1	6.6	6.4	6.2
	0.4	13.9	total	7.0	6.4	5.8	8.7	8.0	7.3	10.1	9.2	8.4
27/19	0.2	4.0	sensible	4.8	4.6	4.3	6.4	6.0	5.7	7.7	7.3	7.0
			total	7.5	6.9	6.3	9.8	9.0	8.2	11.5	10.6	9.6
	0.6	28.9	sensible	5.1	4.8	4.5	6.8	6.5	6.1	8.3	7.9	7.5
31/21	0.2	4.0	total	7.1	6.6	6.2	8.3	7.7	7.2	9.0	8.4	7.9
			sensible	5.3	5.1	4.9	6.9	6.7	6.5	8.3	8.1	7.9
	0.4	13.9	total	8.6	8.0	7.4	10.7	10.0	9.2	12.3	11.4	10.6
35/24	0.2	4.0	sensible	5.9	5.7	5.5	7.9	7.6	7.3	9.5	9.2	8.9
			total	9.3	8.6	8.0	12.0	11.2	10.4	14.1	13.2	12.2
	0.6	28.9	sensible	6.3	6.0	5.7	8.4	8.1	7.7	10.3	9.9	9.5
31/21	0.2	4.0	total	8.5	8.0	7.5	9.8	9.3	8.7	10.7	10.1	9.5
			sensible	6.3	6.1	5.9	8.2	8.0	7.8	9.9	9.7	9.5
	0.4	13.9	total	10.3	9.7	9.1	12.8	12.1	11.3	14.7	13.8	12.9
35/24	0.2	4.0	sensible	7.1	6.8	6.6	9.4	9.1	8.8	11.4	11.0	10.7
			total	11.1	10.5	9.8	14.4	13.5	12.7	16.9	15.9	14.9
	0.6	28.9	sensible	7.4	7.1	6.9	10.0	9.7	9.3	12.2	11.8	11.4
35/24	0.2	4.0	total	10.6	10.1	9.6	12.1	11.6	11.0	13.1	12.5	11.9
			sensible	7.0	6.9	6.7	9.1	8.9	8.7	10.9	10.7	10.5
	0.4	13.9	total	13.0	12.5	11.8	16.1	15.3	14.5	18.2	17.3	16.4
35/24	0.2	4.0	sensible	8.0	7.7	7.5	10.5	10.2	9.9	12.5	12.2	11.9
			total	14.2	13.6	12.9	18.3	17.4	16.5	21.3	20.2	19.2
	0.6	28.9	sensible	8.5	8.2	7.9	11.3	10.9	10.6	13.6	13.3	12.9




1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.04	2.0	heat	4.9	6.6	8.2	5.4	7.3	9.1	5.8	7.8	9.8
	0.12	13.5	heat	6.7	9.1	11.4	8.2	11.1	14.0	9.3	12.5	15.8
	0.2	33.3	heat	7.4	10.0	12.6	9.3	12.6	15.9	10.8	14.5	18.3
15	0.04	2.0	heat	4.0	5.7	7.3	4.4	6.3	8.2	4.7	6.7	8.7
	0.12	13.5	heat	5.5	7.8	10.1	6.7	9.5	12.4	7.6	10.8	14.0
	0.2	33.3	heat	6.0	8.6	11.2	7.54	10.8	14.0	8.7	12.5	16.2
21	0.04	2.0	heat	3.3	5.0	6.6	3.6	5.5	7.4	3.9	5.9	7.8
	0.12	13.5	heat	4.5	6.8	9.2	5.5	8.4	11.2	6.2	9.5	12.7
	0.2	33.3	heat	5.0	7.5	10.1	6.2	9.4	12.7	7.2	10.9	14.7

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

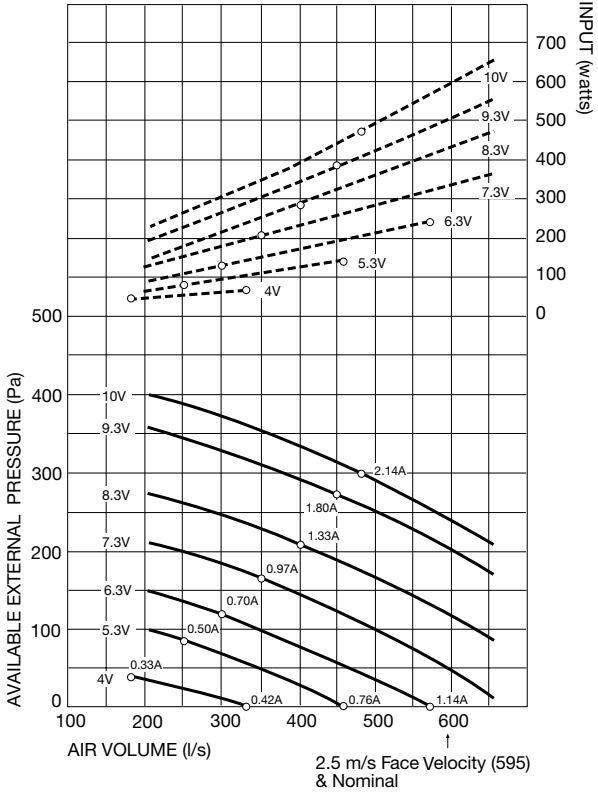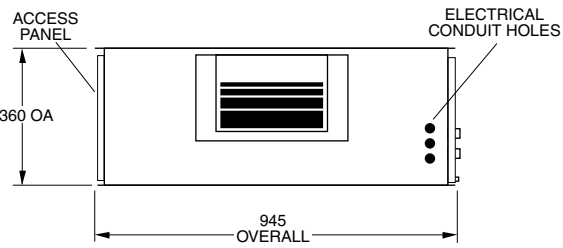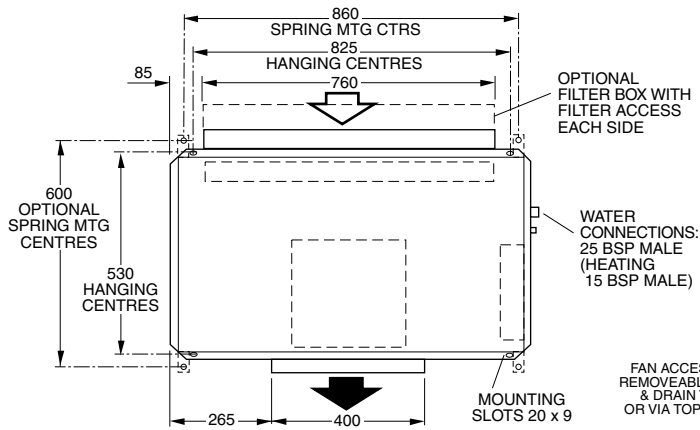

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	7.3	1100	44	53	49	39	34	30	29
Med	8.3	1250	47	56	52	44	38	34	33
High	9.3	1400	52	59	57	49	43	39	39


IMD 170Y				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				350 L/s			550 L/s			750 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.3	9.3	total	7.5	6.9	6.3	9.2	8.5	7.7	10.3	9.5	8.8
			sensible	5.3	5.1	4.8	7.2	6.8	6.5	8.7	8.4	8.0
	0.45	19.4	total	8.3	7.6	6.9	10.6	9.7	8.9	12.3	11.3	10.3
27/19	0.3	9.3	sensible	5.7	5.4	5.1	7.7	7.4	7.0	9.5	9.1	8.6
			total	8.8	8.0	7.3	11.6	10.6	9.7	13.8	12.6	11.5
	0.6	33.4	sensible	5.9	5.6	5.2	8.2	7.8	7.4	10.1	9.6	9.2
31/21	0.3	9.3	total	9.2	8.6	8.0	11.2	10.5	9.7	12.6	11.8	11.0
			sensible	6.6	6.3	6.1	8.9	8.6	8.3	10.8	10.5	10.2
	0.45	19.4	total	10.2	9.5	8.8	13.1	12.2	11.3	15.1	14.0	13.0
35/24	0.3	9.3	sensible	7.0	6.7	6.4	9.6	9.3	8.9	11.8	11.4	11.0
			total	10.8	10.0	9.3	14.2	13.3	12.3	16.9	15.7	14.6
	0.6	33.4	sensible	7.3	7.0	6.6	10.1	9.7	9.3	12.5	12.0	11.6
35/24	0.3	9.3	total	11.0	10.4	9.8	13.4	12.7	11.9	15.0	14.1	13.3
			sensible	7.8	7.6	7.3	10.6	10.3	10.0	12.9	12.6	12.3
	0.45	19.4	total	12.2	11.5	10.8	15.6	14.7	13.8	18.0	16.9	15.9
35/24	0.3	9.3	sensible	8.3	8.0	7.8	11.4	11.1	10.7	14.0	13.6	13.2
			total	12.9	12.2	11.4	17.0	16.0	15.0	20.2	18.9	17.8
	0.6	33.4	sensible	8.6	8.3	8.0	12.0	11.6	11.2	14.8	14.4	13.9
1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
				50	65	80	50	65	80	50	65	80
7	0.06	4.5	heat	6.4	8.6	10.8	7.3	9.9	12.4	8.0	10.7	13.4
	0.12	13.4	heat	7.8	10.5	13.2	9.5	12.9	16.2	10.8	14.6	18.3
	0.18	31.4	heat	8.5	11.4	14.6	10.7	14.4	18.2	12.4	16.7	21.0
15	0.06	4.5	heat	5.2	7.4	9.6	5.9	8.5	11.0	6.4	9.2	11.9
	0.12	15.4	heat	6.3	9.0	11.7	7.7	11.1	14.4	8.8	12.5	16.3
	0.18	31.4	heat	7.0	9.8	12.7	8.7	12.4	16.1	10.0	14.4	18.7
21	0.06	4.5	heat	4.3	6.4	8.7	4.9	7.4	10.0	5.3	8.1	10.9
	0.12	15.4	heat	5.2	7.9	10.5	6.4	9.7	13.0	7.3	11.0	14.8
	0.18	31.4	heat	5.6	8.6	11.5	7.2	10.9	14.6	8.3	12.6	16.9

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

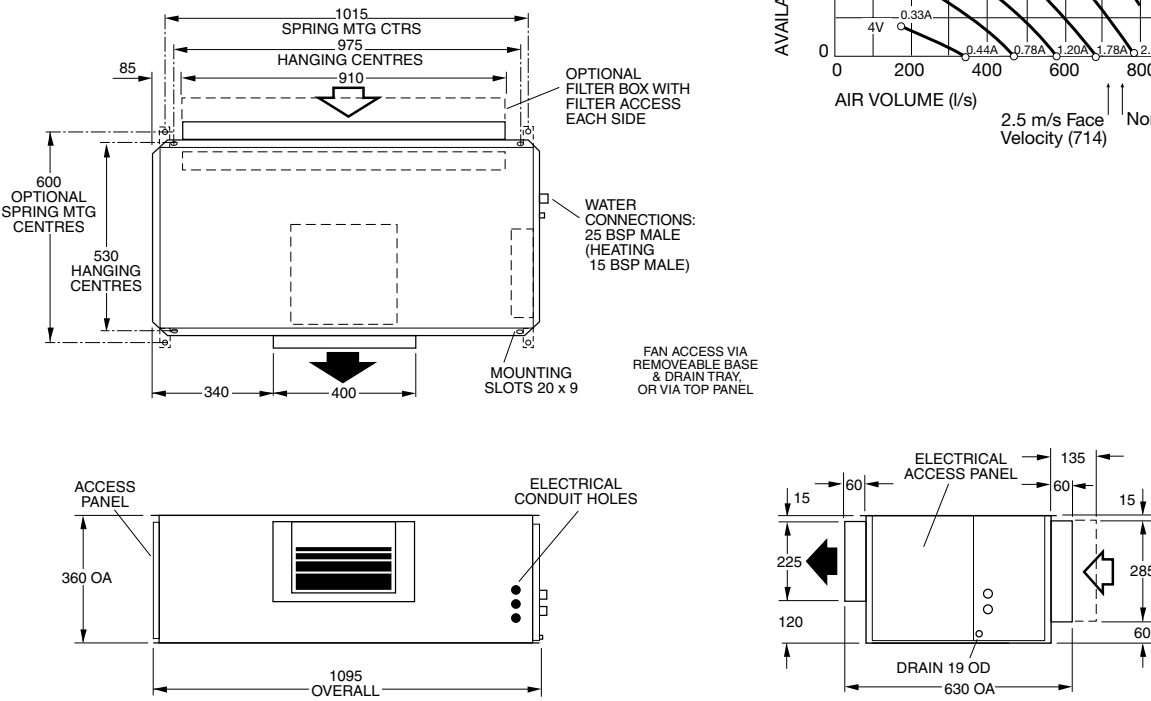


Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	6.3	950	44	47	45	43	37	31	30
Med	8.3	1250	53	55	55	52	45	40	40
High	10	1500	62	63	65	59	57	50	50

IMD 170Y

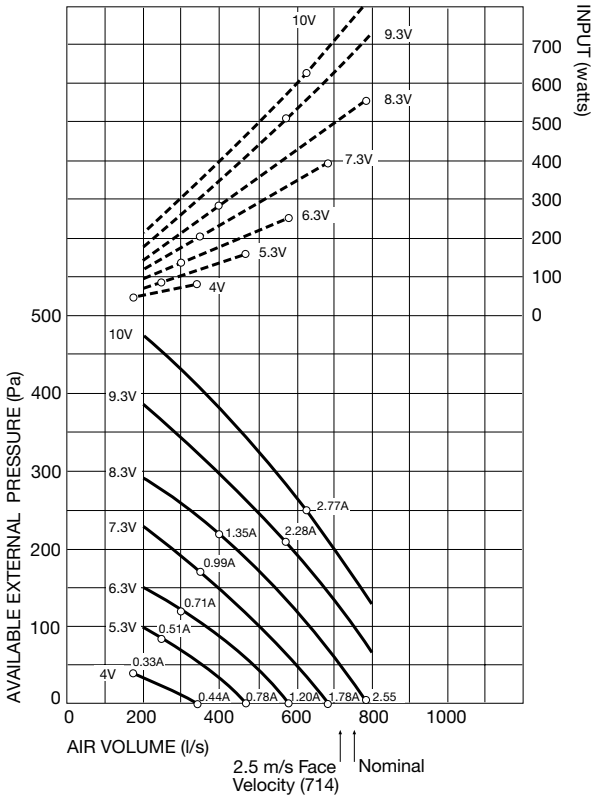

IMD 210Y


4 row chilled water coil				Low Air flow			Medium Air flow			Nominal Air flow		
				400 L/s			650 L/s			900 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	0.4	9.5	total	8.9	8.2	7.5	11.3	10.3	9.4	12.8	11.8	10.7
			sensible	6.2	5.9	5.6	8.6	8.2	7.8	10.6	10.1	9.7
	0.6	19.6	total	9.7	8.9	8.1	12.9	11.8	10.8	15.2	13.9	12.7
27/19	0.4	9.5	sensible	6.6	6.2	5.9	9.3	8.8	8.4	11.5	11.0	10.5
			total	10.2	9.4	8.6	14.0	12.8	11.7	16.8	15.4	14.0
	0.8	33.5	sensible	6.8	6.5	6.1	9.8	9.3	8.8	12.2	11.6	11.0
31/21	0.4	9.5	total	10.9	10.2	9.4	13.8	12.9	11.9	15.6	14.7	13.6
			sensible	7.7	7.4	7.1	10.7	10.3	9.9	13.1	12.8	12.4
	0.6	19.6	total	11.9	11.1	10.4	15.8	14.8	13.7	18.6	17.3	16.1
35/24	0.4	9.5	sensible	8.2	7.8	7.5	11.5	11.1	10.6	14.3	13.8	13.3
			total	12.6	10.7	10.9	17.2	16.0	14.8	20.6	19.2	17.7
	0.8	33.5	sensible	8.5	8.1	7.7	12.1	11.6	11.1	15.1	14.5	14.0
31/21	0.4	9.5	total	13.1	12.3	11.6	16.4	15.5	14.5	18.6	17.6	16.4
			sensible	9.2	8.9	8.5	12.7	12.3	12.0	15.7	15.3	14.9
	0.6	19.6	total	14.3	13.6	12.7	19.0	17.9	16.7	22.2	20.8	19.7
35/24	0.4	9.5	sensible	9.7	9.4	9.0	13.7	13.3	12.8	17.0	16.5	16.1
			total	15.1	14.3	13.4	20.6	19.4	18.2	24.6	23.1	21.8
	0.8	33.5	sensible	10.0	9.7	9.3	14.3	13.9	13.4	17.9	17.4	16.9
35/24	0.4	9.5	total	16.6	15.8	14.9	20.5	19.5	18.5	22.9	21.8	20.5
			sensible	10.3	10.0	9.7	14.1	13.7	13.4	17.2	16.9	16.6
	0.6	19.6	total	18.3	17.4	16.5	23.8	22.7	21.5	27.6	26.3	24.9
35/24	0.4	9.5	sensible	11.0	10.7	10.3	15.3	14.9	14.4	18.8	18.4	17.9
			total	19.3	18.4	17.5	26.1	24.9	23.6	30.9	29.4	27.8
	0.8	33.5	sensible	11.4	11.0	10.7	16.2	15.7	15.2	20.0	19.5	18.9
1 row hot water coil				Entering water temp			Entering water temp			Entering water temp		
Air on DB	W. flow L/s	P.D. kPa	Heating kW	50	65	80	50	65	80	50	65	80
7	0.08	8.4	heat	7.8	10.5	13.2	9.2	12.4	15.6	10.1	13.6	17.1
	0.12	17.3	heat	8.7	11.7	14.7	10.8	14.5	18.3	12.2	16.4	20.7
	0.16	28.8	heat	9.3	12.6	15.8	11.8	16.0	20.1	13.6	18.3	23.0
15	0.08	8.4	heat	6.3	9.0	11.7	7.4	10.6	13.9	8.2	11.7	15.2
	0.12	17.3	heat	7.1	10.1	13.1	8.7	12.5	16.2	9.9	14.1	18.3
	0.16	28.8	heat	7.7	10.8	14.0	9.6	13.7	17.8	11.0	15.7	20.4
21	0.08	8.4	heat	5.2	7.9	10.6	6.2	9.4	12.5	6.8	10.3	13.8
	0.12	17.3	heat	5.8	8.8	11.8	7.2	11.0	14.7	8.2	12.4	16.6
	0.16	28.8	heat	6.4	9.5	12.7	8.2	12.0	16.1	9.1	13.8	18.5

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

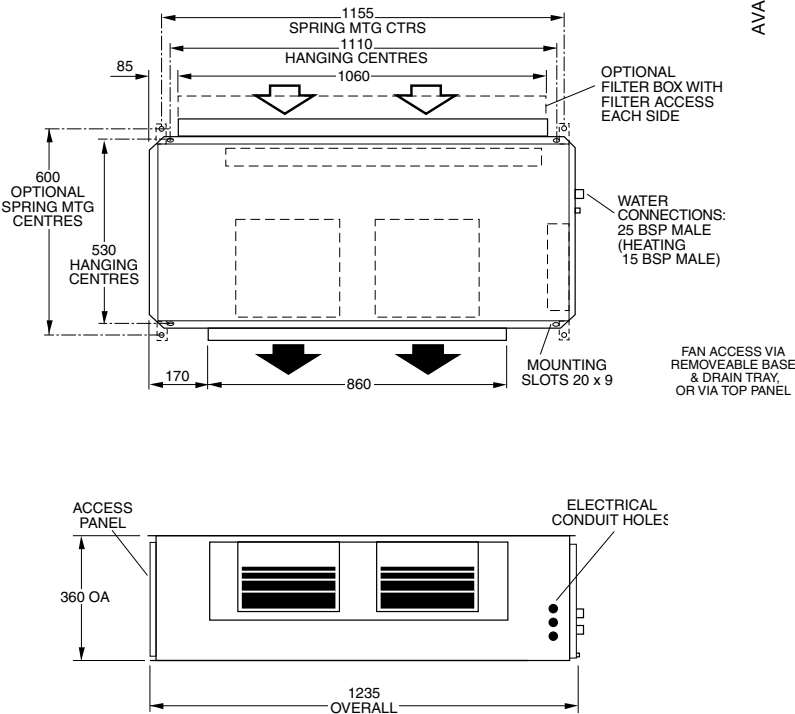


Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	6.7	1000	46	48	47	46	39	33	30
Med	8	1200	52	56	54	52	46	41	39
High	9.3	1400	60	62	61	57	56	49	48

IMD 210Y

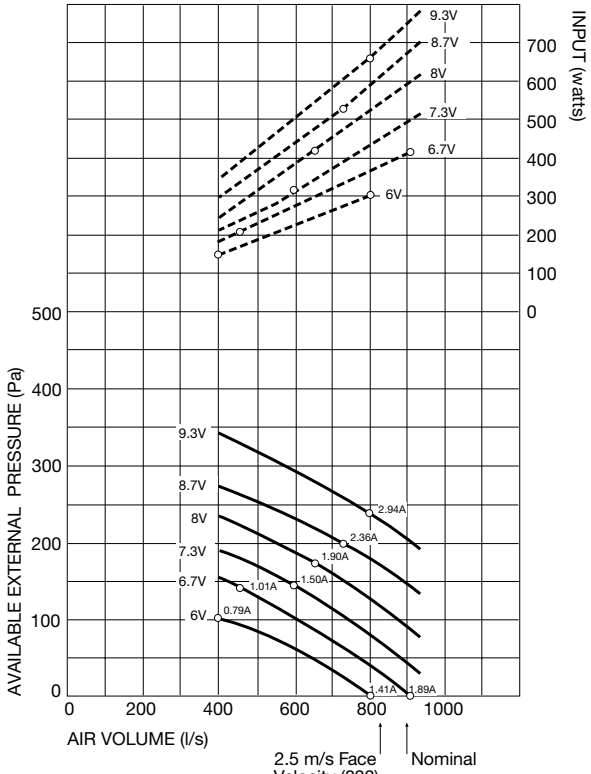


IMD 280Y				Low Air flow			Medium Air flow			Nominal Air flow		
				600 L/s			900 L/s			1200 L/s		
				Entering water temp			Entering water temp			Entering water temp		
4 row chilled water coil				6	7	8	6	7	8	6	7	8
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW									
23/17	0.6	7.0	total	12.8	11.7	10.7	15.5	14.2	13.0	17.4	16.0	14.6
			sensible	9.1	8.6	8.2	11.9	11.3	10.8	14.2	13.7	13.1
	1.0	17.8	total	14.5	13.2	12.0	18.3	16.8	15.3	21.2	19.5	17.7
27/19			sensible	9.8	9.3	8.7	13.0	12.4	11.7	15.8	15.0	14.3
	1.4	33.1	total	15.2	13.9	12.7	19.9	18.3	16.6	23.6	21.7	19.7
			sensible	10.2	9.6	9.1	13.7	13.0	12.3	16.8	16.0	15.2
31/21	0.6	7.0	total	15.7	14.6	13.5	19.0	17.7	16.4	21.2	19.8	18.4
			sensible	11.2	10.8	10.3	14.7	14.2	13.7	17.7	17.2	16.6
	1.0	17.8	total	17.7	16.5	15.3	22.4	20.9	19.3	26.0	24.2	22.4
35/24			sensible	12.1	11.6	11.1	16.1	15.5	14.9	19.6	18.9	18.2
	1.4	33.1	total	18.7	17.4	16.2	24.4	22.8	21.1	29.0	27.0	25.0
			sensible	12.6	12.0	11.4	17.0	16.3	15.6	20.8	20.0	19.2
31/21	0.6	7.0	total	18.8	17.7	16.6	22.7	21.3	20.0	25.4	23.9	22.4
			sensible	13.4	12.9	12.5	17.5	17.0	16.5	21.1	20.6	20.0
	1.0	17.8	total	21.2	20.0	18.7	26.9	25.3	23.7	31.1	29.3	27.5
35/24			sensible	14.4	13.9	13.3	19.2	18.5	17.9	23.3	22.6	21.9
	1.4	33.1	total	22.5	21.2	19.9	29.3	27.6	25.9	34.7	32.7	30.6
			sensible	14.9	14.4	13.8	20.2	19.5	18.8	24.7	23.9	23.1
1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.2	2.8	heat	12.5	16.9	21.2	14.8	20.0	25.2	16.6	22.4	28.2
	0.4	9.6	heat	14.1	19.0	23.9	17.5	23.6	29.7	20.1	27.1	34.1
	0.6	20.2	heat	15.0	20.2	25.4	18.9	25.6	32.2	22.1	29.8	37.5
15	0.2	2.8	heat	9.9	15.1	18.5	11.8	16.9	22.0	13.3	18.9	24.6
	0.4	9.6	heat	12.2	17.0	20.8	13.9	19.9	25.9	16.0	22.9	29.8
	0.6	20.2	heat	13.0	18.1	22.1	15.1	21.5	28.0	17.6	25.2	32.7
21	0.2	2.8	heat	8.2	12.5	16.8	9.8	14.9	19.9	10.9	16.6	22.3
	0.4	9.6	heat	9.3	14.0	18.8	11.5	17.5	23.4	13.2	20.1	26.9
	0.6	20.2	heat	9.8	14.9	20.0	12.5	18.9	25.3	14.5	22.1	29.6

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

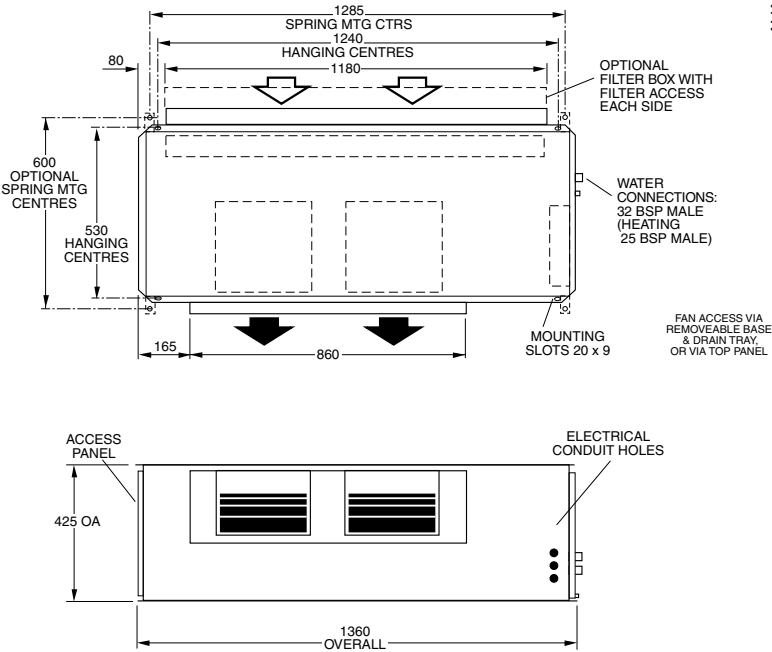


Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	6.3	950	45	49	48	44	38	34	31
Med	8.3	1250	55	58	58	53	49	44	41
High	10	1500	64	66	66	61	58	54	52

IMD 280Y

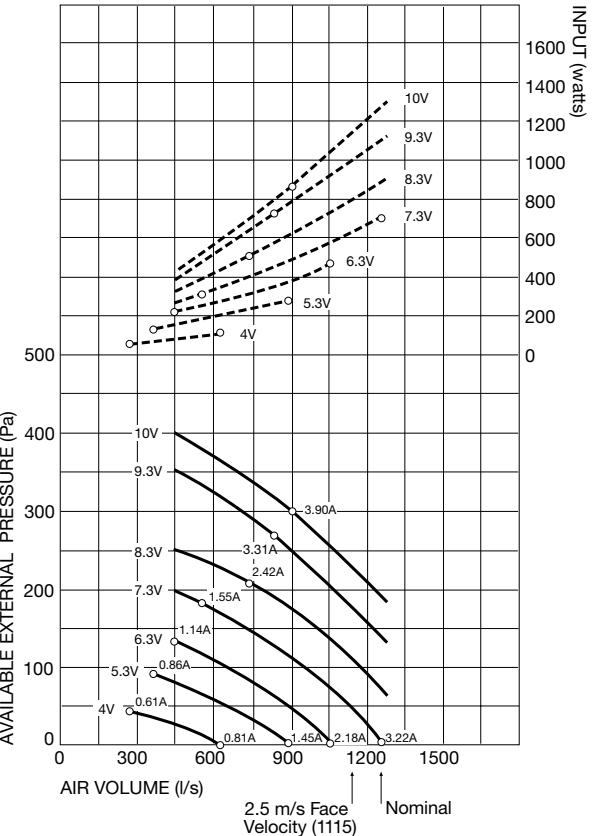





IMD 420Y				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				1000 L/s			1400 L/s			1800 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	1.0	3.9	total	20.4	18.8	17.1	23.9	21.9	19.9	26.4	24.4	22.2
			sensible	14.7	14.0	13.3	18.3	17.5	16.7	21.5	20.7	19.8
	2.0	13.9	total	23.8	21.9	19.9	29.2	26.8	24.4	33.6	31.1	28.2
			sensible	16.2	15.4	14.5	20.6	19.6	18.6	24.5	23.4	22.2
	3.0	29.8	total	25.3	23.3	21.2	32.0	29.3	26.7	37.4	34.5	31.2
			sensible	16.9	16.0	15.1	21.8	20.7	19.5	26.1	24.8	23.4
27/19	1.0	3.9	total	25.0	23.3	21.6	29.1	27.2	25.2	32.1	30.2	27.9
			sensible	18.2	17.5	16.8	22.8	22.0	21.2	26.7	26.0	25.1
	2.0	13.9	total	29.3	27.3	25.3	35.8	33.4	30.9	41.6	38.6	35.6
			sensible	20.0	19.2	18.3	25.5	24.5	23.5	30.5	29.3	28.1
	3.0	29.8	total	31.2	29.1	27.0	39.4	36.7	34.0	46.2	43.1	40.1
			sensible	20.9	20.0	19.1	27.0	25.9	24.7	32.4	31.1	29.9
31/21	1.0	3.9	total	29.9	28.2	26.5	34.8	32.8	30.7	38.6	36.0	34.0
			sensible	21.6	20.9	20.3	27.1	26.3	25.6	32.0	31.0	30.3
	2.0	13.9	total	35.1	33.1	31.0	43.0	40.5	38.0	49.5	46.4	43.7
			sensible	23.8	23.0	22.1	30.3	29.3	28.3	36.1	34.9	33.9
	3.0	29.8	total	37.5	35.3	33.2	47.3	44.6	41.8	55.3	52.3	49.2
			sensible	24.9	23.9	23.0	32.2	31.0	29.8	38.4	37.2	36.0
35/24	1.0	3.9	total	37.7	35.9	34.0	43.4	41.3	39.1	47.4	45.1	42.8
			sensible	24.2	23.5	22.9	30.0	29.3	28.6	35.1	34.4	33.6
	2.0	13.9	total	44.6	42.5	40.6	54.5	51.8	49.2	62.1	59.0	56.0
			sensible	27.0	26.1	25.3	34.1	33.1	32.1	40.2	39.1	38.0
	3.0	29.8	total	48.1	45.9	43.6	60.1	57.3	54.4	70.2	66.7	63.2
			sensible	28.4	27.5	26.5	36.3	35.2	34.0	43.2	41.9	40.7
1 row hot water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.3	3.9	heat	20.0	27.0	34.0	23.1	31.1	39.2	25.4	34.3	43.2
	0.6	12.2	heat	22.9	30.9	38.9	27.5	37.1	46.7	31.0	41.8	52.6
	0.9	27.4	heat	24.5	33.0	41.5	29.8	40.3	50.7	34.1	46.0	57.9
15	0.3	3.9	heat	16.2	23.2	30.1	18.7	26.7	34.8	20.7	29.5	38.4
	0.6	12.2	heat	18.5	26.5	34.4	22.3	31.8	41.4	25.1	35.9	46.6
	0.9	27.4	heat	19.8	28.3	36.8	24.2	34.5	44.9	27.6	39.5	51.3
21	0.3	3.9	heat	13.4	20.3	27.3	15.5	23.5	31.5	17.0	25.9	34.7
	0.6	12.2	heat	15.3	23.2	31.1	18.4	27.9	37.4	20.7	31.5	42.2
	0.9	27.4	heat	16.3	24.8	33.2	19.9	30.2	40.5	22.8	34.6	46.4

Performance Data

Air Handling

- Notes:**
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

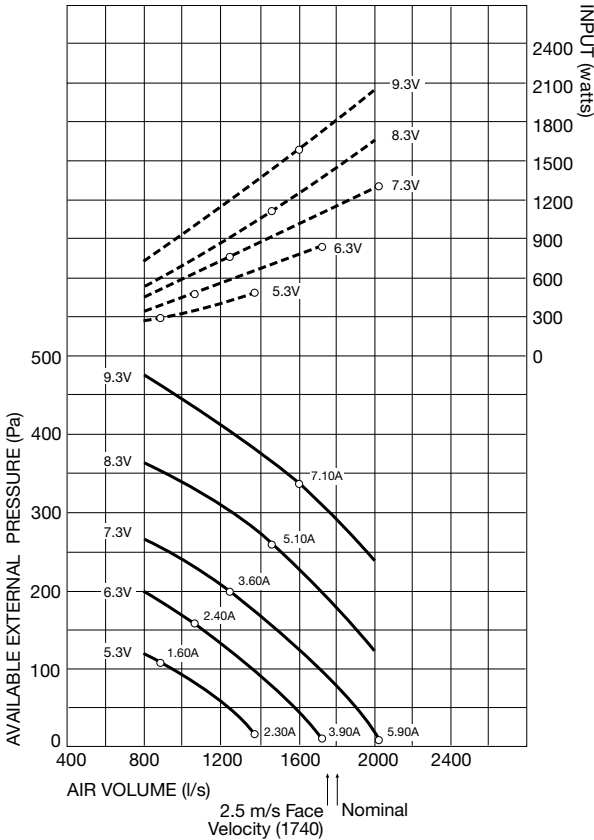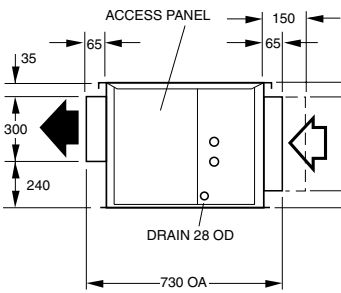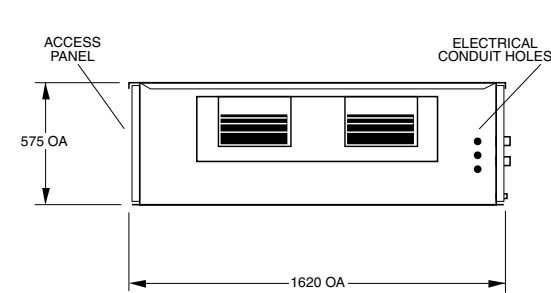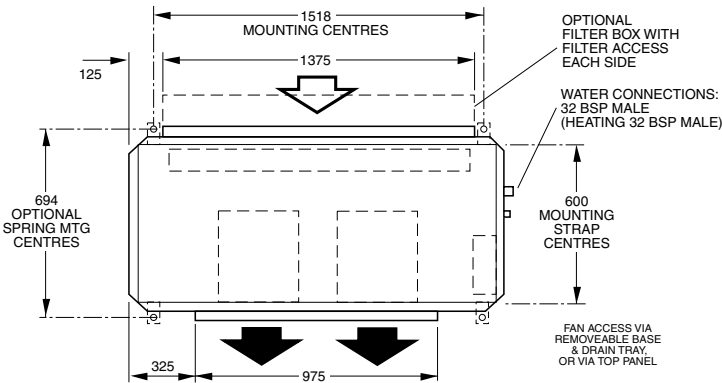

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	7.3	1100	52	56	52	50	46	42	38
Med	8.3	1250	56	61	57	55	50	47	44
High	9.3	1400	63	67	64	62	57	54	52


IMD 550Y				Low Air flow			Medium Air flow			Nominal Air flow		
4 row chilled water coil				1300 L/s			1800 L/s			2350 L/s		
Air on DB/WB	W. flow L/s	P.D. kPa	Cooling kW	Entering water temp			Entering water temp			Entering water temp		
				6	7	8	6	7	8	6	7	8
23/17	2.0	9.5	total	29.5	27.1	24.6	35.2	32.5	29.3	40.5	37.2	33.8
			sensible	20.4	19.3	18.3	25.5	24.3	23.1	30.5	29.1	27.7
	3.0	20.6	total	31.7	29.3	26.6	39.3	36.1	32.8	46.1	42.3	38.5
			sensible	21.4	20.3	19.2	27.3	25.9	24.5	32.9	31.2	29.6
	4.0	32.8	total	33.2	30.5	27.8	41.6	38.2	34.7	49.5	45.2	41.4
			sensible	22.1	20.9	19.7	28.3	26.8	25.3	34.3	32.5	30.8
27/19	2.0	9.5	total	36.2	33.7	31.2	43.5	40.5	37.4	49.5	46.1	43.0
			sensible	25.2	24.2	23.1	31.7	30.5	29.2	37.8	36.4	35.2
	3.0	20.6	total	39.2	36.6	33.9	48.2	45.0	41.6	56.7	52.8	48.8
			sensible	26.6	25.4	24.3	33.7	32.3	31.0	40.7	39.1	37.5
	4.0	32.8	total	40.8	38.1	35.3	51.1	47.8	44.1	60.6	56.2	52.3
			sensible	27.3	26.1	24.9	35.0	33.5	32.0	42.3	40.5	38.9
31/21	2.0	9.5	total	43.3	40.9	38.3	52.0	49.0	45.9	59.5	56.0	52.1
			sensible	30.0	28.9	27.9	37.6	36.5	35.3	45.1	43.7	42.3
	3.0	20.6	total	47.1	44.4	41.7	57.9	54.4	51.1	67.7	63.6	59.6
			sensible	31.6	30.4	29.2	40.1	38.7	37.3	48.2	46.7	45.1
	4.0	32.8	total	49.1	46.3	43.5	61.6	58.1	54.5	73.1	68.6	64.5
			sensible	32.5	31.2	30.0	41.6	40.1	38.7	50.4	48.6	47.0
35/24	2.0	9.5	total	55.1	52.6	49.9	65.5	62.3	59.0	74.1	70.4	66.7
			sensible	33.9	32.8	31.8	42.1	40.9	39.8	50.0	48.7	47.5
	3.0	20.6	total	60.0	57.2	54.3	73.6	70.1	66.5	85.3	81.2	76.9
			sensible	35.8	34.7	33.5	45.2	43.8	42.5	54.1	52.5	51.0
	4.0	32.8	total	62.7	60.0	57.0	78.5	74.7	70.9	92.5	88.0	83.5
			sensible	37.0	35.9	34.6	47.1	45.7	44.2	56.8	55.1	53.4
1 row heating water coil												
Air on DB	W. flow L/s	P.D. kPa	Heating kW	Entering water temp			Entering water temp			Entering water temp		
				50	65	80	50	65	80	50	65	80
7	0.4	4.5	heat	26.2	34.1	44.5	30.1	40.6	51.1	33.4	45.1	56.8
	0.8	15.4	heat	30.0	39.0	50.9	35.8	48.3	60.8	40.7	54.9	69.1
	1.2	31.5	heat	32.0	41.7	54.3	38.7	52.2	65.7	44.8	60.4	76.1
15	0.4	4.5	heat	21.2	30.4	39.4	24.4	34.9	45.4	27.2	38.8	50.4
	0.8	15.4	heat	24.3	34.6	45.1	29.0	41.4	53.9	33.0	47.1	61.3
	1.2	31.5	heat	25.9	37.0	48.1	31.5	45.0	58.5	36.3	51.9	67.4
21	0.4	4.5	heat	17.5	26.6	35.7	20.2	30.6	41.1	22.5	34.0	45.6
	0.8	15.4	heat	20.0	30.4	40.7	24.0	36.3	48.7	27.2	41.3	55.4
	1.2	31.5	heat	21.4	32.4	43.5	26.0	39.4	52.8	30.0	45.4	60.9

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

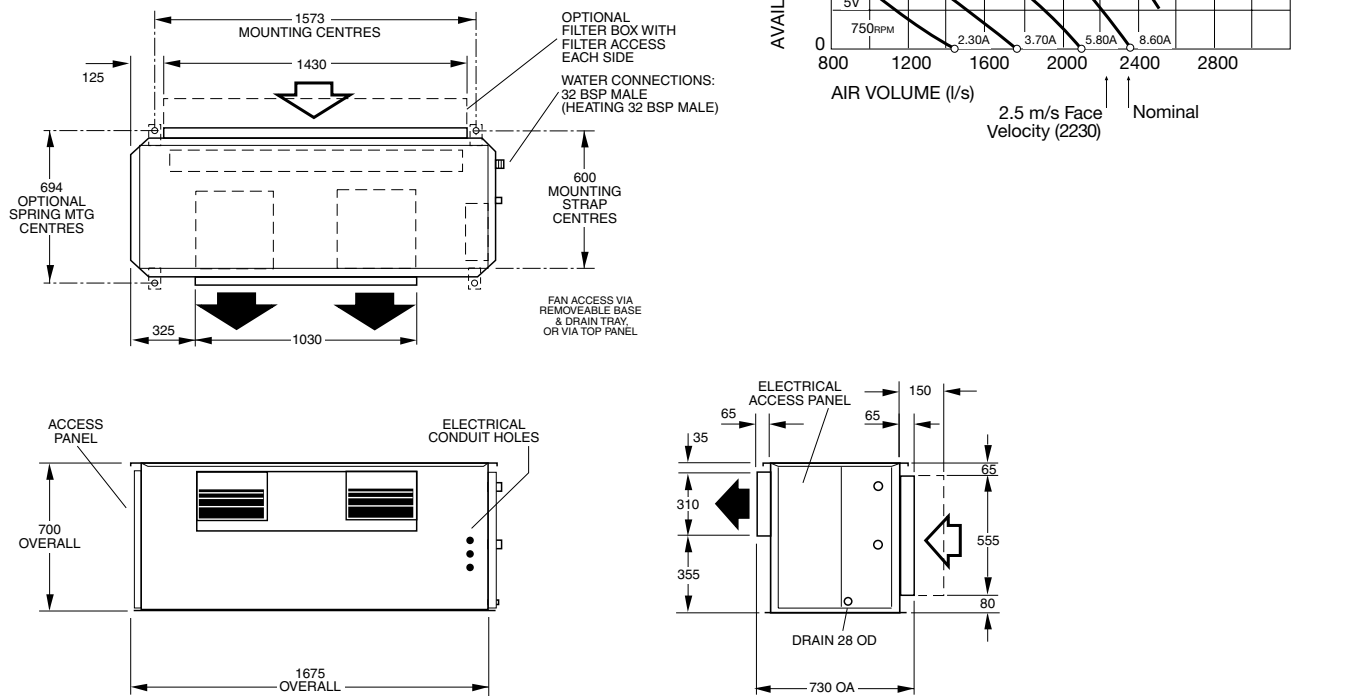

Sound Levels

Sound levels are specified as in-situ conditions. For more information and adjustment factors for your specific installation please find supplementary booklets under the relevant units on our website www.temperzone.com

Fan Speed	Vdc	RPM	Sound Power Levels (SWL) (dB)						
			dB(A)	Octave Band Centre Frequency (Hz)					
				125	250	500	1K	2K	4K
Low	6	900	56	58	54	54	51	47	45
Med	8	1200	63	65	62	61	58	55	53
High	10	1500	69	70	67	66	63	64	59

Advantage IJD Range
(AHU)






Variable Pitch Pulley



High Static Pressure



Vertical Fan Discharge



Opposite Hand

Advantage Range (IJD)
Specifications

Model	IJD 370	IJD 450	IJD 620	IJD 950	IJD 1400	IJD 2000	IJD 2400
Features							
Nominal Air Flow (l/s) *1	1400	1800	2200	3200	5000	7500	9000
Fan Type	Forward Curved Centrifugal Double Inlet Double Width Belt Driven						
Motor Type	Aluminium Foot Mounted TEFC IP55						
Power Source *2	3 Phase 415V 50 Hz						
Motor Rating (W)	2.2	2.2	3.0	4.0	7.5	(2x) 5.5	(2x) 5.5
Full Load Amps (A) *3	5	5	6.7	8.7	15.7	20.6	20.6
Optional Electric Heating (kW) *4	12	18	18	27	36	48	54
Electric Heat Current (A/ph)	17.6/3	26.4/3	26.4/3	39.6/3	52.8/3	70.4/3	79.2/3
Heat Exchanger Type	Epoxy Aluminium Corrugated Plate Fins To Expanded Rifled Copper Tube						
Finish	Zinc Galvanised Steel						
Test Pressure	2100 kPa						
Cooling/Heating Medium	Chilled Water / Hot Water / Electric Heat						
Connection Sizes 4 Row Cooling Coil (mm)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)	Ø 40 (1½" BSP)	Ø 50 (2" BSP)	(2x) Ø 50 (2" BSP)	(2x) Ø 50 (2" BSP)
Connection Sizes 6 Row Cooling Coil (mm)	Ø 32 (1¼" BSP)	Ø 40 (1½" BSP)	Ø 40 (1½" BSP)	Ø 40 (1½" BSP)	Ø 50 (2" BSP)	(2x) Ø 50 (2" BSP)	(2x) Ø 50 (2" BSP)
Connection Sizes 1 Row Heating Coil (mm)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)	Ø 32 (1¼" BSP)	Ø 40 (1½" BSP)	Ø 50 (2" BSP)	(2x) Ø 50 (2" BSP)	(2x) Ø 50 (2" BSP)
Filters							
Optional Air Filter Type	Disposable Extended Surface EU4/G4 Rated						
Number of Optional Air Filters	2	3	3	3+3	4+4	12	12
Optional Air Filter Size (mm)	625x500x50	625x400x50	625x500x50	400x500x50 500x500x50	450x500x50 500x500x50	500x500x50	600x500x50
Weight							
Weight (4/1) Incl. Water (kg)	180	217	245	316	445	657	809
Nett Dry Weight (4/1) (kg)	166	201	224	285	398	583	723
Shipping Weight (kg)	184	218	242	315	428	620	760
Notes:							
*1 With no filters fitted and with a dry coil surface							
*2 Voltage range 3 phase power supply, 380-440 V a.c 50 Hz							
*3 Excluding Electric Heating							
*4 Complete with high temperature safety cutout thermostats required to meet AS/NZS 3350.2.40 2019							
Cooling and Heating Coil options							
4 Row Cooling only, 4 Row Cooling + 1 Row Heating							
4 Row Cooling + Electric Heating							
6 Row Cooling only, 6 Row Cooling + 1 Row Heating							
6 Row Cooling + Electric Heating							
Configuration options							
Horizontal / Vertical Supply Air							
Standard / Opposite Hand							

IJD 370			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
4 row chilled water coil			800 L/s						1400 L/s					
Air on DB/WB	W. flow L/s	P.D. kPa	Entering water temp						Entering water temp					
			6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	1.0	3.4	16.7	11.9	15.4	11.4	13.9	10.8	21.7	17.2	19.9	16.5	18.1	15.8
	2.0	11.8	19.3	13.1	17.6	12.3	16.1	11.7	26.9	19.4	24.8	18.5	22.6	17.6
	3.0	24.5	20.4	13.6	18.8	12.8	17.1	12.1	29.8	20.7	27.4	19.6	24.9	18.6
27/19	1.0	3.4	20.5	14.8	19.1	14.2	17.6	13.6	26.6	21.4	24.7	20.7	22.8	20.0
	2.0	11.8	23.7	16.1	22.0	15.4	20.5	14.7	33.1	24.1	30.9	23.1	28.6	22.2
	3.0	24.5	25.1	16.8	23.5	16.0	21.8	15.3	36.7	25.5	34.2	24.5	31.7	23.4
31/21	1.0	3.4	24.5	17.5	23.1	17.0	21.7	16.4	31.6	25.5	29.7	24.8	27.8	24.1
	2.0	11.8	28.4	19.1	26.8	18.5	25.1	17.8	39.7	28.6	37.2	27.6	34.9	26.7
	3.0	24.5	30.2	19.9	28.4	19.2	26.6	18.4	44.2	30.4	41.6	29.3	39.0	28.3
35/24	1.0	3.4	30.9	19.6	29.4	19.1	27.9	18.5	39.3	28.2	37.4	27.5	35.4	26.8
	2.0	11.8	36.1	21.7	34.4	21.0	32.7	20.3	50.1	32.0	47.7	31.1	45.2	30.2
	3.0	24.5	38.6	22.8	36.9	22.0	35.1	21.3	56.0	34.2	53.2	33.2	50.5	32.1

6 row chilled water coil														
23/17	1.0	4.9	19.1	13.2	17.6	12.5	16.1	11.8	25.7	19.2	23.6	18.4	21.6	17.5
	2.0	17.2	21.6	14.3	19.9	13.5	18.1	12.7	31.5	21.8	29.0	20.6	26.4	19.5
	3.0	58.8	22.6	14.8	20.7	13.9	18.9	13.1	34.4	23.1	31.7	21.9	28.9	20.6
27/19	1.0	4.9	23.5	16.3	22.0	15.6	20.4	14.9	31.5	23.9	29.4	23.0	27.3	22.2
	2.0	17.2	26.6	17.7	24.8	16.9	23.1	16.1	38.9	27.0	36.2	25.9	33.6	24.7
	3.0	35.8	27.7	18.2	26.0	17.4	24.1	16.5	42.4	28.6	39.6	27.3	36.8	26.1
31/21	1.0	4.9	28.2	19.3	26.6	18.7	25.0	18.0	37.7	28.4	35.6	27.6	33.4	26.8
	2.0	17.2	31.9	21.0	30.1	20.2	28.3	19.4	46.6	32.0	44.0	30.9	41.3	29.9
	3.0	35.8	33.5	21.7	31.7	20.9	29.8	20.1	50.9	33.9	48.2	32.7	45.2	31.5
35/24	1.0	4.9	35.7	21.8	34.0	21.1	32.4	20.5	46.8	31.5	44.5	30.7	42.4	29.9
	2.0	17.2	40.6	24.0	38.8	23.1	37.0	22.4	58.8	36.0	56.0	35.0	53.2	33.9
	3.0	35.8	42.7	24.9	40.7	24.0	38.9	23.2	64.6	38.4	61.6	37.2	58.6	35.9



1 row hot water coil								
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp		
			50	65	80	50	65	80
7	0.5	1.3	17.3	23.3	29.3	22.6	30.5	38.5
	1.0	4.8	18.8	25.4	32.0	25.7	34.7	43.6
	2.0	15.6	20.6	27.8	35.0	28.9	38.9	48.9
15	0.5	1.3	14.0	20.0	26.0	18.4	26.2	34.1
	1.0	4.8	15.3	21.8	28.3	20.8	29.7	38.7
	2.0	15.6	16.6	23.8	30.9	23.4	33.4	43.4
21	0.5	1.3	11.6	17.6	23.6	15.2	23.0	30.9
	1.0	4.8	12.6	19.1	25.6	17.2	26.1	35.0
	2.0	15.6	13.6	20.8	27.8	19.2	29.2	39.2

Performance Data

Air Handling


- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

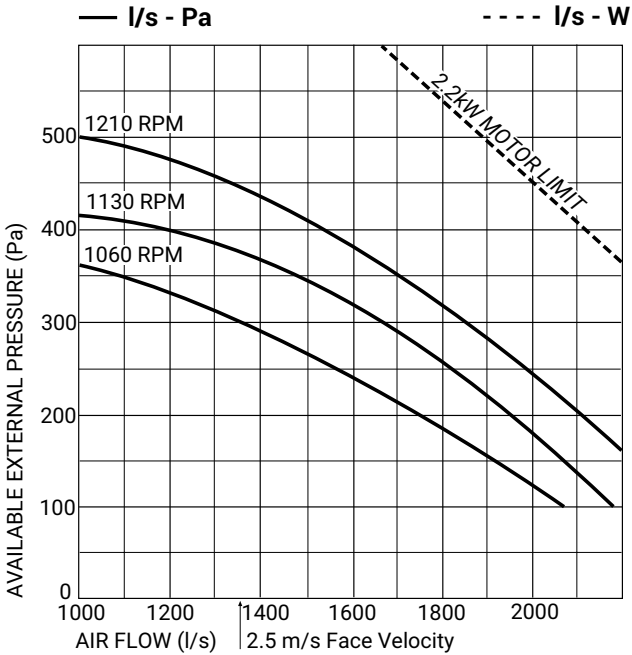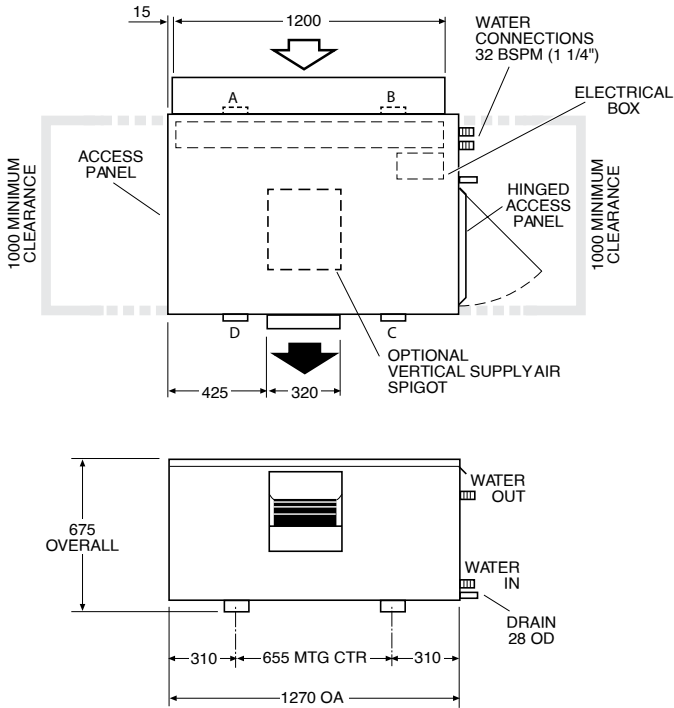

Point Loads			
A	B	C	D
40	52	50	38

*4/1 row coil including water

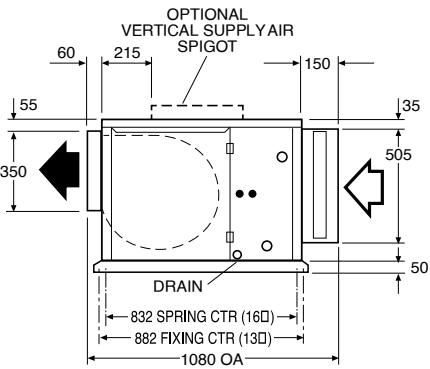

Sound Levels

Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
1060	82	79	78	79	77	75	70
1130	84	80	79	81	79	77	72
1210	86	81	80	82	82	79	75

IJD 450			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
			1000 L/s						1800 L/s					
			Entering water temp						Entering water temp					
Air on DB/WB	W. flow L/s	P.D. kPa	6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	2.0	7.9	23.1	15.9	21.2	15.0	19.3	14.2	32.3	23.9	29.6	22.8	26.8	21.6
	3.0	16.7	24.6	16.6	22.7	15.7	20.7	14.8	36.0	25.5	33.3	24.3	30.1	23.0
	4.0	26.0	25.7	17.1	23.7	16.1	21.5	15.2	38.6	26.6	35.4	25.2	32.3	23.9
27/19	2.0	7.9	28.3	19.6	26.4	18.8	24.5	18.0	39.4	29.6	36.6	28.5	34.1	27.5
	3.0	16.7	30.4	20.5	28.4	19.7	26.4	18.8	44.4	31.6	41.2	30.3	38.4	29.2
	4.0	26.0	31.7	21.1	29.5	20.1	27.4	19.2	47.5	32.9	44.3	31.6	41.0	30.2
31/21	2.0	7.9	34.0	23.3	32.1	22.5	30.0	21.7	47.1	35.1	44.2	34.0	41.6	33.1
	3.0	16.7	36.6	24.4	34.5	23.5	32.4	22.7	53.2	37.5	49.8	36.2	46.9	35.1
	4.0	26.0	38.1	25.1	35.9	24.1	33.8	23.2	56.8	39.0	53.7	37.8	50.4	36.4
35/24	2.0	7.9	43.4	26.4	41.2	25.5	39.2	24.8	59.2	39.2	56.2	38.1	53.2	37.1
	3.0	16.7	46.8	27.8	44.5	26.9	42.3	26.0	67.2	42.1	63.9	40.9	60.5	39.7
	4.0	26.0	48.7	28.6	46.4	27.7	44.3	26.8	72.3	44.1	68.8	42.7	65.3	41.4

6 row chilled water coil														
23/17	1.5	6.6	24.9	16.9	22.9	16.0	20.8	15.1	34.8	25.5	31.8	24.2	29.1	23.1
	2.5	17.0	27.0	17.9	24.8	16.9	22.6	15.9	40.2	27.8	37.1	26.5	33.8	25.0
	3.5	31.5	28.0	18.4	25.8	17.3	23.6	16.3	43.2	29.2	40.0	27.7	36.3	26.1
27/19	1.5	6.6	30.6	20.9	28.5	20.0	26.5	19.1	42.4	31.5	39.7	30.4	37.0	29.3
	2.5	17.0	33.3	22.1	31.1	21.1	28.8	20.1	49.5	34.5	46.2	33.1	42.8	31.6
	3.5	31.5	34.6	22.7	32.3	21.7	30.0	20.6	53.5	36.2	49.8	34.6	46.0	33.0
31/21	1.5	6.6	36.7	24.8	34.6	23.9	32.5	23.0	51.0	37.5	48.2	36.4	45.0	35.2
	2.5	17.0	39.9	26.3	37.7	25.3	35.4	24.3	59.5	41.0	56.1	39.6	52.5	38.1
	3.5	31.5	41.5	27.0	39.4	26.0	37.0	25.0	63.9	42.9	60.5	41.4	56.6	39.8
35/24	1.5	6.6	46.3	28.0	44.3	27.2	42.2	26.3	63.5	41.6	60.4	40.5	57.3	39.4
	2.5	17.0	50.8	29.9	48.4	28.9	46.3	28.0	74.7	45.9	71.2	44.5	67.8	43.2
	3.5	31.5	52.8	30.8	50.6	29.8	48.3	28.9	81.1	48.5	77.6	47.1	73.7	45.5



1 row hot water coil								
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp		
			50	65	80	50	65	80
7	0.5	1.0	21.1	28.4	35.8	27.4	37.0	46.6
	1.0	3.3	23.0	31.0	39.0	31.3	42.2	53.1
	2.0	10.7	25.1	33.8	42.6	35.2	47.6	59.9
15	0.5	1.0	17.1	24.4	31.7	22.2	31.8	41.2
	1.0	3.3	18.6	26.5	34.5	25.4	36.2	47.1
	2.0	10.7	20.2	28.8	37.5	28.5	40.8	53.1
21	0.5	1.0	14.1	21.4	28.7	18.4	27.9	37.4
	1.0	3.3	15.3	23.2	31.2	20.9	31.8	42.6
	2.0	10.7	16.6	25.2	33.9	23.6	35.8	48.0

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

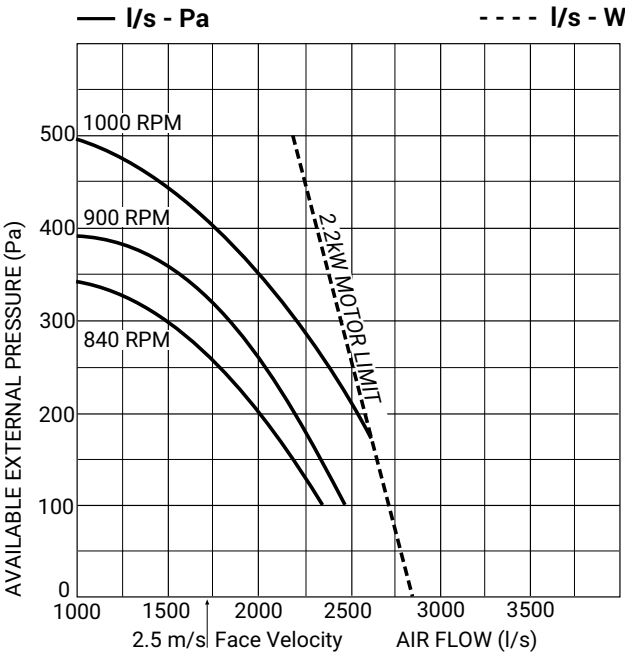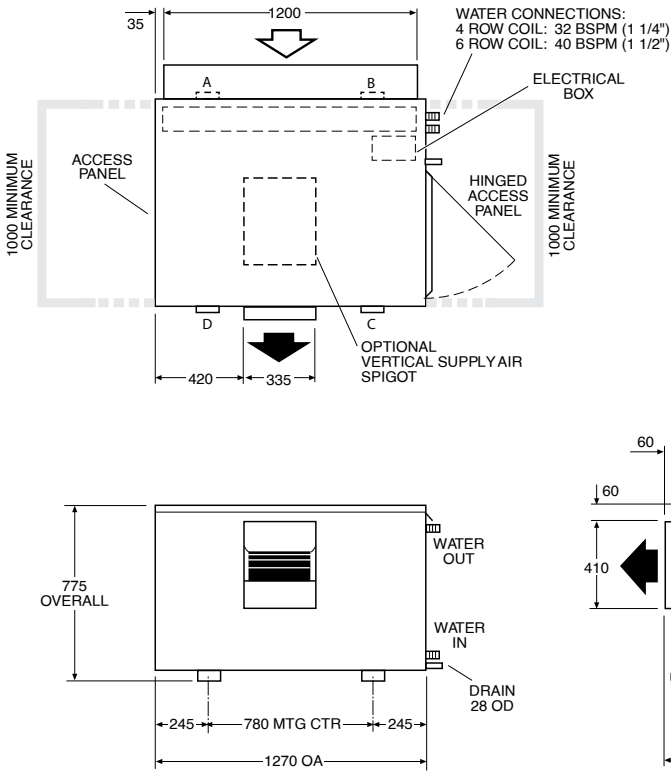

Point Loads			
A	B	C	D
61	74	47	35

*4/1 row coil including water

Sound Levels

Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
840	84	86	82	80	78	77	76
900	89	87	84	84	83	82	81
1000	94	88	86	88	90	87	87

IJD 620			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
4 row chilled water coil			1600 L/s						2200 L/s					
Air on DB/WB	W. flow L/s	P.D. kPa	Entering water temp						Entering water temp					
			6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	1.5	5.5	29.9	22.1	27.5	21.1	25.0	20.1	34.7	27.2	31.9	26.1	29.0	24.9
	2.5	13.9	34.4	24.1	31.6	22.8	28.6	21.6	41.3	30.0	37.8	28.5	34.3	27.1
	3.5	24.7	36.9	25.2	33.9	23.8	30.8	22.5	45.1	31.6	41.4	30.0	37.7	28.5
27/19	1.5	5.5	36.8	27.5	34.3	26.5	31.6	25.4	42.4	33.9	39.5	32.8	36.6	31.6
	2.5	13.9	42.2	29.8	39.3	28.5	36.4	27.4	50.5	37.1	47.0	35.7	43.5	34.3
	3.5	24.7	45.3	31.1	42.2	29.8	39.2	28.5	55.5	39.2	51.7	37.6	47.8	36.0
31/21	1.5	5.5	44.0	32.7	41.4	31.7	38.8	30.7	50.8	40.4	47.6	39.2	44.5	38.1
	2.5	13.0	50.6	35.3	47.6	34.1	44.7	33.0	60.4	44.1	56.8	42.6	53.2	41.3
	3.5	24.7	54.6	37.1	51.5	35.7	48.3	34.4	66.5	46.5	62.6	44.9	58.7	43.4
35/24	1.5	5.5	55.1	36.4	52.4	35.4	49.7	34.4	62.9	44.5	59.7	43.5	56.6	42.5
	2.5	13.9	64.3	39.8	61.2	38.6	58.1	37.5	76.1	49.2	72.3	47.9	68.5	46.5
	3.5	24.7	69.5	41.9	66.2	40.6	62.8	39.3	84.1	52.2	80.0	50.7	76.1	49.2

6 row chilled water coil														
23/17	1.5	7.8	34.9	24.6	32.1	23.4	29.2	22.2	40.9	30.4	37.6	29.0	34.3	27.6
	2.5	19.9	39.3	26.7	36.2	25.2	33.0	23.8	48.2	33.6	44.3	31.9	40.3	30.2
	3.5	36.3	41.9	27.8	38.5	26.3	35.1	24.8	52.2	35.3	48.0	33.5	43.8	31.7
27/19	1.5	7.8	42.8	30.5	39.9	29.3	37.0	28.1	50.3	37.8	46.8	36.5	43.4	35.1
	2.5	19.8	48.4	33.0	45.1	31.5	41.9	30.2	59.2	41.6	55.2	39.9	51.2	38.2
	3.5	36.3	51.5	34.4	48.1	32.9	44.6	31.3	64.2	43.8	60.0	41.9	55.6	40.1
31/21	1.5	7.8	51.3	36.3	48.5	35.1	45.5	33.9	59.9	44.9	56.6	43.6	53.1	42.3
	2.5	19.8	58.2	39.2	55.0	37.8	51.6	36.4	70.9	49.3	66.8	47.1	62.8	46.0
	3.5	36.3	61.9	40.9	58.5	39.3	54.9	37.8	77.1	51.9	72.7	50.1	68.3	48.3
35/24	1.5	7.8	64.4	40.6	61.4	39.5	58.3	38.3	74.5	49.8	70.9	48.5	67.4	47.2
	2.5	19.8	73.8	44.4	70.4	43.0	66.9	41.6	89.1	55.2	85.2	53.7	80.9	52.1
	3.5	36.3	78.8	46.5	75.2	45.0	71.5	43.5	97.8	58.7	93.3	56.9	88.7	55.1


1 row hot water coil														
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp			Entering water temp			Entering water temp		
			50	65	80	50	65	80	50	65	80	50	65	80
7	1.0	3.6	32.2	43.5	54.7	37.7	50.8	64.0	37.7	50.8	64.0	37.7	50.8	64.0
	1.5	7.3	34.4	46.4	58.4	40.7	54.9	69.1	40.7	54.9	69.1	40.7	54.9	69.1
	2.0	12.3	35.5	47.9	60.3	42.8	57.7	72.6	42.8	57.7	72.6	42.8	57.7	72.6
15	1.0	3.6	26.1	37.3	48.5	30.5	43.6	56.7	30.5	43.6	56.7	30.5	43.6	56.7
	1.5	7.3	27.8	39.7	51.6	33.0	47.1	61.3	33.0	47.1	61.3	33.0	47.1	61.3
	2.0	12.3	28.7	41.1	53.4	34.7	49.5	64.4	34.7	49.5	64.4	34.7	49.5	64.4
21	1.0	3.6	21.5	32.7	43.8	25.2	38.2	51.3	25.2	38.2	51.3	25.2	38.2	51.3
	1.5	7.3	23.0	34.9	46.7	27.2	41.3	55.4	27.2	41.3	55.4	27.2	41.3	55.4
	2.0	12.3	23.8	36.0	48.3	28.6	43.4	58.2	28.6	43.4	58.2	28.6	43.4	58.2

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

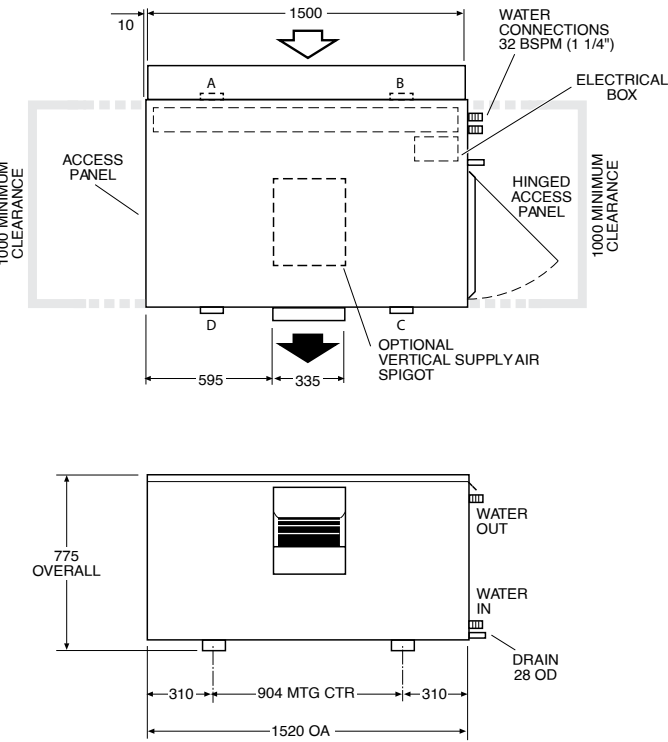

Sound Levels


Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

IJD 620

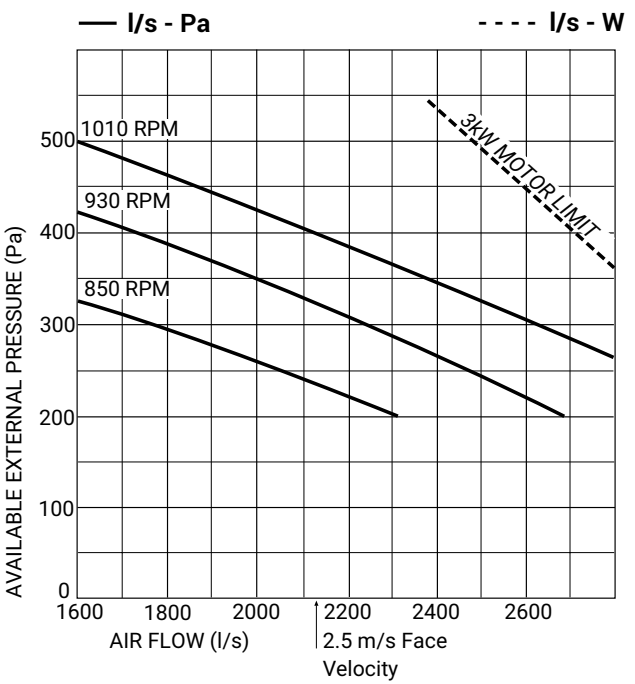

Point Loads			
A	B	C	D
69	83	54	39

*4/1 row coil including water

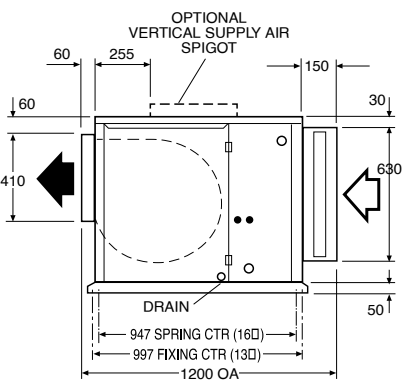

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
850	88	84	83	83	84	82	79
930	91	86	84	85	87	86	81
1010	94	87	85	87	91	90	84

IJD 950			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
4 row chilled water coil			2000 L/s						3200 L/s					
Air on DB/WB	W. flow L/s	P.D. kPa	Entering water temp						Entering water temp					
			6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	2.5	7.7	42.7	30.1	39.1	28.6	35.6	27.1	54.1	41.2	49.5	39.3	45.1	37.5
	3.5	14.0	45.9	31.6	42.1	29.9	38.4	28.3	60.3	43.8	55.3	41.7	50.3	39.6
	4.5	22.6	48.1	32.6	44.3	30.9	40.3	29.1	64.6	45.7	59.4	43.5	54.2	41.2
27/19	2.5	7.7	52.3	37.3	48.8	35.8	45.2	34.3	66.2	51.1	61.5	49.3	57.0	47.6
	3.5	14.0	56.4	39.1	52.6	37.4	48.7	35.8	73.9	54.3	68.8	52.2	63.7	50.2
	4.5	22.6	59.3	40.3	55.3	38.5	51.2	36.8	79.6	56.7	74.1	54.4	68.6	52.2
31/21	2.5	7.7	62.7	44.3	59.1	42.8	55.3	41.3	79.3	61.0	74.1	59.0	69.5	57.3
	3.5	14.0	67.6	46.3	63.8	44.8	60.0	43.2	88.5	64.5	83.1	62.4	78.0	60.4
	4.5	22.6	71.3	47.9	67.1	46.1	63.0	44.4	95.4	67.2	89.7	65.0	84.1	62.8
35/24	2.5	7.7	79.1	49.7	75.6	48.3	71.6	46.9	98.6	67.5	93.7	65.7	88.7	64.1
	3.5	14.0	86.2	52.5	82.1	50.8	77.9	49.2	111.4	72.0	105.8	70.1	100.4	68.1
	4.5	22.6	90.6	54.3	86.3	52.6	82.5	51.0	120.2	75.3	114.8	73.3	108.9	71.1

6 row chilled water coil														
23/17	2.5	11.1	48.7	33.3	44.6	31.5	40.8	29.8	63.5	46.0	58.3	43.8	53.1	41.7
	3.5	20.6	51.8	34.7	47.8	32.9	43.6	31.0	70.4	49.1	64.8	46.6	59.1	44.2
	4.5	31.9	54.1	35.7	49.7	33.8	45.3	31.7	74.9	51.1	68.8	48.4	62.8	45.8
27/19	2.5	11.1	59.8	41.1	55.8	39.4	51.9	37.6	77.8	57.1	72.6	54.9	67.4	52.8
	3.5	20.6	63.9	43.0	59.7	41.1	55.5	39.3	86.5	60.7	80.7	58.3	74.9	55.9
	4.5	31.9	66.5	44.2	62.2	42.2	57.7	40.2	92.1	63.2	85.9	60.5	79.7	57.9
31/21	2.5	11.1	71.7	48.8	67.6	47.1	63.6	45.4	92.9	67.7	87.8	65.7	82.3	63.5
	3.5	20.6	76.9	51.1	72.6	49.2	68.2	47.3	103.7	72.1	97.9	69.7	91.6	67.2
	4.5	31.9	79.9	52.5	75.5	50.5	70.9	48.5	110.5	75.0	104.1	72.3	97.9	69.7
35/24	2.5	11.1	90.9	55.2	86.7	53.5	82.4	51.8	116.5	75.5	110.8	73.5	105.3	71.4
	3.5	20.6	97.6	58.0	93.2	56.2	88.6	54.3	130.2	80.8	124.1	78.4	118.3	76.2
	4.5	31.9	101.6	59.8	97.2	57.9	92.7	56.0	140.0	84.7	133.5	82.1	126.9	79.5



1 row hot water coil								
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp		
			50	65	80	50	65	80
7	1.0	2.1	41.6	56.1	70.6	51.7	69.7	87.7
	2.0	7.2	45.8	61.8	77.7	59.3	80.0	100.8
	3.0	14.7	48.3	65.2	82.1	63.9	86.2	108.6
15	1.0	2.1	33.7	48.1	62.6	41.9	59.8	77.8
	2.0	7.2	37.1	52.9	68.8	48.1	68.7	89.3
	3.0	14.7	39.1	55.9	72.7	51.8	73.9	96.1
21	1.0	2.1	27.8	42.2	56.6	34.6	52.5	70.4
	2.0	7.2	30.5	46.3	62.2	39.6	60.2	80.7
	3.0	14.7	32.3	49.0	65.7	42.7	64.9	87.0

Performance Data

Air Handling


- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.

Dimensions

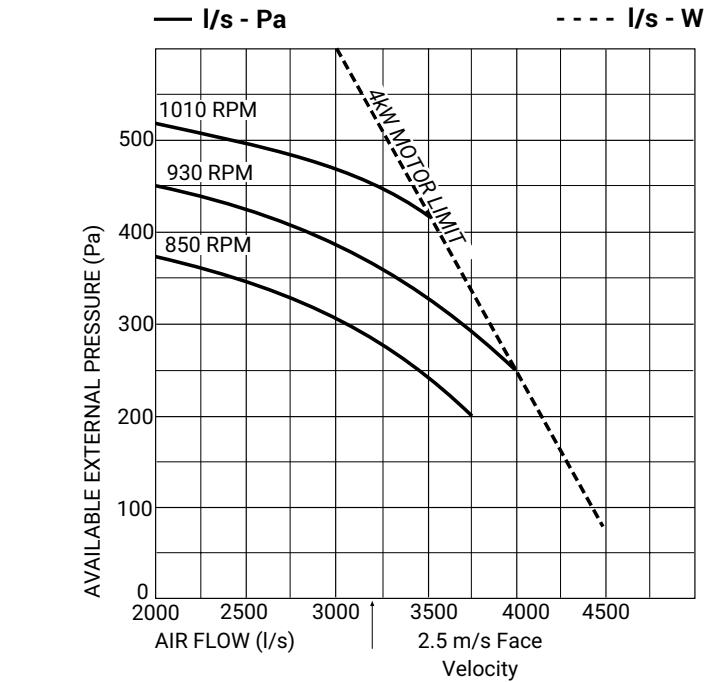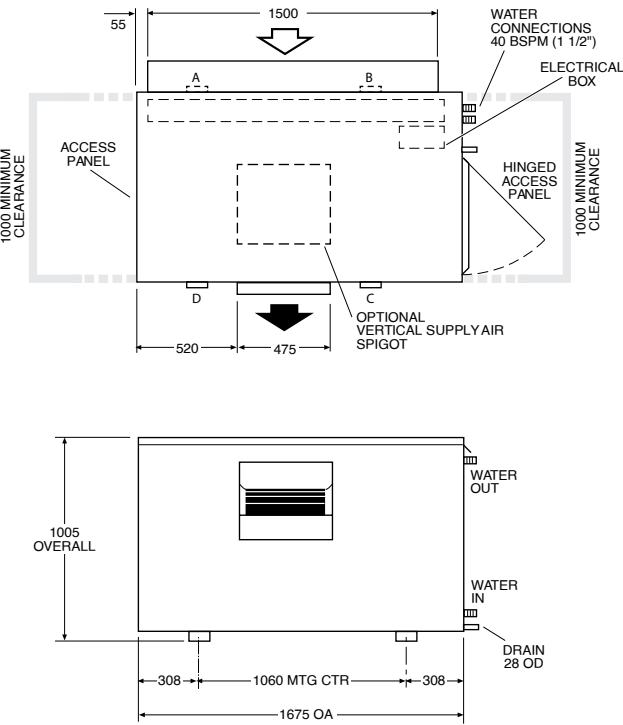

Point Loads			
A	B	C	D
95	103	64	54

*4/1 row coil including water

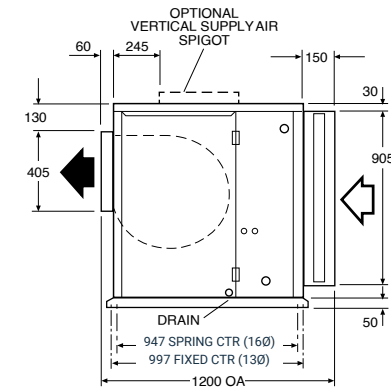

Sound Levels

Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
850	88	86	84	82	82	82	79
930	89	86	84	82	84	83	81
1010	90	87	85	83	85	84	81

IJD 1400

JD 1400			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
4 row chilled water coil			3000 L/s						5000 L/s					
Air on DB/WB	W. flow L/s	P.D. kPa	Entering water temp						Entering water temp					
			6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	2.5	9.1	59.9	43.5	55.1	41.3	50.1	39.3	74.9	60.3	68.6	57.8	62.6	55.4
	3.5	16.2	65.7	45.9	60.3	43.6	54.8	41.2	85.7	64.7	78.7	61.8	71.5	58.9
	4.5	25.5	69.7	47.8	64.0	45.2	58.2	42.7	93.6	68.1	85.9	64.8	78.1	61.6
27/19	2.5	9.1	73.7	53.9	68.5	51.8	63.5	49.8	91.5	75.1	85.3	72.7	79.2	70.3
	3.5	16.2	81.0	57.0	75.4	54.7	69.8	52.4	104.9	80.4	97.7	77.5	90.6	74.7
	4.5	25.5	85.7	59.1	79.8	56.5	74.0	54.1	114.6	84.3	106.9	81.1	99.0	78.0
31/21	2.5	9.1	87.9	64.0	82.8	61.9	77.7	60.0	109.1	89.5	102.7	87.1	96.1	84.8
	3.5	16.2	97.0	67.7	91.4	65.4	85.8	63.1	125.8	95.6	118.1	92.8	110.8	90.1
	4.5	25.5	102.8	70.1	96.8	67.6	90.8	65.1	137.1	100.1	129.1	97.0	120.9	93.9
35/24	2.5	9.1	110.5	71.5	105.3	69.5	100.9	67.6	135.2	98.7	128.5	96.5	121.5	94.2
	3.5	16.2	122.5	76.1	116.7	73.8	110.7	71.5	156.4	106.0	148.6	103.3	141.1	100.7
	4.5	25.5	130.9	79.4	124.7	76.9	118.4	74.4	172.5	111.8	164.1	108.7	155.6	105.7

6 row chilled water coil														
23/17	2.5	13.0	68.7	48.0	63.2	45.6	57.7	43.2	87.7	66.9	80.7	64.0	73.5	61.1
	3.5	23.5	74.7	50.7	68.7	48.0	62.6	45.3	99.9	72.2	92.0	68.8	83.9	65.4
	4.5	36.7	78.4	52.4	72.1	49.5	65.9	46.7	108.7	76.0	100.1	72.2	91.2	68.4
27/19	2.5	13.0	84.4	59.4	79.0	57.0	73.2	54.6	107.3	83.2	100.4	80.4	93.1	77.6
	3.5	23.5	91.8	62.6	85.7	60.0	79.6	57.3	122.5	89.4	114.5	86.1	106.2	82.8
	4.5	36.7	96.3	64.7	90.3	62.0	83.8	59.1	133.5	94.1	124.7	90.3	115.7	86.6
31/21	2.5	13.0	101.1	70.5	95.5	68.1	89.6	65.8	128.1	98.9	120.6	96.1	113.7	93.5
	3.5	23.5	110.2	74.4	104.0	71.7	97.7	69.1	147.2	106.4	138.7	103.1	130.2	99.8
	4.5	36.7	116.1	77.0	109.7	74.2	103.1	71.4	159.9	111.6	151.0	108.0	141.9	104.3
35/24	2.5	13.0	126.8	79.0	121.3	76.8	115.4	74.5	158.4	109.2	150.8	106.6	143.0	103.9
	3.5	23.5	139.7	84.3	133.3	81.6	126.8	79.0	183.3	118.3	174.7	115.1	166.0	111.9
	4.5	36.7	147.5	87.6	140.8	84.7	134.0	81.9	201.2	125.1	191.8	121.5	182.3	117.9



1 row hot water coil								
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp		
			50	65	80	50	65	80
7	1.5	5.0	63.9	86.2	108.5	81.4	109.8	138.2
	2.5	11.7	69.1	93.1	117.2	91.4	123.2	155.2
	3.5	21.2	72.6	97.9	123.2	97.6	131.6	165.7
15	1.5	5.0	51.8	73.7	96.3	66.0	94.3	122.6
	2.5	11.7	55.8	79.8	103.8	74.1	105.8	137.5
	3.5	21.3	58.7	83.9	109.1	79.0	112.9	146.8
21	1.5	5.0	42.6	64.7	86.7	54.5	82.7	110.9
	2.5	11.7	46.1	70.0	93.8	61.1	92.8	124.4
	3.5	21.3	48.4	73.4	98.5	65.3	99.0	132.8

Performance Data

Air Handling

- Notes:
- 1. Air flows given are for a unit with no filter installed.
 - 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 - 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

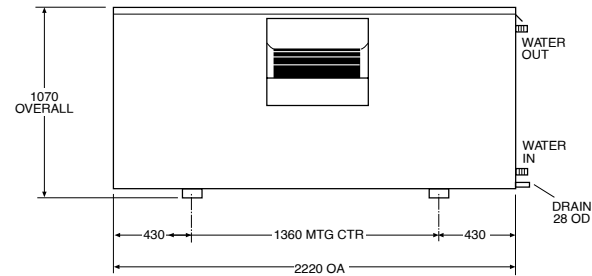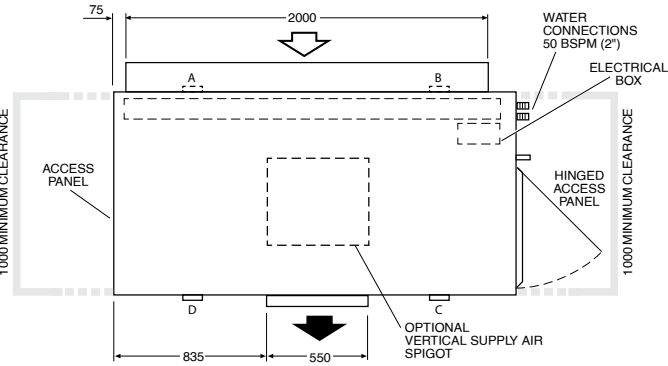

Sound Levels


Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

IJD 1400

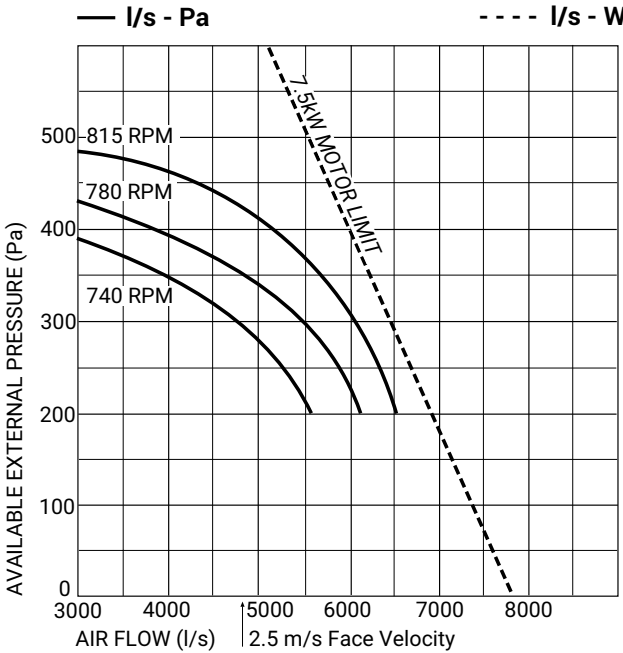

Point Loads			
A	B	C	D
115	145	107	78

*4/1 row coil including water

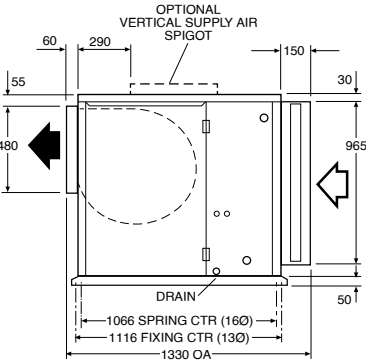

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
740	81	83	80	76	74	76	70
780	86	86	83	83	81	81	76
815	92	90	86	89	87	86	82

IJD 2000			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
4 row chilled water coil			4500 L/s						7500 L/s					
Air on DB/WB	W. flow L/s	P.D. kPa	Entering water temp						Entering water temp					
			6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	3.5	6.9	88.2	64.5	81.0	61.4	73.8	58.4	108.9	89.2	100.3	85.7	91.4	85.2
	5.5	15.3	99.7	69.5	91.4	65.9	83.2	62.4	130.4	98.0	119.6	93.6	109.1	89.3
	7.5	27.2	106.8	72.7	98.1	68.8	89.3	64.9	144.8	104.1	133.0	99.1	120.7	94.0
27/19	3.5	6.9	107.8	79.9	100.6	76.9	93.1	73.9	133.0	111.2	123.9	107.7	115.4	104.5
	5.5	15.3	122.3	85.9	114.2	82.5	105.9	79.1	159.5	121.7	148.7	117.3	137.5	113.0
	7.5	27.2	131.1	89.8	122.4	86.0	113.4	82.2	177.5	128.9	165.3	124.0	153.2	119.1
31/21	3.5	6.9	129.0	94.9	121.5	91.9	114.0	89.0	158.6	132.6	148.5	129.0	140.2	126.0
	5.5	15.3	147.1	102.3	138.7	98.8	130.0	95.3	191.0	144.7	179.9	140.5	167.9	136.1
	7.5	27.2	157.7	106.7	148.5	102.8	139.4	99.1	212.2	153.0	199.8	148.2	187.3	143.3
35/24	3.5	6.9	161.9	105.9	154.1	103.0	146.0	100.1	195.4	145.9	185.8	142.7	176.2	139.6
	5.5	15.3	186.1	115.1	177.0	111.6	168.1	108.2	238.3	160.6	226.9	156.5	215.1	152.5
	7.5	27.2	200.1	120.7	191.4	117.2	181.8	113.4	268.1	171.3	254.7	166.4	241.3	161.6

6 row chilled water coil														
23/17	3.5	9.7	101.1	71.1	92.9	67.6	84.8	64.1	127.2	98.8	117.1	94.6	106.6	90.4
	5.5	22.5	113.1	76.6	104.1	72.5	94.9	68.4	152.2	109.4	139.9	104.1	127.7	98.9
	7.5	38.6	119.7	79.6	110.1	75.2	100.5	70.8	167.5	116.1	153.8	110.1	140.2	104.3
27/19	3.5	9.7	123.9	88.0	115.9	84.5	107.7	81.1	156.1	123.0	144.9	118.6	135.1	114.8
	5.5	22.5	139.1	94.7	129.9	90.6	120.5	86.5	186.6	135.5	173.9	130.2	161.7	125.3
	7.5	38.6	147.3	98.4	137.6	94.0	127.8	89.7	206.2	143.9	192.7	138.0	178.6	132.2
31/21	3.5	9.7	148.7	104.6	140.2	101.0	131.7	97.6	185.8	146.2	175.1	142.2	164.5	138.2
	5.5	22.5	166.9	112.4	157.5	108.3	148.1	104.3	222.9	160.7	210.3	155.8	197.5	150.7
	7.5	38.6	176.9	116.9	167.0	112.4	156.9	108.1	247.1	170.7	233.4	165.0	218.9	159.2
35/24	3.5	9.7	186.5	117.1	177.9	113.7	169.1	110.3	228.9	161.1	218.0	157.3	207.2	153.6
	5.5	22.5	210.7	127.0	201.9	123.3	192.2	119.3	279.2	179.3	265.6	174.2	252.5	169.4
	7.5	38.6	225.2	133.2	215.3	128.9	205.0	124.5	310.8	191.4	296.2	185.7	281.2	180.0


1 row hot water coil														
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp			Entering water temp			Entering water temp		
			50	65	80	50	65	80	50	65	80	50	65	80
7	2.0	3.3	94.3	127.1	160.0	119.2	160.7	202.2						
	4.0	11.4	104.9	141.5	178.1	139.1	187.7	236.2						
	6.0	23.4	111.6	150.7	189.4	150.7	203.3	255.9						
15	2.0	3.3	76.3	109.1	141.8	96.6	138.0	179.3						
	4.0	11.4	84.9	121.2	157.7	112.6	161.1	209.4						
	6.0	23.4	90.0	128.6	167.1	122.1	174.4	226.7						
21	2.0	3.3	63.1	95.7	128.3	79.9	121.1	162.4						
	4.0	11.4	70.0	106.2	142.5	93.1	141.2	189.4						
	6.0	23.4	74.2	112.6	151.0	100.7	152.9	204.9						

Performance Data

Air Handling

- Notes:
1. Air flows given are for a unit with no filter installed.
 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

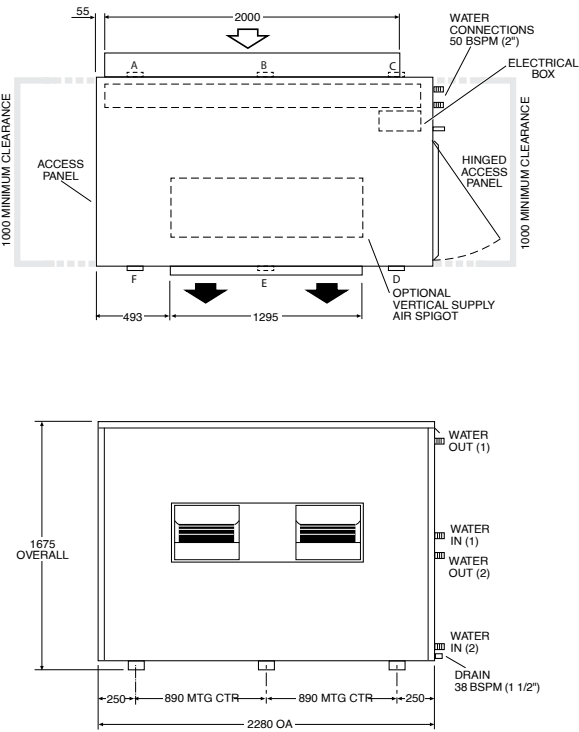

Sound Levels


Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

IJD 2000

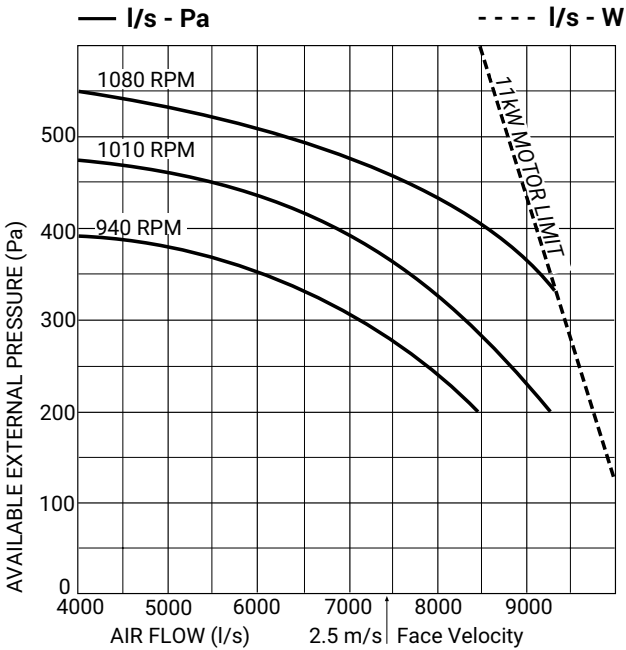

Point Loads					
A	B	C	D	E	F
117	133	149	102	86	70

*4/1 row coil including water

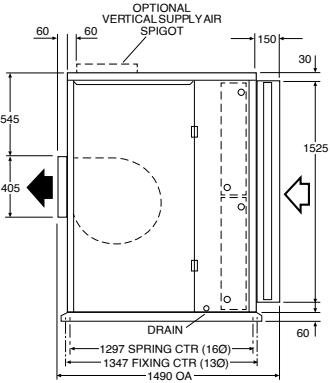

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
940	83	88	86	80	78	74	70
1010	89	92	91	82	81	84	80
1080	99	97	96	95	95	94	90

IJD 2400			Low Air flow (approx 1.5m/s)						Nominal Air flow (approx 2.5m/s)					
4 row chilled water coil			5000 L/s						9000 L/s					
Air on DB/WB	W. flow L/s	P.D. kPa	Entering water temp						Entering water temp					
			6		7		8		6		7		8	
			T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW	T kW	S kW
23/17	5.0	9.8	106.4	75.4	97.8	71.7	88.7	67.8	139.7	110.5	128.4	105.7	116.8	101.3
	7.0	18.3	115.3	79.4	106.0	75.2	96.4	71.0	159.1	118.5	146.8	113.1	132.7	107.6
	9.0	28.5	121.3	82.1	111.5	77.7	101.5	73.3	172.8	124.3	158.8	118.4	143.8	112.4
27/19	5.0	9.8	130.5	93.4	121.8	89.7	112.7	86.0	170.9	137.6	159.4	133.1	147.6	128.6
	7.0	18.3	141.6	98.2	132.1	94.0	122.3	89.9	194.7	147.0	181.4	141.6	167.9	136.4
	9.0	28.5	149.2	101.5	139.2	97.1	129.0	92.7	212.0	154.0	197.4	148.1	182.9	142.3
31/21	5.0	9.8	156.4	110.9	147.6	107.3	138.2	103.6	204.1	163.8	191.9	159.4	179.6	154.9
	7.0	18.3	169.8	116.5	160.0	112.4	150.1	108.3	233.2	174.9	219.4	169.6	205.0	164.2
	9.0	28.5	179.3	120.6	168.9	116.2	158.6	111.8	253.6	182.8	238.7	177.0	223.7	171.3
35/24	5.0	9.8	196.9	124.2	187.3	120.6	177.7	117.0	253.3	181.0	240.9	176.8	227.3	172.3
	7.0	18.3	216.1	131.8	206.0	127.8	195.5	123.7	291.4	194.1	277.2	189.1	262.5	184.1
	9.0	28.5	228.0	136.7	217.3	132.3	206.5	127.9	319.8	204.5	304.1	198.8	288.4	193.1

6 row chilled water coil														
23/17	5.0	14.2	120.9	82.9	111.3	78.6	101.5	74.3	163.9	123.1	150.8	117.6	137.2	111.9
	7.0	25.9	129.7	87.0	119.3	82.2	108.8	77.5	185.6	132.3	170.8	126.0	155.7	119.6
	9.0	40.3	135.7	89.8	124.9	84.8	113.9	79.8	200.1	138.7	184.6	131.9	168.0	124.8
27/19	5.0	14.2	148.6	102.6	138.8	98.3	128.8	94.1	200.7	152.8	187.6	147.5	174.3	142.2
	7.0	25.9	159.3	107.5	149.4	103.0	138.8	98.3	227.8	163.9	212.5	157.6	197.5	151.4
	9.0	40.3	166.9	110.9	155.9	105.9	144.7	100.9	246.6	172.1	230.3	165.0	213.7	158.1
31/21	5.0	14.2	178.1	121.8	168.3	117.6	157.9	113.3	240.1	181.7	225.9	176.3	212.3	171.1
	7.0	25.9	192.0	127.9	181.4	123.3	170.6	118.6	272.2	194.5	256.9	188.3	241.1	182.1
	9.0	40.3	200.6	131.9	189.6	126.8	178.0	121.8	295.6	204.1	278.9	197.2	262.0	190.3
35/24	5.0	14.2	225.2	137.5	214.8	133.2	204.2	129.1	297.3	200.9	283.1	195.8	268.9	190.9
	7.0	25.9	243.7	145.3	232.6	140.5	221.4	135.9	341.4	217.2	325.3	211.1	308.9	205.1
	9.0	40.3	255.1	150.3	243.4	145.1	231.6	140.1	371.5	228.8	354.1	222.0	337.0	215.4


1 row hot water coil								
Air on DB	W. flow L/s	P.D. kPa	Entering water temp			Entering water temp		
			50	65	80	50	65	80
7	4.0	8.6	116.4	156.9	197.6	159.0	226.0	270.2
	6.0	17.8	123.3	166.4	209.2	173.0	245.4	293.8
	8.0	29.6	129.1	174.0	218.9	183.1	259.4	310.7
15	4.0	8.6	94.1	134.5	174.9	128.9	184.2	239.4
	6.0	17.8	99.7	142.6	185.2	140.1	200.2	260.3
	8.0	29.6	104.3	148.8	193.7	148.5	211.9	275.4
21	4.0	8.6	77.7	118.0	158.1	106.5	161.5	216.4
	6.0	17.8	82.3	124.8	167.4	115.7	175.5	235.3
	8.0	29.6	86.0	130.4	174.7	122.4	185.7	249.0

Performance Data

Air Handling

- Notes:
1. Air flows given are for a unit with no filter installed.
 2. In a free blown application, beware of exceeding indoor fan motor's full load amp limit.
 3. Airflows are for dry coil. Reduce airflow by 10% in high moisture removal conditions. Refer to page 51 for filter pressure drop.


Dimensions

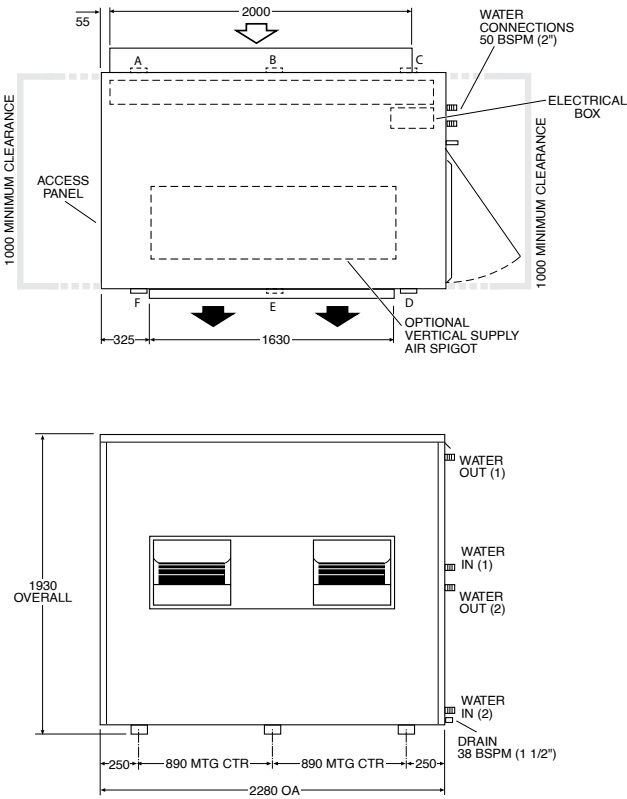

Sound Levels


Test Conditions: BS 848 PT2 1985
Installation Type A (free inlet and outlet)
Direct method of measurement (reverberant room)
Measured in decibels re 1 picowatt

IJD 2400

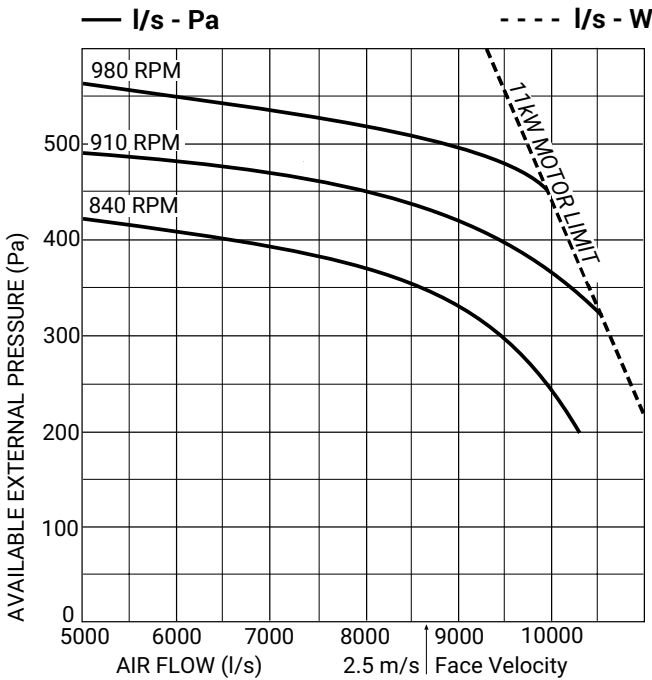

Point Loads					
A	B	C	D	E	F
144	163	184	125	106	87

*4/1 row coil including water

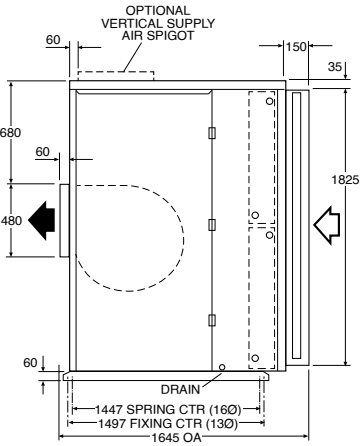

Fan Speed	Sound Power Levels (SWL) (dB)						
	dB(A)	Octave Band Centre Frequency (Hz)					
		125	250	500	1K	2K	4K
840	83	86	83	80	77	76	72
910	90	91	88	87	86	84	79
980	97	97	94	92	92	92	88



Standard



Optional

Range Options & Features

The range of options available allow you to customise your desired unit, giving you ultimate control and flexibility.

Model	● GMW	● IMDL	● IMDL-Y	● IXDL-Y	● IMD	● IMD-Y	● IJD
Features							
kW Range (kW)*	4.0 - 16.0	5.0-15.5	5.0-15.5	4.0 - 20.0	9.5 - 55.0	9.5 - 55.0	36.0 - 230.0
EC Fan (Y) version	N/A	N/A	●	●	N/A	●	□
0-10V Fan Speed Control	N/A	N/A	●	●	N/A	●	□
3rd Party Controls Input	●	●	●	●	●	●	●
High Static Fans	N/A	N/A	N/A	N/A	●	●	●
Epoxy Coated Coil							
Chilled Water Cooling	●	●	●	●	●	●	●
Hot Water Heating (STD)	●	●	●	●	●	●	●
Alternative Electric Heating	N/A	□	□	N/A	□	□	□
Cabinet Colour	●	N/A	N/A	N/A	□	□	□
Stainless Steel Cabinet	N/A	N/A	N/A	N/A	□	□	□
Configuration Options							
Standard Handing (RHS)	N/A	●	●	●	●	●	●
Opposite Handing (LHS)	N/A	●	●	□	●	●	□
Vertical Air Discharge	N/A	N/A	N/A	N/A	N/A	N/A	□
Accessories							
Washable Screen Filter	●	N/A	N/A	N/A	N/A	N/A	N/A
12mm (Washable)	N/A	●	●	●	□	□	N/A
50mm (Disposable)	N/A	N/A	N/A	N/A	N/A	N/A	□
Spring Hanger Kit	N/A	N/A	N/A	N/A	□	□	N/A
Multi-Oval Spigot	N/A	□	□	●	N/A	N/A	N/A

* Nominal cooling capacity @ nominal air flow, 27/19 entering air, 7.0°C water.





NEW ZEALAND DESIGNED
AND MANUFACTURED



temperzone.com



New Zealand

nzsales@temperzone.com

Singapore

sales@temperzone.com.sg

Australia

ausales@temperzone.com

The specifications of this catalogue may change without prior notice to allow Temperzone to incorporate the latest innovations for its customers. The information contained in the catalogue is merely informative. Temperzone declines any responsibility in the broadest sense, for damage direct or indirect, arising from the use and / or interpretation of the recommendations in this catalogue.

TEM03/23

New Zealand

Auckland	09 – 279 5250
Hamilton	07 – 839 2705
Wellington	04 – 569 3262
Christchurch	03 – 379 3216

Asia

Singapore	65 – 6733 4292
Shanghai	21 – 5648 2078

Australia

Sydney	02 – 8822 5700
Adelaide	08 – 8115 2111
Brisbane	07 – 3308 8333
Melbourne	03 – 8769 7600

Distributors

Newcastle	02 – 4962 1155
Perth	08 – 6399 5900
Launceston	03 – 6331 4209

